



**CLEAN DEVELOPMENT MECHANISM
PROJECT DESIGN DOCUMENT FORM (CDM-PDD)
Version 03 - in effect as of: 28 July 2006**

CONTENTS

- A. General description of project activity
- B. Application of a baseline and monitoring methodology
- C. Duration of the project activity / Crediting period
- D. Environmental impacts
- E. Stakeholders' comments

Annexes

- Annex 1: Contact information on participants in the project activity
- Annex 2: Information regarding public funding
- Annex 3: Baseline information
- Annex 4: Monitoring plan

**SECTION A. General description of project activity****A.1. Title of the project activity:**

>>

Project name: Wanzai Kaidi Biomass Power Project

Version: 05

Date: 27/07/2012

Version History:

| Version Number | Date | Comment |
|----------------|------------|--|
| Version 1 | 05/01/2009 | Version submitted for GSP |
| Version 2 | 10/07/2009 | Version submitted to DOE following Draft Validation Report |
| Version 3 | 20/10/2009 | Version submitted for Registration |
| Version 4 | 31/03/2010 | Version submitted after first completeness check |
| Version 5 | 27/07/2012 | Version submitted for Notification |

A.2. Description of the project activity:

>>

Wanzai Kaidi Biomass Power Project (hereafter referred to as the proposed project) is a biomass utilization project developed by Wanzai Kaidi Green Energy Development Co., Ltd.(hereafter referred to as the Project Owner) and is located in Wanzai Industrial park,, Wanzai County, Jiangxi Province, P.R. China.

The scenario existing prior to the start of implementation of the project activity is the generation of power by grid-connected power plants, generation of heat in small coal-fired boilers and the biomass residues(rice husk, branch, barks and saw dust) are dumped or left to decay under mainly aerobic conditions. The latter applies to, for example, dumping and decay of biomass residues on fields or burnt in an uncontrolled manner without utilizing it for energy purposes.

The proposed project will process about 211,000tonnes (wet) of biomass residue annually, of which rice husk, branch, barks and saw dust are the main biomass fuel. 2 sets of 65t/h Circulating Fluidized Bed (CFB) boiler and 2 sets of 12MW steam turbines generator units will be installed. Therefore, the total installed capacity of the Project is 24MW. The annual equivalent operation hours at full load is estimated to be 6000 hours with a net electricity generation of 126,720MWh and a net heat generation of 541,602GJ per year.

The proposed project will not claim GHG emission reductions from displacing heat that would otherwise be produced within Wanzai Industrial Park. The estimated GHG emission reduction is 114,828tCO₂e per year in the first crediting period.

The electricity generated might be transmitted through an 110kV cable to Wanzai 220kV substation and then supplied to the Central China Power Grid (CCPG) indirectly. The proposed project will therefore replace the equivalent capacity of power plants on the CCPG, which is predominantly made up of coal fired power plants. The heat generated will be supplied to the plants in the Wanzai Industrial Park to meet



the process heat demand and replace the heat generated by the small coal-fired boilers within the independent industries.

Additionally, the proposed project will accomplish an extra benefit of greenhouse gas (GHG) mitigation derived from a reduction of methane emissions by utilizing biomass residues from the local area which would otherwise be dumped or left decay under mainly aerobic conditions and burned in an uncontrolled manner outside in the fields.

The baseline scenario is the same as the scenario existing prior to the starting of implementation of the project activity.

The proposed project will not only supply renewable electricity to the grid thereby emission reductions, but it will also contribute to sustainable development of the local community and the host country by means of:

- Supplying clean renewable energy to the CCPG with improvements to the local energy structure;
- Promoting the comprehensive utilization of resources and mitigating emissions caused by decay or uncontrolled burning of the biomass residues;
- Increasing local incomes and providing 93 job opportunities;
- Decreasing GHG emissions from the fossil-fuel fired power plants and the GHG emissions from the uncontrolled burning of the biomass residues as well as decreasing emission of SO_x, NO_x and dust.

In order to meet the requirements in Page 6 and 7 of the applied methodology, the situation of the project activity and baseline scenario has been discussed as follows:

- *For each power plant that was operating at the project site during the most recent three years prior to the start of the project activity: the type and capacity of the power plant, types and quantities of fuels have been used in the power plant during the most recent three years prior to the start of the project activity and whether the plant continues operation after the start of the project activity;*
- ◆ The project activity is a Greenfield project and there is no power plant that was operating at the project site during the most recent three years prior to the start of the project activity.
- *For each boiler or other heat generation equipment that was operating at the project site during the most recent three years prior to the start of the project activity: the type and capacity of the boiler, types and quantities of fuels have been used in the boiler during the most recent three years prior to the start of the project activity and whether the boiler continues operation after the start of the project activity;*
- ◆ The project activity is a Greenfield project and there is no boiler or heat generation that was operating at the project site during the most recent three years prior to the start of the project activity.
- *For each boiler or power plant installed under the project activity: the type and capacity of boilers and/or power plants and which types and quantities of fuels are planned to be used;*
- ◆ The specification of the boilers and turbines installed under the project activity are described in the PDD section A.4.3. The main fuel of the project activity is biomass residues. Diesel will be used as the start-up fuel and there will be some diesel consumption for forklifts at collections sites and project site under the project activity.



CDM – Executive Board

page 4

- *For each new boiler or power plant that would be installed in the absence of the project activity: the type and capacity of the new boilers and/or power plants and which types and quantities of fuels would be used."*
- ◆ There are some existing off-site boilers that were operating at the Wanzai Industrial park, the type, capacity and location of the boiler, type and quantities of fuels have been used in each of the boilers during the most recent three years prior to the start of the project activity have been described in detail in PDD section A 4.3.

A.3. Project participants:

>>

| Name of Party involved (*) ((host) indicates a host Party) | Private and/or public entity (ies) project participants (*) (as applicable) | Kindly indicate if the Party involved wishes to be considered as project participant (Yes/No) |
|--|--|--|
| Peoples' Republic of China (host) | Wanzai Kaidi Green Energy Development Co., Ltd | No |
| United Kingdom | Camco International Limited | No |
| United Kingdom | Camco Carbon Limited | No |
| Switzerland | Camco International Limited | No |

>>

See Annex 1 for details

A.4. Technical description of the project activity:**A.4.1. Location of the project activity:**

>>

A.4.1.1. Host Party(ies):

>>

People's Republic of China

A.4.1.2. Region/State/Province etc.:

>>

Jiangxi Province

A.4.1.3. City/Town/Community etc:

>>

Wanzai County

A.4.1.4. Detail of physical location, including information allowing the unique identification of this project activity (maximum one page):

>>

The proposed project activity is located in the Industrial Area, Wanzai County, Jiangxi Province.

The center of plant has geographical coordinates of 114°29'18" east longitude 28°7'37" north latitude. FigureA-1 shows the location of the proposed project.



Figure A-1. The location of Wanzai Kaidi Biomass Power Project

A.4.2. Category(ies) of project activity:

>>

The proposed project falls into:

Sectoral Scope 1: energy industries (renewable - / non-renewable sources)

Project Activity: Grid-connected renewable power generation;

**A.4.3. Technology to be employed by the project activity:**

>>

Scenario prior to the start of the implementation of the project activity:

- ◆ The equivalent electricity is supplied from the CCPG which is dominated by coal-fired power plants.
- ◆ The process heat demand for each individual plant in the Wanzai Industrial Park is or would be met by individual small coal-fired boilers.

The existing heat demand in the Wanzai Industrial Park is around 15t/h, which is met by individual small coal-fired boilers owned by each plant owner¹. The key information on each individual coal-fired boiler is detailed as below:

Table A-1 The existing off site fossil fuel-fired boilers in the Wanzai Industrial park².

¹ “Introduction on the industrial boilers in Wanzai Industrial Park”, Official letter from the Administration Committee of the Wanzai Industrial park

“Supplementary introduction on the industrial boilers in Wanzai Industrial Park”, Official letter from the Administration Committee of the Wanzai Industrial park

² *ibid*



| Owner | Rated Capacity (t/h) | Commission starting date (year) | Predicted date of replacement | Model | Fuel/Consumption | Distance from the Project(km) | Coordinates |
|--|----------------------|---------------------------------|-------------------------------|----------------|-----------------------|-------------------------------|------------------------|
| Jiangxi Longya Lily Co. Ltd. | 1 | 2006 | 2031 | SZH1-0.7-A II | Coal/600ton per year | 2 | E114°29'23" N28°06'55" |
| Jiangxi Wanhua Science & Technology Co. Ltd. | 4 | 2003 | 2028 | DZL4-1.25-A II | Coal/2400ton per year | 3 | E114°29'52" N28°07'17" |
| Wanzai Rubber Product Co. Ltd. | 4 | 2001 | 2026 | DZG4-1.25-A II | Coal/2400ton per year | 3 | E114°28'42" N28°06'23" |
| Wanzai Wanri Rubber Product Co. Ltd. | 4 | 2005 | 2030 | DZH4-1.25-A II | Coal/2400ton per year | 3 | E114°28'48" N28°06'36" |
| Wanzai Qingye Food Product Co. Ltd | 2 | 2002 | 2027 | SZH2-1.25-A II | Coal/1200ton per year | 3 | E114°28'52" N28°06'40" |

Note: The design lifetime for those kinds of boilers is 30 years³. The average commercial lifetime is above 25 years⁴ therefore a 25 year lifetime is used in the table above to calculate the predicted year of replacement to be conservative.

Although coal-fired boilers for process heat supply are common practice in local area, the small coal fired boilers have a negative impact on the local environment. In consideration of the negative impact on the local environment and in order to build a green, environmental friendly industrial park, the Administration Committee of the Wanzai Industrial park is willing to let the proposed project to provide heat to the individual heat users within the industrial park to meet the heat demand. The official document issued by the Administration Committee of the Wanzai Industrial park⁵ states that the existing boilers at the consumer

³ Boiler intensity calculation standards application manual, standards press of China, 1998 page 11

⁴ "Introduction on the lifetime of the boilers" by the Senior Engineer Zhu yuqing from Central Southern China Electric Power Design Institute of China Power Engineering Consulting Group

⁵ "Introduction on the industrial boilers in Wanzai Industrial Park", Official letter from the Administration Committee of the Wanzai Industrial park



site should stop operation when the proposed project is supplying heat.

Additionally, in another official document issued by Administration Committee of the Wanzai Industrial park, it also states that to provide better infrastructure for the industrial park, the local government will bear the capital cost on the heat pipeline for transporting steam to the independent heat users within the economic development park⁶.

- ♦ The biomass residues which are to be utilized in the proposed power plant are currently dumped or left decay under mainly aerobic conditions and burned uncontrolled outside in the fields.

Baseline Scenario is the same as the scenario prior to the implementation of the project activity.

Project Activity Scenario:

The technology employed by the proposed project is advanced domestic technology. The proposed project will install two sets of 65t/h circulating fluid bed (CFB) boilers with medium temperature and sub-high pressure. At the same time, two 12MW steam turbines and two suited generators will be applied in the proposed project. The steam turbine employed is medium temperature and sub-high pressure extraction condensing steam turbine. The total installed capacity of the proposed project is 24MW and the total efficiency of the plant is approximately 42%.

The key technical specifications of the boiler, turbine and generator are listed in the table below.

TableA-2 Key Equipments Parameters:⁷

| BOILER | |
|----------------------------|--|
| Manufacturer | Jiangxi Jianglian Energy and Environmental Protection Co., Ltd |
| Model | KG65-450/5.29-FSWZ- I |
| Type | Medium temperature and sub-high pressure Circulating Fluidized Bed |
| Maximum evaporation volume | 65t/h |
| Rated steam pressure | 5.29MPa |
| Rated steam temperature | 450°C |
| Feed water temperature | 153.2°C |

“Supplementary introduction on the industrial boilers in Wanzai Industrial Park”, Official letter from the Administration Committee of the Wanzai Industrial park

⁶ Clarifications on taking Wanzai Kaidi Biomass Power Generation Project as the district heating system in Wanzai Industrial Park, WanGongHan [2010] 10

⁷ Equipment purchase Agreement, Annex1, from the Project Owner



CDM – Executive Board

page 9

| | |
|--|--|
| Feed water pressure | 5.72MPa |
| Efficiency | $\geq 86\%$ |
| Quantity | 2 |
| STEAM TURBINE | |
| Manufacturer | NanJing Steam Turbine(Group) Co., Ltd |
| Model | C12-4.90/0.981-12/435°C |
| Type | Medium temperature and sub-high pressure extraction condensing steam turbine |
| Rated power | 12MW |
| Main steam pressure | 4.9Mpa.a |
| Main steam temperature | 435°C |
| Rate extraction steam volume | 15t/h |
| Maxium Extraction steam volume when Rate electricity capacity is 6.59MW | 45t/h |
| Quantity | 1 |
| Manufacturer | China Chang Jiang Energy Corporation. |
| Model | C12-4.90/0.981/435°C |
| Type | Medium temperature and sub-high pressure extraction condensing steam turbine |
| Rated power | 12MW |
| Main steam pressure | 4.9Mpa.a |
| Main steam temperature | 435°C |
| Rate extraction steam volume | 15t/h |
| Maximum Extraction steam volume when Rate electricity capacity is 6.59MW | 45t/h |
| Quantity | 1 |
| GENERATOR | |
| Manufacturer | NanJing Steam Turbine(Group) Co., Ltd |



| | |
|----------------------|---------------------------------------|
| Model | QFJ-15-2 |
| Rated power | 15MW ⁸ |
| Rated voltage | 10.5KV |
| Power factor | 0.8 |
| Efficiency | ≥97% |
| Rated rotating speed | 3000r/min |
| Rated frequency | 50Hz |
| Quantity | 1 |
| Manufacturer | China Chang Jiang Energy Corporation. |
| Model | QF-15-2 |
| Rated power | 15MW ⁹ |
| Rated voltage | 10.5KV |
| Power factor | 0.8 |
| Efficiency | ≥97% |
| Rated rotating speed | 3000r/min |
| Rated frequency | 50Hz |
| Quantity | 1 |

The biomass residues utilized in this proposed project will be mainly rice husk, branch, barks and saw dust . The rice husk will be packed and stored temporarily at the rice mills. Some collection sites will be set up near to the resources for the biomass residues to be processed and stored from where the biomass residues will be transported to the plant according to the dispatch schedule. At the same time, some biomass residues will be transported to the project plant directly.

The biomass residues are weighed by the weighbridge before being fed into the fuel entering system to the boiler for combustion or into the storehouse in the plant for future usage. The steam entered into the turbine is used for power generation and some is extracted for heat supply. The heat generated by the proposed project will be supply to the local industrial users as process heat in the industrial park.

⁸ The generator is sized at 15MW and not 12MW to allow for possible peak generation and to avoid damage to the generation unit by sudden load change in abnormal situations.

⁹ The generator is sized at 15MW and not 12MW to allow for possible peak generation and to avoid damage to the generation unit bu sudden load change in abnormal situations.

The boiler smoke will be treated by a high efficiency bag filter and then carried to the ash storeroom. It is estimated that the annual ash generated from the power plant will be very limited. The ash is expected to be transported outside of the plant and dealt with by some local fertilizer company.

All of the turbine and generator system will be supplied by Chinese domestic suppliers as well as the other auxiliary equipments installed in the power plant.

A flow diagram showing the power plant operation is provided as below.

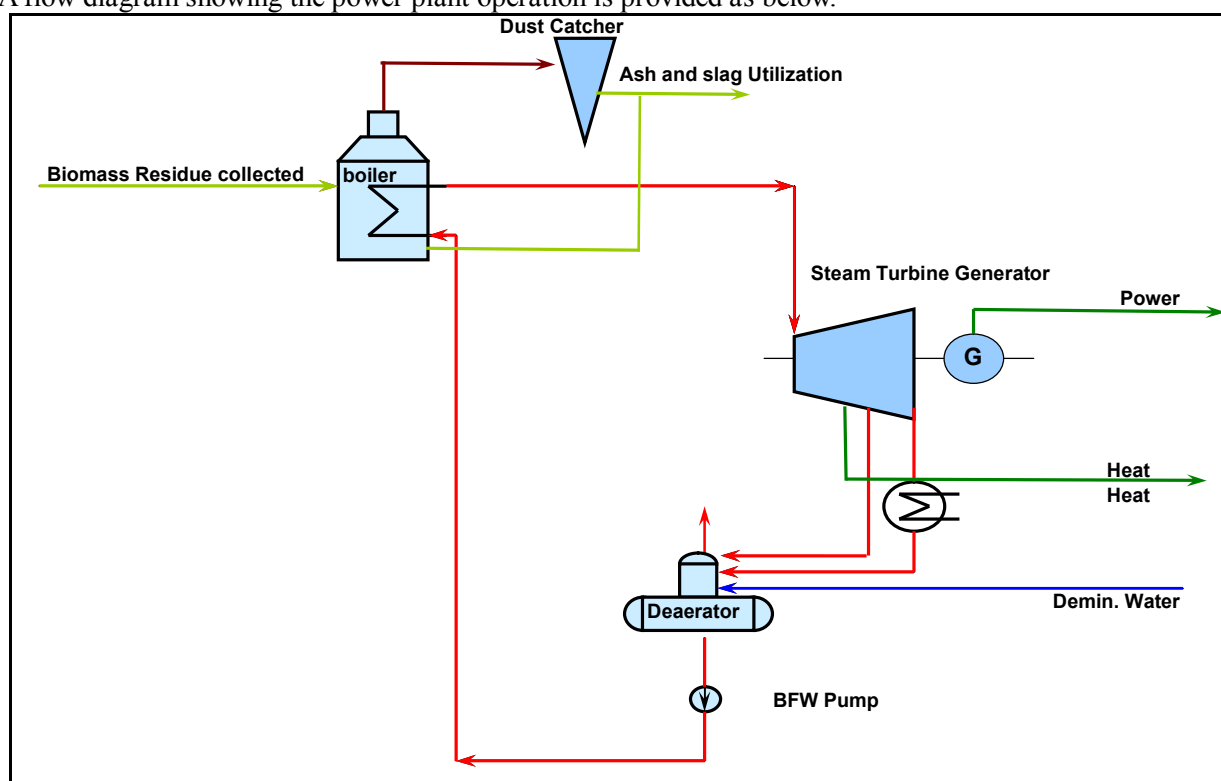


Figure A-2 Flow Diagram of the plant

A.4.4. Estimated amount of emission reductions over the chosen crediting period:

>>

A crediting period of 7 (seven) years (renewable twice) is selected for the project activity. The starting date of the crediting period for the project is 01/01/2011 or the date of registration which ever comes late. During the first crediting period, estimation of emission reductions of the project would be shown in the table below..

| Years | Annual estimation of emission reductions in tonnes of CO ₂ e |
|-------|---|
| 2011 | 114,828 |
| 2012 | 114,828 |
| 2013 | 114,828 |



| | |
|---|---------|
| 2014 | 114,828 |
| 2015 | 114,828 |
| 2016 | 114,828 |
| 2017 | 114,828 |
| Total estimated reductions (tonnes of CO ₂ e) | 803,796 |
| Total number of crediting years | 7 |
| Annual average over the crediting period of estimated reductions (tonnes of CO ₂ e) | 114,828 |

A.4.5. Public funding of the project activity:

>>

There is no public funding for this project.

**SECTION B. Application of a baseline and monitoring methodology:****B.1. Title and reference of the approved baseline and monitoring methodology applied to the project activity:**

>>

1. ACM0006 (Version 09) – “Consolidated methodology electricity generation from biomass residues”
2. “Combined tool to identify the baseline scenario and demonstrate additionality”. (Version 02.2)
3. ACM0002 (Version 10) – “Consolidated baseline methodology for grid-connected electricity generation from renewable sources”
4. “Tool to calculate project or leakage CO₂ emissions from fossil fuel combustion” (Version 02)
5. “Tool to calculate baseline, project and/or leakage emissions from electricity consumption” (Version 01)
6. “Tool to calculate the emission factor for an electricity system” (Version 02)

For more information regarding the methodology, please refer to the link:

<http://cdm.unfccc.int/methodologies/PAmethodologies/approved.html>

B.2. Justification of the choice of the methodology and why it is applicable to the project activity:

>>

ACM0006 is applicable to biomass residue fired electricity generation project activities, including cogeneration plants. The proposed project is a Greenfield power cogeneration project on the operation of an independent plant supplied by biomass residues coming from the nearby area.

The proposed project meets all applicability conditions of ACM0006 which are justified as follows:

| Applicable conditions of ACM0006 | Justification on the applicability of ACM0006 to the Proposed Project |
|---|--|
| No other biomass types than biomass residues, as defined in the methodology, are used in the project plant and these biomass residues are the predominant fuel used in the project plant (some fossil fuels may be co-fired); | Biomass residues (rice husk, branch, barks and saw dust) from local agriculture and forestry will be the predominant fuel at the power plant. Only a small amount of diesel will be used for start-up of the boilers. |
| For projects that use biomass residues from a production process, the implementation of the project shall not result in an increase of the processing capacity of raw input or in other substantial changes in this process; | The biomass residues used by the proposed project are byproducts of agriculture crops and forestry, not from a production process. |
| The biomass residues used by the project facility should not be stored for more than one year; | The biomass residues are consumed on a first-come-first-used basis. According to the FSR, a regular clearance of the warehouse at the power plant will happen every four months. Thus, the biomass residues will not be stored more than one year. |



| | |
|--|--|
| No significant energy quantities, except from transportation or mechanical treatment of the biomass residues, are required to prepare the biomass residues for fuel combustion, i.e. projects that process the biomass residues prior to combustion (e.g. esterification of waste oils). | The preparation of the biomass residues only includes mechanical treatment or transportation. Therefore, the proposed project will not have significant consumption of fossil fuels. |
|--|--|

Besides, the baseline scenario of the project activity corresponds to the "description of the situation" of scenario 2 -one of the scenarios described in Table 2 in the methodology which has been discussed in B.4.

Therefore, ACM0006 is applicable to the proposed project.

B.3. Description of the sources and gases included in the project boundary:

>>

Emission sources:

For the purpose of determining GHG emissions of the **project activity**, the following emission sources are included:

- CO₂ emissions from on-site fossil fuel and electricity consumption that is attributable to the project activity
- CO₂ emissions from transportation of biomass residues to the project site

For the purpose of determining **baseline emissions**, the following emission sources are included:

- CO₂ emissions from fossil fuel fired power plants connected to the electricity system
- The project participants have chosen not to claim CO₂ emissions from fossil fuel based heat generation.

According to the approved methodology ACM0006, where the most likely baseline scenario for the biomass residue use is that the biomass residues would be dumped or left to decay under aerobic or anaerobic conditions or would be burnt in an uncontrolled manner without utilizing it for energy purposes, project participants may decide whether to include CH₄ emissions in the project boundary.

For this project, CH₄ emissions are **included** and these emissions are included in both the calculations for determining project emissions and baseline emissions.

According to the approved methodology ACM0006, the emission sources and GHGs in the project boundary are listed in the following table.

Table B-1 Overview on emissions sources included in or excluded from the project boundary

| | Source | Gas | | Justification / Explanation |
|-----------------|------------------------|------------------|----------|--|
| Baseline | Electricity generation | CO ₂ | Included | Main emission source |
| | | CH ₄ | Excluded | Excluded for simplification. This is conservative. |
| | | N ₂ O | Excluded | Excluded for simplification. This is conservative. |



| | | | | |
|-------------------------|---|------------------|----------|---|
| | Heat generation | CO ₂ | Excluded | The project activity will not claim CO ₂ emissions from fossil fuel based heat generation. |
| | | CH ₄ | Excluded | Excluded for simplification. This is conservative. |
| | | N ₂ O | Excluded | Excluded for simplification. This is conservative. |
| | Uncontrolled burning or decay of surplus biomass | CO ₂ | Excluded | It is assumed that CO ₂ emissions from surplus biomass residues do not lead to changes of carbon pools in the LULUCF sector. |
| | | CH ₄ | Included | Main emission source |
| | | N ₂ O | Excluded | Excluded for simplification. This is conservative. |
| Project Activity | On-site fossil fuel and electricity consumption due to the project activity | CO ₂ | Included | May be an important emission source by the project activity |
| | | CH ₄ | Excluded | Excluded for simplification. This emission source is assumed to be very small. |
| | | N ₂ O | Excluded | Excluded for simplification. This emission source is assumed to be very small. |
| | Off-site transportation of biomass residues | CO ₂ | Included | May be an important emission source by the project activity |
| | | CH ₄ | Excluded | Excluded for simplification. This emission source is assumed to be very small. |
| | | N ₂ O | Excluded | Excluded for simplification. This emission source is assumed to be very small. |
| | Combustion of biomass residues for electricity and / or heat generation | CO ₂ | Excluded | It is assumed that CO ₂ emission from surplus biomass residues do not lead to changes of carbon pools in the LULUCF sector. |
| | | CH ₄ | Included | Since the CH ₄ emissions of biomass residue are included in baseline, according to the methodology, this emission is included in project scenario. |
| | | N ₂ O | Excluded | Excluded for simplification. This emission source is assumed to be very small. |
| | Storage of biomass residues | CO ₂ | Excluded | It is assumed that CO ₂ emissions from surplus biomass residues do not lead to changes of carbon pools in the LULUCF sector. |
| | | CH ₄ | Excluded | Excluded for simplification. Since biomass is stored for not longer than one year, this emission source is assumed to be small. |
| | | N ₂ O | Excluded | For simplification. This emission source is assumed to be very small. |


| | | | | |
|--|--|------------------|----------|--|
| | Waste water from the treatment of biomass residues | CO ₂ | Excluded | It is assumed that CO ₂ emission from surplus biomass residues do not lead to changes of carbon pools in the LULUCF sector. |
| | | CH ₄ | Excluded | The waste water generated is treated under aerobic treatment; therefore, the emission source is not included ¹⁰ |
| | | N ₂ O | Excluded | Excluded for simplification. This emission source is assumed to be very small. |

Spatial Extent of the Project Boundary:

The spatial extent of the project boundary encompasses

- The power plant at the project site;
- Transportation of biomass residues by trucks to the project site;
- All power plants connected physically to the Central China Power Grid (CCPG). The CCPG includes Henan Province, Hubei Province, Hunan Province, Jiangxi Province, Sichuan Province and Chongqing City according to published information by the China DNA¹¹.
- The sites where the biomass residues would have been left for decay or dumped.
- The biomass collection sites where the biomass residues will be pretreated

The heat users are included in the project boundary to account for revenues from selling thermal energy, but they are not considered in the determination of baseline emissions since the project participants have chosen not to claim CO₂ emissions from fossil fuel based heat generation.

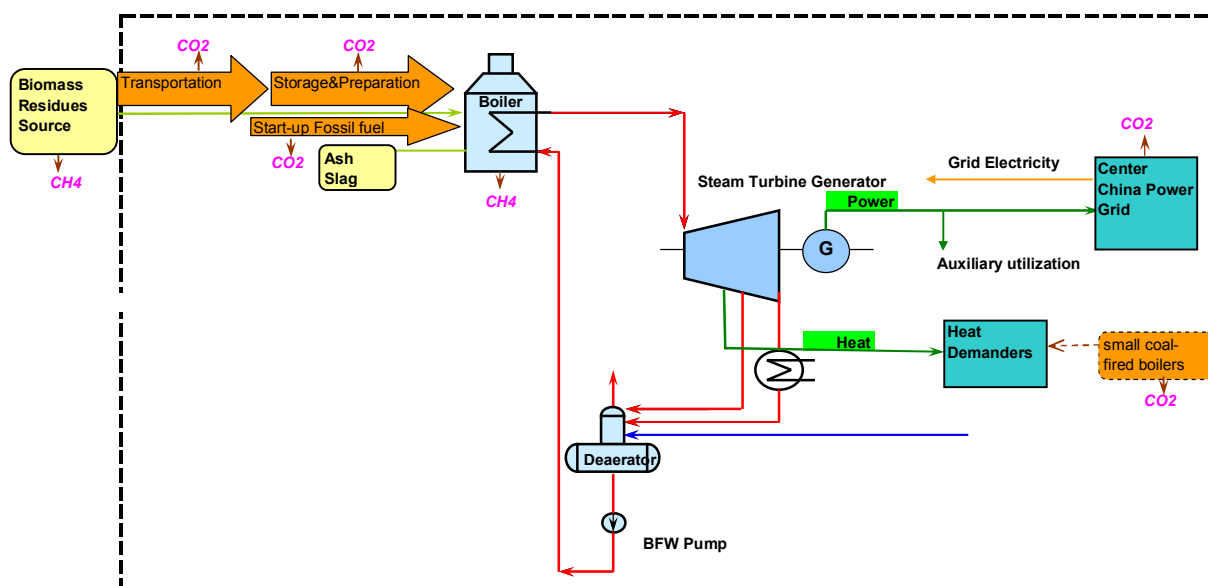

FigureB-1 Project Boundary

¹⁰ EIA report of the project, page 53

¹¹ <http://cdm.ccchina.gov.cn/web/NewsInfo.asp?NewsId=3239>

**B.4. Description of how the baseline scenario is identified and description of the identified baseline scenario:**

>>

According to the latest methodology ACM0006, “Combined Tool to identify the baseline scenario and demonstrate additionality”(Version02.2) should be used to identify the most plausible baseline scenario and demonstrate additionality.

This tool applies the following four steps:

STEP 1 Identification of alternative scenarios

STEP 2 Barrier analysis

STEP 3 Investment analysis (If applicable)

STEP 4 Common practice analysis

STEP 1. Identification of alternative scenarios

This step serves to identify all alternative scenarios to the proposed CDM project activity(s) that can be the baseline scenario through the following sub-steps:

Sub-step 1a. Define alternative scenarios to the proposed CDM project activity

Realistic and credible alternatives should be separately determined regarding:

- How power would be generated in the absence of the CDM project activity;
- What would happen to the biomass residues in the absence of the project activity;
- How the heat would be generated in the absence of the project activity.

According to ACM0006, all the baseline alternatives for **power generation are listed and discussed as follows:**

Table B-2 Define alternatives for power generation

| Alternatives | Realistic and credible alternative scenario? Yes/No |
|---|---|
| P1 The project not undertaken as a CDM project activity. | Yes. Despite the fact that this alternative is economically unattractive, as analysed in step3, this alternative is a plausible scenario for further analysis. |
| P2 The continuation of power generation in an existing biomass residue fired power plant at the project site, in the same configuration, without retrofitting and fired with the same type of biomass residues as (co-)fired in the Project. | No. Since the proposed project is a greenfield project and there is no existing biomass residues fired power plant at the project site, therefore this alternative is excluded. |
| P3 The generation of power in an existing captive power plant, using only fossil fuels. | No. Since there is no existing captive power plant, using fossil fuels near the project site, therefore this alternative is excluded. |



| | |
|---|--|
| P4 The generation of power in the grid | Yes. This alternative is a plausible scenario for further analysis. |
| P5 The installation of a new biomass residue fired power plant, fired with the same type and with the same annual amount of biomass residues as the Project, but with a lower efficiency of electricity generation (e.g. an efficiency that is common practice in the relevant industry sector) than the Project plant and therefore with a lower power output than in the Project case. | No. Since biomass power plants including the lower efficiency ones are not common practice in the local area. There is no on-grid installed capacity from Biomass Power plant before 2007 in Jiangxi Province ¹² . Therefore, this alternative is excluded. |
| P6 The installation of a new biomass residue fired power plant that is fired with the same type but with a higher annual amount of biomass residues as the Project and that has a lower efficiency of electricity generation (e.g. an efficiency that is common practice in the relevant industry sector) than the Project. Therefore, the power output is the same as in the Project | No. Since biomass power plants are not common practice in the local area. There is no on-grid installed capacity from Biomass Power plant before 2007 in Jiangxi Province ¹³ . Therefore, this alternative is excluded. |
| P7 The retrofitting of an existing biomass residue fired power, fired with the same type and with the same annual amount of biomass residues as the Project, but with a lower efficiency of electricity generation (e.g. an efficiency that is common practice in the relevant industry sector) than the Project plant and therefore with a lower power output than in the Project case. | No. Since the proposed project is a greenfield project and there is no existing biomass residues fired power plant at the project site, therefore this alternative is excluded. |
| P8 The retrofitting of an existing biomass residue fired power that is fired with the same type but with a higher annual amount of biomass residues as the Project and that has a lower efficiency of electricity generation (e.g. an efficiency that is common practice in the relevant industry sector) than the Project. | No. Since the proposed project is a greenfield project and there is no existing biomass residues fired power plant at the project site, therefore this alternative is excluded. |
| P9 The installation of a new fossil fuel fired captive power plant at the project site | Yes. This alternative is a plausible scenario for further analysis. |
| P10 The installation of a new single- (using only biomass residues) or co-fired (using a mix of biomass residues and fossil fuels) cogeneration plant | No. Firstly, since biomass cogeneration plants (including single-or co-fired cogeneration plants) are not |

¹² China Electric Power Yearbook ,2007,2006,2005,2004,2003

¹³ ibid



| | |
|---|--|
| <p>with the same rated power capacity as the project activity power plant, but that is fired with a different type and/or quantity of fuels (biomass residues and/or fossil fuels). The annual amount of biomass residue used in the baseline scenario is lower than that used in the project activity.</p> | <p>common practice in the local area. There is no on-grid installed capacity from Biomass Cogeneration plant before 2007 in Jiangxi Province¹⁴.</p> <p>Secondly, there are no other biomass resources identified in the biomass availability report and as such no other viable biomass fuel options available. It is financially unattractive to use some biomass types that are not identified in the biomass availability report.</p> <p>Thirdly, the <i>Renewable Energy Electricity Tariff and Cost Management Trial Regulations (fagaijiage [2006] 7)</i> issued by NDRC of China in 2006 stipulates that “if the energy consumption from the fossil fuel of a co-fired(using a mix of biomass residues and fossil fuels) power plant exceeds 20% of the total energy consumption, the project should be taken as a ordinary fossil fuel fired project”, which means the tariff of the project within the first 15 years since commissioning will be only the bus-bar tariff for Jiangxi Province(0.385RMB/KWh including VAT)without 0.25RMB/KWh as the subsidy. Thus, it is not financially feasible to build new co-fired biomass power project in the region at present.</p> <p>Therefore this alternative is excluded.</p> |
| <p>P11 The generation of power in an existing fossil fuel fired cogeneration plant co-fired with biomass residues, at the project site.</p> | <p>No.</p> <p>Since there is no existing fossil fuel fired cogeneration plant co-fired with biomass residues near the project site, therefore this alternative is excluded.</p> |

According to ACM0006, all the baseline alternatives for **Heat generation** are listed and discussed as follows:

Table B-3 Define alternatives for Heat Generation

| Alternatives | Realistic and credible alternative scenario? Yes/No |
|--|---|
| <p>H1 The Project not undertaken as a CDM project activity.</p> | <p>Yes.</p> <p>Despite the fact that this alternative is economically unattractive, as analyzed in Step3, this alternative is a plausible scenario for further analysis.</p> |

¹⁴ ibid



| | |
|---|---|
| H2 The proposed project activity (installation of a cogeneration power plant), fired with the same type of biomass residues but with a different efficiency of heat generation (e.g. an efficiency that is common practice in the relevant industry sector) | No. Since at present the technology of biomass cogeneration in China is just started and there is no on-grid installed capacity from Biomass Cogeneration power plant before 2007 in Jiangxi Province ¹⁵ , thus it is not common practice in the local area no matter lower efficiency or higher efficiency, therefore this alternative is excluded. |
| H3 The generation of heat in an existing captive cogeneration plant, using only fossil fuels. | No. Since there is no fossil fuel fired cogeneration plant or any other cogeneration plant at or around the project site ¹⁶ . |
| H4 The generation of heat in boilers using the same type of biomass residues. | No. Since there is no heat boiler using biomass residues in the local area, while using small coal-fired boiler is common practice to meet the process heat demand for the plants in the industry park, besides, it is not feasible for the individual enterprise to be equipped with expertise on the biomass collection or biomass-boiler operation. |
| H5 The continuation of heat generation in an existing biomass residue fired cogeneration plant at the project site, in the same configuration, without retrofitting and fired with the same type of biomass residues as in the Project. | No. Since there is no biomass residue fired cogeneration plant at or around the project site ¹⁷ . Therefore, therefore this alternative is excluded. |
| H6 The generation of heat in boilers using fossil fuels. | Yes. As discussed in section A4.3, existing heat demand is met by small fossil-fuel fired boilers ¹⁸ . In the absence of the proposed project, the industrial process heat will continue to be met the individual small fossil fuel fired boilers. Therefore, this alternative is a plausible scenario for further analysis. |

¹⁵ ibid

¹⁶ A letter from Wanzai Investment Promotion Bureau about the “Clarification on that there’s no other existing biomass power plant or biomass energy project except the Wanzai Kaidi Biomass Power Plant Project in Wanzai County”

¹⁷ ibid



| | |
|---|--|
| <p>H7 The use of heat from external sources, such as district heat.</p> | <p>No. Since there is no district heat supply in the local area, heat sources from external sources such as district heating do not exist. Besides, there is no plan to build district heat system in Wanzai County¹⁹</p> |
| <p>H8 Other heat generation technologies (e.g. heat pumps or solar energy).</p> | <p>No. Since the heat consumers for the project are those enterprises located in the industrial park. They require a huge amount of qualified steam, therefore neither solar energy nor heat pumps are feasible heat supply alternatives that could meet the quality nor the quantity of the process heat needed in the industrial park.</p> |
| <p>H9 The installation of a new single- (using only biomass residues) or co-fired (using a mix of biomass residues and fossil fuels) cogeneration plant with the same rated power capacity as the project activity power plant, but that is fired with a different type and/or quantity of fuels (biomass residues and/or fossil fuels). The annual amount of biomass residue used in the baseline scenario is lower than that used in the project activity.</p> | <p>No. Firstly, since biomass cogeneration plants (including single-or co-fired cogeneration plants) are not common practice in the local area. There is no on-grid installed capacity from Biomass Cogeneration plant before 2007 in Jiangxi Province²⁰.</p> <p>Secondly, there are no other biomass resources identified in the biomass availability report and as such no other viable biomass fuel options available. It is financially unattractive to use some biomass types that are not identified in the biomass availability report.</p> <p>Thirdly, the <i>Renewable Energy Electricity Tariff and Cost Management Trial Regulations (fagaijiage [2006] 7)</i> issued by NDRC of China in 2006 stipulates that “ if the energy consumption from the fossil fuel of a co-fired(using a mix of biomass residues and fossil fuels) power plant exceeds 20% of the total energy consumption, the project should be taken as a ordinary fossil fuel fired project”, which means the tariff of the project within the first 15 years since commissioning will be only the bus-bar tariff for Jiangxi</p> |

¹⁸ “ Introduction on the boilers in Wanzai Industrial Park”, official letter of Administration Bureau of Wanzai Industrial Park

¹⁹ At the validation site visit on February 27th, 2009, local County officials attended and confirmed that there are no future plans for district heating in Wanzai County.

²⁰ *ibid*



| | |
|---|--|
| | <p>Province(0.385RMB/KWh including VAT)without 0.25RMB/KWh as the subsidy. Thus, it is not financially feasible to build new co-fired biomass power project in the region at present.</p> <p>Therefore this alternative is excluded.</p> |
| H10 The generation of power in an existing fossil fuel fired cogeneration plant co-fired with biomass residues, at the project site. | No. Since there is no existing fossil fuel fired cogeneration plant co-fired with biomass residues near the project site, therefore this alternative is excluded. |



According to ACM0006, all the baseline alternatives for **the use of biomass residues** are listed and discussed as follows

Table B-4 Define alternatives to each biomass type

| Alternative | Realistic and credible alternative scenario? Yes/No | |
|--|--|--|
| | Rice Husk | Forestry residues (Including Branch, Barks and Saw dust) |
| B1 The biomass residues are dumped or left to decay under mainly aerobic conditions. This applies, for example, to dumping and decay of biomass residues on fields. | <p>Yes.</p> <p>The availability of the rice husk which has been investigated by the FSR institute with support from the local authorities²¹ shows that 18,070 tons of the rice husk are used for other purposes which only takes up 10% of the total available rice husk generated in the region (180,670 tons), with the rest (90%) left to decay under mainly aerobic conditions or burnt in an uncontrolled manner without utilizing it.</p> <p>The rice mills have limited room for the rice husk and they have to burn it or dump it to leave room for the rice.</p> <p>Therefore, this alternative is a plausible scenario for further analysis.</p> | <p>Yes.</p> <p>The availability of the forestry residues which have been investigated by the FSR institute with support from the local authorities²² shows that 60,750 tons of the forestry residues were used for other purposes which only takes up 15% of the total available forestry residues generated in the region (405,000 tons), with the rest (85%) left to decay under mainly aerobic conditions or burnt in an uncontrolled manner without utilizing it.</p> <p>The local farmers have to get rid of a huge amount of straws in order to keep the land free for the next season's planting, so they burn the straw in the field.</p> <p>Therefore, this alternative is a plausible scenario for further analysis.</p> |
| B2 The biomass residues are dumped or left to decay under clearly anaerobic conditions. This applies, for example, to deep landfills with more than 5 meters. This does not apply | <p>No.</p> <p>It is common that the biomass residues are dumped or left to decay under mainly aerobic conditions and burned in an uncontrolled way outside in the fields. In</p> | <p>No.</p> <p>It is common that the biomass residues are dumped or left to decay under mainly aerobic conditions and burned in an uncontrolled way outside in the fields.</p> |

²¹ Biomass Availability Report of the proposed project, Wuhan Kaidi Electric Power Engineering Co., Ltd., January 2012

²² Biomass Availability Report of the proposed project, Wuhan Kaidi Electric Power Engineering Co., Ltd., January 2012



| | | |
|--|--|---|
| to biomass residues that are stock-piled or left to decay on fields. | China, landfill plant only collects and processes the residential waste which does not cover the waste from agricultural and industrial sector, like the rice husk. | In China, landfill plant only collects and processes the residential waste which does not cover the waste from agricultural and industrial sector, like the forestry residues. |
| B3 The biomass residues are burnt in an uncontrolled manner without utilizing it for energy purposes. | Yes. As for Alternative B1. This alternative is a plausible scenario for further analysis. | Yes. As for Alternative B1. This alternative is a plausible scenario for further analysis. |
| B4 The biomass residues are used for heat and/or electricity generation at the Project site | Yes. This alternative is a plausible scenario for further analysis. | Yes. This alternative is a plausible scenario for further analysis. |
| B5 The biomass residues are used for power generation, including cogeneration, in other existing or new grid-connected power plants | No. Using biomass to generate electricity or heat is not common practice in this region: near the project site, there are no existing power plants (including) cogeneration projects or boilers which are using rice husks to generate energy. Besides, confirmed by Wanzai County Investment Promotion Bureau, there will be no other biomass power plant except the proposed project and there will be no other biomass energy projects in Wanzai County ²³ . | No. Using biomass to generate electricity or heat is not common practice in this region: near the project site, there are no existing power plants (including) cogeneration projects or boilers which are using forestry residues to generate energy. Besides, confirmed by Wanzai County Investment Promotion Bureau, there will be no other biomass power plant except the proposed project and there will be no other biomass energy projects in Wanzai County ²⁴ . |
| B6 The biomass residues are used for heat generation in other existing or new boilers at other sites. | No. As for Alternative B5. | No. As for Alternative B5. |
| B7 The biomass residues are used for other energy purposes, such as the generation of | No. There are no projects using biomass residues like rice | No. There are no projects using biomass residues like |

²³ A letter from Wanzai Investment Promotion Bureau about the “Clarification on that there’s no other existing biomass power plant or biomass energy project except the Wanzai Kaidi Biomass Power Plant Project in Wanzai County”

²⁴ ibid



| | | |
|--|---|--|
| biofuels | husk for other energy purposes at the project site now or in Wanzai County's development plan ²⁵ . Besides, due to the high cost in the biofuels projects, the biofuel industry in China just started development and the biomass used for the biofuels are crops or non-crops plants mainly including the broomcorn, cassavas, sweet potato, Coptis chinensis, hairy chestnut, tung tree, palm oil or waste cooking oil and/or waste fat from biogenic origin ²⁶ . The biomass residues used in the proposed project are not common raw material to produce biofuel. | forestry residues for other energy purposes at the project site now or in Wanzai County's development plan ²⁷ . Besides, due to the high cost in the biofuels projects, the biofuel industry in China just started development and the biomass used for the biofuels are crops or non-crops plants mainly including the broomcorn, cassavas, sweet potato, Coptis chinensis, hairy chestnut, tung tree, palm oil or waste cooking oil and/or waste fat from biogenic origin ²⁸ . The biomass residues used in the proposed project are not common raw material to produce biofuel. |
| B8 The biomass residues are used for non-energy purposes, e.g. as fertilizer or as feedstock in processes (e.g. in the pulp and paper industry) | No. Around 18,070 tons of rice husk within the collection radius are used as feedstuff, which only accounts for 10% of the total rice husk availability and according to the leakage analysis in Section B.6.1, the rice husk is quite abundant surplus, the project will not change the use of rice husk as feedstuff. | No. Around 60,750 tons of the forestry residues within the collection radius are used as household fuel, feedstuff and fertilizer which only accounts for 15% of the total straws availability and according to the leakage analysis in Section B.6.1, the forestry residues are quite abundant surplus, the project will |

²⁵ ibid²⁶ Interim Rules on management on demonstration non-food biofuels projects (Consultative Draft) Dated in 2007 issued by NDRC of China²⁷ A letter from Wanzai Investment Promotion Bureau about the "Clarification on that there's no other existing biomass power plant or biomass energy project except the Wanzai Kaidi Biomass Power Plant Project in Wanzai County"²⁸ Interim Rules on management on demonstration non-food biofuels projects (Consultative Draft) Dated in 2007 issued by NDRC of China



| | | |
|--|--|---|
| | | not change the use of forestry residues as their non-energy uses as household fuel, feedstuff and fertilizer. |
|--|--|---|



To summarize, alternatives **P1, P4, P9, H1, H6, B1, B3 and B4** are plausible alternatives for further analysis both for rice husk and forestry residues..

Outcome of Step 1a:

As described above, the plausible alternative alternatives for the proposed project are **P1, P4** and **P9** for power generation, **H1** and **H6** for heat generation and **B1 B3 and B4** for the biomass residues

Sub-step 1b. Consistency with mandatory applicable laws and regulations:

In this sub step, alternatives which are not compliance with laws and regulations will be eliminated:

Alternatives P9 is not consistent with mandatory applicable laws and regulations. In 2006, the average annual utilization hour of Chinese fuel-fired power equipments is 5612 hours²⁹. Considering the same annual electricity generation, the alternative baseline scenario for the proposed project should be a fuel-fired power plant with installed capacity of 26 MW. Furthermore, given that the proposed project is a grid-connected project, the alternative baseline scenario must be a grid-connected fuel-fired power project.

According to Chinese power regulations, it is prohibited to construct fuel-fired power plants of less than 135MW³⁰ in the areas covered by large grids. The alternative of building a fossil fuel-fired power plant with installed capacity of 26MW conflicts with Chinese regulations. Therefore, **P9** is excluded.

Outcome of Step 1b:

The plausible alternative scenarios are compliance with laws and regulations: **P1** and **P4** for power generation; **H1** and **H6** for heat generation and **B1 B3 and B4** for biomass residues. Namely, two plausible combined scenarios are left after Step 1:

- (a) The Project not undertaken as a CDM project activity. (P1,H1,B4)
- (b) The generation of power in the grid; the generation of heat in boilers using fossil fuels; the biomass residues are dumped or left to decay under mainly aerobic conditions or are burnt in an uncontrolled manner without utilizing it for energy purposes. (P4,H6,B1 or B3, which is Scenario 2 in ACM0006)

STEP 2. Barrier analysis

There are no barriers identified that would prevent the implementation of either of the two alternative scenarios above. Therefore, neither of the two combined scenarios is eliminated by the step2. The two combined scenarios need to be further discussed in Step 3.

STEP 3. Investment analysis

According to the ACM0006 (Version 09), project participants shall identify the most plausible baseline scenario and demonstrate additionality using the latest approved version of the “Combined tool to identify the baseline scenario and demonstrate additionality”.

However, Version 02.2 of the aforementioned tool establishes in footnote 1 (on the first page) that for project activities in which one or more alternatives are not available options to project participants (such as

²⁹ China Electric Power Yearbook 2007

³⁰ Notice on Strictly Prohibiting the Illegal Installation of coal-fired Generators with the Capacity of 135MW or below issued by the General Office of the State Council, Guo Ban Fa Ming Dian decree No. 2002-6



grid-connected power projects), a different procedure to demonstrate additionality and identify the baseline scenario must be followed. For example, methodologies that involve alternatives that is not under the control of project participants can continue to use, if desired, the additionality tool (provides benchmark and other tools that utilize information about the markets in which such projects might compete), and provide their own methods to develop and/or assess baseline scenario. Besides, “Guidance on the Assessment of Investment Analysis” issued in EB51 has clearly pointed that if the alternative to the project activity is the supply of electricity from a grid this is not to be considered an investment and a benchmark approach is considered appropriate.

According to the above, this PDD will use the Benchmark to analyze whether the proposed project activity is less economically or financially attractive than the alternatives without the revenue from CERs. The investment analysis is conducted in the following steps:

Sub-step 3a. Apply benchmark analysis.

The project IRR benchmark for this project is 8%. This was set by the Department of Power Generation & Transmission Operations of the former State Power Corporation of China, in the “Interim Rules on Economic Assessment of Electrical Engineering Retrofit Projects”³¹. This organization was responsible for carrying out government policies relating to new and retrofit power projects and for issuing rules such as IRR benchmark. Following re-organization, the functions of the State Power Corporation were transferred to the National Development and Reform Committee.

The Interim Rules were issued based on “The Methodology and Parameters for Financial Evaluation of Construction projects (Chapter 1 General, Section 1.1)” edited by the National Development and Reform Committee and Construction Ministry. The 8% project IRR benchmark listed in the Interim Rules is still valid and is applicable to new and retrofit power projects including cogeneration power projects, and is accepted as the benchmark of CDM projects in the power sector which has been used widely for the Feasibility Studies Reports of those projects. Hence, the proposed project adopts this benchmark. In addition, the 8% project IRR benchmark used in the PDD is an important index that is adopted in the benchmark investment analysis of Feasibility Study Report (FSR). The project FSR was approved by DRC of Jiangxi Province in February, 2008.

Sub-step 3b. Calculation and comparison of financial indicators.

1) Key Parameters needed for calculation of IRR

All input values in the investment analysis used in the PDD are derived from the FSR which was undertaken by Wu Han Kaidi Electric Power Engineering Company Limited, a qualified design institute and an independent party. (Qualification rank: Grade A for power sector, No.170606-sj issued by Ministry of Construction of P.R. China). The FSR was approved by Jiangxi Province Development and Reform Commission. In this context, the FSR should be deemed as credible and reliable source to be applied in the investment analysis.

³¹ State Power Corporation of China. Interim Rules on Economic Assessment of Electrical Engineering Retrofit Projects. Beijing: China Electric Power Press, 2003.



The FSR of the project activity was completed in March 2008. Although the completion of FSR was later than the investment decision, the input values from the FSR of the proposed project is still deemed to be suitable to be applied in the investment analysis due to the reasons addressed below:

- i. **The assumptions of input value from the FSR of proposed project are the same/similar as those in the FSRs of three similar pilot projects using for investment decision.**

The proposed project is applying exactly the same equipment and technology provided by the same supplier and therefore the key financial parameters are assumed to be the similar to the three pilot projects. The projects are also all located in industrial parks with the intention of supplying heat to industrial users. They are all belong to biomass power plants. The FSRs are all written by the same FSR institute and the projects are all invested by the same company. The CDM revenues are also included in the three pilot projects' FSRs. As such any differences in assumptions are minor and each project can be assumed to be similar to another for the purposes of the investment decision.

The table below shows a comparison of input values in the FSRs for proposed project and three similar pilot projects:

Table B-5 Comparison of the input value for proposed project and pilot projects.

| | | Proposed Project | Jianli Kaidi Biomass Power Project (Registered; Ref No.3044; in the following: Jianli)³² | Hunan Yueyang Kaidi Biomass Power Project (Ref No.3065; in the following Yueyang)³³ | Hunan Yiyang Kaidi Biomass Power Project (Ref No.3072; in the following: Yiyang)³⁴ |
|---------------------------------------|-------------|-------------------------|--|---|--|
| Parameter | Unit | Value | Value | Value | Value |
| Installed capacity | MW | 24 | 24 | 48 | 48 |
| Project Lifetime (operational period) | Years | 20 | 20 | 20 | 20 |
| Operation hours | Hour | 6,000 | 6,000 | 6,000 | 6,000 |
| Gross power generation | MWh | 144,000 | 144,000 | 288,000 | 288,000 |
| Self-consumption rate | % | 12 | 12 | 12 | 12 |
| Net Power Generation output | MWh | 126,720 | 126,720 | 253,440 | 253,440 |
| Net Heat Generation | GJ | 541, 600 | 541, 602 | 1,083,204 | 1,083,204 |

³² Jianli FSR

³³ Yueyang FSR

³⁴ Yiyang FSR



| | | | | | |
|---|---------|-------------|-------------|-------------|-------------|
| output | | | | | |
| Static total investment | RMB | 226,410,000 | 264,770,000 | 438,720,000 | 444,800,000 |
| Tariff (incl. VAT) in first 15 years | RMB/MWh | 635 | 632 | 653 | 653 |
| Tariff (incl. VAT) after the 15 years | RMB/MWh | 385 | 382 | 403 | 403 |
| Heat price (excl. VAT) | RMB/GJ | 29.85 | 29.85 | 29.85 | 29.85 |
| Annual O&M cost (including the fuel cost) | RMB | 62,363,813 | 59,868,380 | 125,567,841 | 124,017,274 |
| Unit O&M | RMB/KWh | 0.43 | 0.42 | 0.44 | 0.43 |
| Biomass Cost | RMB/t | 260 | 241 | 275 | 270 |
| Income tax | % | 25% | 25% | 25% | 25% |
| VAT for Electricity | % | 17% | 17% | 17% | 17% |
| VAT for Heat | % | 13% | 13% | 13% | 13% |
| Depreciation period | Years | 15 | 15 | 15 | 15 |
| Residual Rate | % | 4 | 4 | 4 | 4 |
| Benchmark | % | 8 | 8 | 8 | 8 |
| IRR without CDM revenue | % | 3.21 | 3.03 | 4.83 | 5.28 |

From the table above, it is clear that all input values for the proposed project and pilot projects are similar. Based on the assumptions of the input value above, the project IRR of proposed project without CDM revenue is 3.21% , while the project IRRs without CDM revenue for three pilot projects i.e Jianli, Yueyang, Yiyang are 3.03%, 4.83%,5.28% respectively. This demonstrates that the applied input values from the FSR will not modify the additionality of the proposed project.

ii. The valid of the input values from the FSRs of the pilots projects at time of investment decision

The period between the completion of the three pilot project FSRs (June, August, September 2007 respectively) and the investment decision (21 September 2007; date of Board Resolution) is less than 1 year and as such the assumptions in the FSRs of the three pilot projects are considered to be valid at the time of the investment decision.

iii. The period between the investment decision and the FSR completion is short enough that the input values for investment analysis can't be changed materially

The period between the completion of the FSR of the proposed project (March 2008) and the investment decision (21 September 2007; date of Board Resolution) is less than 1 year, thus there is no material changes of the input values assumed.

- The applied relevant sector and national standards in the FSR have not been changed.

The FSR of proposed project was designed complying with the Budgetary Estimation and Calculation Standard for Engineering Construction of Fuel-fired Power Sector, the Band Calculation of Budget for



Engineering Construction of Power Sector, Interim Rules on Economic Assessment of Electrical Engineering Retrofit Projects, The Methodology and Parameters for Financial Evaluation of Construction projects which were also applied in the FSRs of pilot projects in the time of investment decision. It is also currently required to be complied with and applied in the Feasibility study for the power generation and cogeneration project hence is valid and applicable whenever at the time of the investment decision and the time of the FSR of the project.

- The applied benchmark has not been changed.

The sector benchmark 8% for power generation and cogeneration has been required. The applied benchmark of proposed project in the FSR is the same one using in the time of investment decision.

In conclusion, above the arguments fully substantiate the input value in the investment analysis is valid and applicable, appropriate at the time of the investment decision. The applied input values from FSR of the proposed project can completely represent the information and data available at the time of the investment decision and hence is appropriate to be used for the investment analysis.

According to the Feasibility Study Report (FSR) of the proposed project, key parameters needed for calculation of IRR are as follows:

Table B-6 Key Parameters for calculation of IRR

| Parameter | Value | Unit | Source |
|--|-------------|---------|----------------|
| Installed capacity | 24 | MW | FSR Vol.01 P5 |
| Project Lifetime (operational period) | 20 | years | FSR Vol.03 P5 |
| Net Power Generation output | 126,720 | MWh | FSR Vol.01 P19 |
| Net Heat Generation output | 541, 602 | GJ | FSR Vol.01 P20 |
| Static total investment | 226,410,000 | RMB | FSR Vol.03 P38 |
| Tariff(incl. VAT) in first 15 years | 635 | RMB/MWh | FSR Vol.03 P7 |
| Tariff(incl. VAT) after the 15 years | 385 | RMB/MWh | FSR Vol.03 P7 |
| Annual O&M cost(including the fuel cost) | 62,363,813 | RMB | FSR Vol.03 P42 |
| Heat price(excl. VAT) | 29.85 | RMB/GJ | FSR Vol.03 P7 |
| Biomass Cost | 260 | RMB/t | FSR Vol.03 P5 |
| Income tax | 25% | | FSR Vol.03 P6 |
| VAT for Electricity | 17% | | FSR Vol.03 P6 |
| VAT for Heat | 13% | | FSR Vol.03 P6 |
| Depreciation period | 15 | years | FSR Vol.03 P6 |
| Residual Rate | 4% | | FSR Vol.03 P6 |
| Expected CER price | 8.5 | EUR | Estimated |

The project owner made the investment decision based on the FSR and all the input values used in the investment analysis were taken from the FSR for the project carried out by the FSR Institute, which is certified to compile design reports for power projects with the highest grade A issued by Ministry of Construction P.R.China. In accordance to Chinese procedures, assumptions and data sources for the economic evaluation are based on relevant national standards and criteria. Furthermore, all the data in the



FSR was assessed by designated independent experts and finally approved by the DRC of Jiangxi Province. Therefore, the values are considered to be reliable and suitable.

In addition, the rationality of the main assumptions are justified as follows:

Static total investment

The static total investment does not include investment on heat pipelines, since there is no agreement yet with the industrial park whether the industrial park or the project owner should pay for it, but the heat revenues are definitely included in the IRR calculation and therefore the investment analysis is conservative. The static total investment is broken down as follows:

| | |
|-----------------------------|--------------------|
| Civil Works | 56.53 Million RMB |
| Equipment Purchasing t Fees | 77.05 Million RMB |
| Equipment Installation Fees | 44.07 Million RMB |
| Other expenditure | 48.76 Million RMB |
| Sub-Total | 226.41 Million RMB |

Considering that the static total investment per kW of biomass power projects in China are generally above 10,000-13,000 RMB/kW³⁵, the static total investment of the proposed project of 9,434RMB/kW which can be considered to be appropriate.

Additionally, the proposed project started construction in 2008, which is much later than the registered projects, it is reasonable to assume that costs would have risen since the other project were constructed. Specifically inflation for the main raw materials would need to be considered in the comparison. The national Pricing Indices of raw materials and power in year 2003,2004,2005,2006,2007(which are 104.8,111.4,108.3,106,104.4 respectively³⁶) and the national Pricing Indices of investment in fixed assets in year 2003,2004,2005,2006,2007 (which are 102.2,105.6,101.6,101.5,103.9³⁷) are representing an average increase of 3% per year both show a general increasing trend of investment cost in China prior to the investment decision.

Given that the project total investment is both consistent with industry standards and with other projects registered with the CDM Executive Board, it is reasonable to conclude that the static total investment of the project in the FSR is justified.

O&M Costs

The O&M costs include the fuel expenditure (biomass residues cost), Material expenditure, Water expenditure, Employee expenditure, Repairs and maintenance, Insurance fee and other O&M expenditure. Of these, the fuel expenditure represents 75% of the total O&M cost.

³⁵ <http://www.newenergy.org.cn/Html/0084/4100816608.html>

³⁶ Data source: China Statistical Yearbook 2004-2008; <http://www.stats.gov.cn/tjsj/ndsj/2008/indexch.htm>

³⁷ *ibid*

The biomass cost is estimated based on investigation on the local labour cost, collection cost, transportation cost and pre-treatment cost by the FSR writing institute and the project owner with the support from the local authorities.

The project owner does not own the biomass residues as they belong to individual farmers. The project owner procures the biomass from the agent who organizes the collection and the transportation of biomass from the field to the power plant. Therefore there are many associated costs with the procurement of biomass residue for the power plant. The project business model for biomass procurement is showed as below:




Figure B-2 Project Business Model for Biomass Procurement

The value applied in the investment analysis is a reflection of the fact that in order to get the biomass from the fields to the power plant there are associated costs with collection cost particularly agent cost for collection, transportation, handling and storage. This is clearly described in the FSR and Biomass Availability Report of the project. According to the FSR and the Biomass Availability Report, the work flow for the biomass supply chain is as shown in Figure B-3 below.

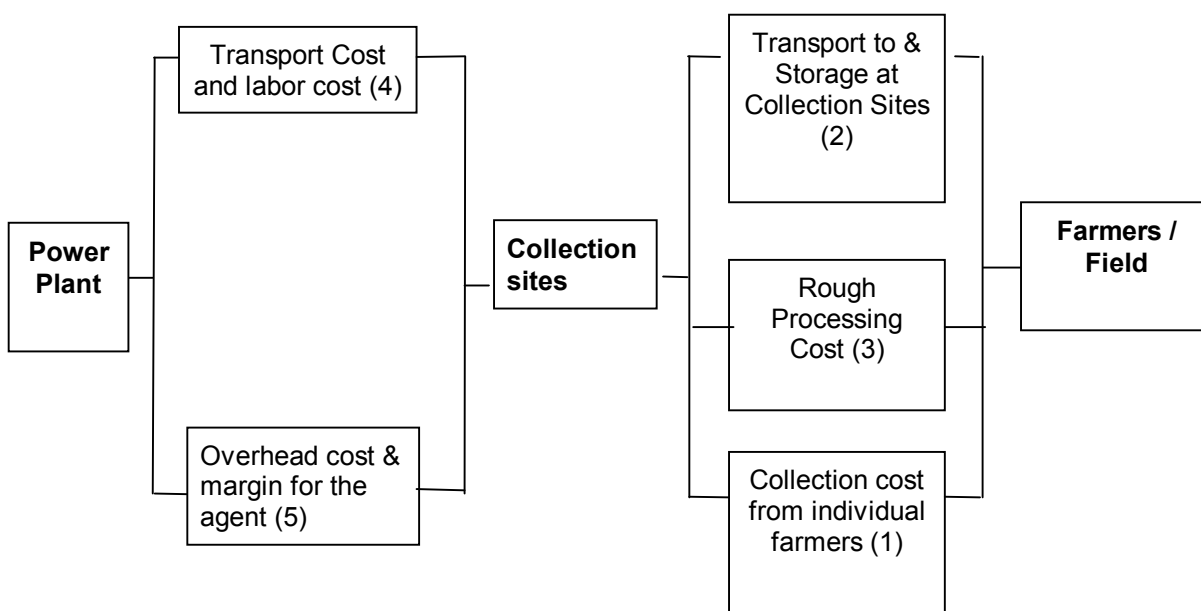


Figure B-3 Work flow for biomass collection and transportation



The above work flow clearly shows that there are costs incurred in two stages. Firstly, the cost incurred from the fields to the collection sites and then secondly, the cost incurred from the collection sites to the power plant.

The cost incurred from the fields to the collection sites includes the biomass collection cost from the individual farmers to the collection site (1), then transport to the collection sites and storage at the collection site (2) and then pre-treatment cost of biomass incurred at the collection sites (3).

The costs incurred to get the biomass from the collection sites to the power plant again include vehicles and labor (4). There will also be an overhead cost and margin associated with the third party agent that supplies the biomass from the local farmers (5).

The business model applied in the project is common practice according to the research report from the Chinese Journal, Renewable Energy Resources³⁸ which also illustrates the same work flow for collection, transportation, handling and storage, agent's overhead and margin as the project activity.

Breakdown of Biomass Costs for the proposed project

The breakdown of the biomass cost (delivered to the plant) for the proposed project has been estimated and provided by the FSR design institute³⁹ and this breakdown is as follows (in accordance with the work flow in Figure B-3 above):

- i. ***Cost from farmers/field to the collection site (1+2): 115RMB/ton***, including the collection cost at the field (labor cost) and transportation cost from field to the collection sites and storage.
- ii. ***Cost incurred at the collection site (3+5): 70RMB/ton***, including the land utilization cost, pre treatment cost, labor cost, biomass residues loss, agent margin/agent cost
- iii. ***Cost from the collection site to the power plant for power generation (4): 75RMB/ton***, including the transportation cost, the labor cost (loading and unloading), and the biomass loss.

The total purchase cost of 260RMB/tonne in the IRR calculation is derived from the cost breakdown above and therefore does not represent a market value. The cost breakdown does include a margin for the agent to undertake the role as intermediary, but this is considered to be reasonable given the costs that the agent incurs.

It is reported that the typical biomass cost in the CCPG area where the project located was 300RMB/ton in 2006⁴⁰, whereas, the project assumes 260RMB/ton.

Therefore, the biomass cost in the FSR should be considered to be appropriate and conservative.

Power and Heat Generation:

The Net Power Generation of the project in the FSR is calculated as follows:

³⁸ The operating model, existing problems and development strategies for China's straw storage and transportation system, Renewable Energy Resources, Vol.27 No.1, Feb. 2009

³⁹ Clarification on the biomass cost assumption in the FSR, KaiDiGongChengHan[2009]105, June 25th, 2009

⁴⁰ Related Questions Research on Biomass Generation Using Agriculture and Forest Residue in China, HUANG Jintao, Journal of Shenyang Institute of Engineering (Natural Science), Vol14 No11, Jan. 2008

**Net Power Generation**

=Installed Capacity x Equivalent Operational Hours at full load x (1-auxiliary consumption rate)

=24MW x 6000h x (1-12%)

=126,720MWh

Installed Capacity⁴¹

The rated installed capacity of the steam turbines is 2 x 12MW. The rated steam extraction of the proposed project is 2 x 15t/h, with power generation capacity of 2 x 12MW. The power output, heat output and IRR calculation in the FSR is based on this operational condition.

Under conditions where there is no steam extraction the steam turbines can theoretically generate at 2 x 15MW. This situation would be applicable to a scenario where there is no heat generation. However, as described above the intention of the project is to generate power and provide heat to the industrial park.

Nonetheless, in order to demonstrate the continued additionality if the project were to generate power at 15MW, a separate investment analysis has been completed. It shows an IRR of 1.98%, which is both below benchmark and below the IRR when a capacity of 2 x 12MW power generation and rated heat generation is assumed⁴². The reason why the IRR is lower than the rated scenario is because the efficiency of the plant is higher when operating in cogeneration mode⁴³.

The opposite extreme scenario would be applicable to a scenario when the maximum steam is extracted. The IRR of this scenario is 6.51%⁴⁴, which is still far below the benchmark and higher than the rated scenario. The reason the IRR is higher than the rated scenario is because the fixed tariff of electricity by the government is not financially attractive than the heat price assumed in the FSR. The table below shows that the key elements in the three operational conditions:

| Operational Conditions | Power Capacity | Steam Extracted | Annual Revenue in the first 15 years | Annual Revenue in the last 5 years | IRR |
|-------------------------------|-----------------------|------------------------|---|---|------------|
| Rated Scenario | 2 x 12MW | 2 x 15t/h | 84.94 million RMB | 57.87 million RMB | 3.21% |
| Condensing Scenario | 2 x 15MW | 0t/h | 85.97 million RMB | 51.12 million RMB | 1.98% |
| Maximum Extraction Scenario | 2 x 6.59MW | 2 x 45t/h | 86.27 million RMB | 71.40 million RMB | 6.51% |

From above, we can conclude that the different operational conditions of the project will not change the additionality status of the project.

⁴¹ Technical specification of the steam turbine

⁴² IRR spreadsheet when no steam is extracted from the steam turbines

⁴³ http://www.newenergy.org.cn/html/0079/200796_14310_1.html

⁴⁴ IRR spreadsheet when maximum steam is extracted from the steam turbines

Equivalent Operational Hours at full Load

The investment analysis assumes 6000 hours as the equivalent operational hours at full load. It does not assume that the plant will only operate for 6000 hours, but rather that the project will not run at full capacity for 100% of the time.

The following bullet points provide a technical explanation of the 6000 operational hours⁴⁵..

- Risk on the Reliability of the CFB boiler
The CFB boiler is designed by the project owner and manufactured by domestic manufacturer. All the facilities in fuel feeding system are also domestic equipments. Although Wuhan Kaidi Power Engineer Co. Ltd has done a lot of research on the CFB biomass fired boiler, this new technology still needs to be tested and debugged during a long-term operation, and there's still relatively great potential technology risks, like inadequate steam output, dust depositing, unbalanced fluidization, serious corrosion of heating surfaces etc.
- Risk on the fuel quality
The biomass contain considerable elements of K, Na, and Cl, resulting in a high risk of dust depositing, blockages and erosion. Moreover, the content of SiO₂ in rice husk ash is higher than 85%, which will cause serious wear and tear of heating surface. Although some mitigation measures are taken, potential risks still exist. Besides, biomass residues are seasonal fuels, not only the amount but also some characteristics (such as water content) always fluctuate seasonally. Additionally, the residues may rot during storage and the calorific value will decrease. Any changes in the quantity and quality of biomass could lower the generator operating hour, or even stop production.
- Maintenance
The technology is relatively new to the project owner. Having no experience in operation and maintenance and thus no skilled workers will affect the efficiency and smooth operation of the plant. Also, because the feeding system of biomass power plants is much more complicated than that of normal coal-fired power plants, there are a number of resulting technology difficulties. Until now, nearly all relevant equipment in the operating biomass power plants in China are imported. However, all the devices of feeding system employed in this project are domestically manufactured. Considering that there's no mature Industrial and market of supporting devices and service, a higher frequency of incidents that require maintenance as well as longer maintenance periods would be expected.

In addition to the explanations above, the project owner has made a comparison of similar biomass projects in operation⁴⁶. Zhongjieneng Suqian Biomass project is considered as a comparable project since it is a publicly available grid connected biomass residues project using CFB boilers and it is located in the southern area of China. The monitoring reports of this project covering almost 1.5 years shows that its operational hours are considerably less than 6000 hours⁴⁷. Thus, 6,000 hours can be considered to be reasonable.

⁴⁵ Introduction on the operational hour 's calculation and assumption for Kaidi Biomass Power projects

⁴⁶ <http://www.ccchina.gov.cn/WebSite/CCChina/UpFile/2008/2008121111144663.pdf>

<http://www.sdpc.gov.cn/jggl/zcfg/W020080407569102971887.pdf>

⁴⁷ <http://cdm.unfccc.int/UserManagement/FileStorage/5F90E9FXXPZN54ANH8ERHI56PZNR8A>

**Table B-7 Actual operational Hour for Similar project-Zhongjieneng Suqian Biomass Power Plant**

| Monitoring period | Exported Power from the two monitoring reports | Power Generated(Assuming 12% is the self consumption rate) |
|---|--|--|
| Apr-07 | 710 | 807 |
| May-07 | 3290 | 3739 |
| Jun-07 | 3800 | 4318 |
| Jul-07 | 1960 | 2227 |
| Aug-07 | 4250 | 4830 |
| Sep-07 | 5240 | 5955 |
| Oct-07 | 7410 | 8420 |
| Nov-07 | 12930 | 14693 |
| Dec-07 | 11440 | 13000 |
| Jan-08 | 6570 | 7466 |
| Feb-08 | 9110 | 10352 |
| Mar-08 | 13490 | 15330 |
| Apr-08 | 13640 | 15500 |
| May-08 | 13950 | 15852 |
| Jun-08 | 6200 | 7045 |
| Jul-08 | 5530 | 6284 |
| Total Electricity Generated | | 135818 |
| Operational hour from April 2007 to July 2008 | | 4244 |
| Operational hour from July 2007 to July 2008 | | 5197 |

Heat Generation

The rated steam generation of the project is 30t/h with a temperature of 296.5°C a pressure of 1.27Mpa, thus an enthalpy of 3.0089GJ/t. Therefore, the Heat Generation in the FSR is calculated as follows:

$$\text{Heat Generation} = 30\text{t/h} \times 6000\text{h} \times 3.0089 \text{ GJ/t} = 541,602 \text{ GJ}$$

Auxiliary consumption rate

The auxiliary consumption rate of the project plant in the FSR is assumed as 12%.

The in house loads of the project (including both the high voltage facilities and low voltage facilities) are totally 4936.3KW⁴⁸, based on which, the calculated auxiliary consumption rate of the power plant is around 16.4%⁴⁹, higher than 12%, which shows that the 12% used in the IRR calculation is conservative.

<http://cdm.unfccc.int/UserManagement/FileStorage/OF2X17HG0DRAQMV8IZS9BL6YN4ETJW>

⁴⁸ Log books of the in-house load facilities, referred by the purchase contracts, provided by the project owner

⁴⁹ Power Industrial Standards of People's republic of China, Technical Rule for Designing auxiliary power system of fossil fuel power plant issued in year 2002; Standard Code: DL/T 5153-2002

Calculation of the auxiliary rate spreadsheet



Besides, according to an investigation report from Kushan Municipal Development and Reform Commission, the auxiliary consumption rate of the operational biomass power generation projects in China is 12%⁵⁰. Therefore, the auxiliary consumption rate for the project is reasonable.

Power tariff—According to *Renewable Energy Electricity Tariff and Cost Management Trial Regulations (fagaijiage [2006] 7)* issued by NDRC of China in 2006, for biomass power plant, the tariff within the first 15 years since commissioning is calculated by 0.25RMB/KWh plus the benchmark for the on-grid tariff of coal-fired power plants with de-sulphurisation units installed in year 2005. After 15 years' operation, the tariff would be cancelled.

The tariff of 0.635RMB/KWh including VAT used in the investment analysis is consistent with the FSR which is approved by the government. This tariff used in the FSR was estimated by taking the basic tariff rate for de-sulphurisation coal fired generator units in year 2007&2006 in Jiangxi province and applying the subsidy of 0.25RMB/kwh for first 15 years. In year 2007&2006, the basic tariff rate for de-sulphurisation coal fired generator units is 0.385RMB/KWh including VAT⁵¹. The tariff 0.385RMB/KWh including VAT is used after 15 years' operation.

The approved FSR of the project was finalized in March 2008. The FSR uses the most recent tariff for on-grid coal-fired power plants with de-sulphurisation units installed in Jiangxi province available at that time.

The tariff approved by the Pricing Bureau of Jiangxi Province for the project is 0.622RMB/KWh (0.372 RMB/KWh as the basic tariff rate for de-sulphurisation coal fired generator units in year 2005 in Jiangxi province +0.250 RMB/KWh as the subsidy) for the first 15 years and without the 0.250RMB/KWh subsidy after the 15 years⁵². This is the actual tariff obtained by the project, which is consistent with the regulation and lower than the one estimated in the FSR.

Thus, the tariff used in the investment analysis is conservative.

Heat price—The heat price in the FSR is 29.85 RMB/GJ excluding VAT, which is determined after a investigation of the heat demand, local market price of heat supply during the FSR period and a fully discussion with the Administration Bureau of Industrial Park by the FSR writing Institute and the project owner.

This price is the price at the generation site and does not include the pipeline cost and the transmission losses. The heat pipeline capital cost is borne by the local government.

In order to provide additional substantiation as to the heat price applied in the investment analysis, a leveled cost analysis for the independent small coal fired boiler heat generation has been done to illustrate

⁵⁰ Energetically facilitate the development of biomass power generation industry to actively explore new ways of ecological civilization-building, Kushan Municipal Development and Reform Commission.
<http://www.dpc.ks.gov.cn/xxnr.jsp?ID=884>

⁵¹ http://www.gov.cn/gzdt/2006-07/01/content_325205.htm
http://www.ndrc.gov.cn/zcfb/zcfbtz/2008tongzhi/t20080702_222227.htm

⁵² The tariff approval of Wanzai Kaidi Biomass Power Generation Project, Pricing Bureau of Jiangxi Province, GanFaGaiShangJiaHan[2010]160, February 1st, 2010



whether or not it is feasible to purchase heat from the proposed project from the heat users' point of view. If the purchase price of heat is higher than the levelised cost of generation heat, the existing heat users will continue to run their own small coal-fired boilers to meet their heat demand.

The levelised cost was calculated based on 6 t/h coal-fired boilers as these are common practice boilers for heat generation in China⁵³. The key assumptions are described below.

i Capital cost

The capital cost of 665,000 RMB used in the levelised cost is an average capital cost of a 6t/h coal-fired boiler which is from publicly available reference⁵⁴ and is therefore deemed reliable and credible.

ii Coal cost (Fuel cost)

- Coal consumption: 7,387 tonne/year

The coal consumption is calculated by considering the boiler efficiency, and heat value of purchased coal, heat generation, heat enthalpy of the rated steam from the boiler. This is taken from publicly available data which are listed in the table below. Therefore the input value is appropriate for the levelised cost calculation. The audit team has recalculated the coal consumption by using the same data input.

- Coal price: 550RMB/tonne was based on the published market price in 2009 and the reference can be seen in the table below.

iii. O&M cost (excluding fuel cost)

For a typical 6 t/h coal-fired boiler, annual O&M cost is 422,625RMB (excluding fuel cost) which includes desulfurization expenditure, electricity consumption cost, labor cost, overhaul, ash and sediments treatment fees etc. Each component of O&M cost was rated in terms of the relevant sector standard and published market rate. Each component of O&M was justified as below:

- Labor cost: 140,000 RMB
 - Employee number: 7 people
 - Salary: 20,000RMB/employee/year

- Overhaul cost: 2.5% of capital cost

The overhaul cost is calculated by 1.5% to 5% of fixed assets investment⁵⁵.

- Ash and sediments treatment fees: 50,000 RMB/year⁵⁶
- Desulfurization expenditure: 72,000 RMB/year⁵⁷

⁵³ FANLing, CAO Qin, GUTao, YUQian, Comparison of Environmental Impact and Operation Cost of Mini Type Gas-fired Boiler(Oil-fired Boiler) with Coal-fired boilers,[J] Arid Environmental Monitoring, 2004(03)

⁵⁴ FANLing, CAO Qin, GUTao, YUQian, Comparison of Environmental Impact and Operation Cost of Mini Type Gas-fired Boiler(Oil-fired Boiler) with Coal-fired boilers,[J] Arid Environmental Monitoring, 2004(03)

⁵⁵ Financial evaluation and difficult question analysis for FSR research and bank loan project, Chen Pucai, China Planning Publishing Company, 2007

⁵⁶ WU Xihuan. Inner Mongolia Oil and Chemistry, Investigation on retrofitting the coal-fired boiler to gas-fired boiler, 2008 (10)



CDM – Executive Board

page 40

- Electricity cost: 140,000RMB/year⁵⁸

The input parameters and reference were listed in the table below. Furthermore, the levelised cost spreadsheet was provided and the correctness of the calculations has been checked.

Table B-8 Input parameter for levelised cost and reference table

| Parameter | Value | Unit | Reference |
|---|---------|------------|--|
| Construction period | 1 | year | Experienced data |
| Lifetime | 25 | years | “Introduction on the lifetime of the boilers” by the Senior Engineer Zhu yuqing from Central Southern China Electric Power Design Institute of China Power Engineering Consulting Group |
| Boiler efficiency | 85% | | AM0058, Page26 |
| Capacity | 6 | t/h | Taking it as example for the calculation |
| Capital Cost | 665,000 | RMB | FANLing, CAO Qin, GUTao, YUQian, Comparison of Environmental Impact and Operation Cost of Mini Type Gas-fired Boiler(Oil-fired Boiler) with Coal-fired boilers,[J] Arid Environmental Monitoring, 2004(03); |
| Coal Price | 550 | RMB/tonne | http://news.stockstar.com/info/darticle.aspx?id=JL_20090707_00001411&columnid=2921 |
| Heat Value of the Coal | 5,500 | Kcal/tonne | Ibid |
| Unit conversion from Kcal to KJ | 4.182 | | |
| Operational Hour | 8,000 | hours | Information obtained from the owners of the existing mini type coal-fired boilers |
| Assumed enthalpy of the rated Steam from the boiler | 3,009 | KJ/kg | Same data from the biomass fired boiler in the proposed project |
| Discount Rate -(r) | 0.08 | | Benchmark used in power industry |

⁵⁷ WU Xihuan. Inner Mongolia Oil and Chemistry, Investigation on retrofitting the coal-fired boiler to gas-fired boiler, 2008 (10)

⁵⁸ WU Xihuan. Inner Mongolia Oil and Chemistry, Investigation on retrofitting the coal-fired boiler to gas-fired boiler, 2008 (10)



CDM – Executive Board

page 41

| | | | |
|----------------------------------|-----------|----------|---|
| Labor Number | 7 | | WU Xihuan. Inner Mongolia Oil and Chemistry, Investigation on retrofitting the coal-fired boiler to gas-fired boiler, 2008(10) |
| Salary of the labor | 20,000 | RMB/year | Information obtained from the owners of the existing mini type coal-fired boilers |
| Electricity Cost | 144,000 | RMB | WU Xihuan. Inner Mongolia Oil and Chemistry, Investigation on retrofitting the coal-fired boiler to gas-fired boiler, 2008(10) |
| Desulferisation Cost | 50,000 | RMB | Ibid |
| Ash and sediments treatment fees | 72,000 | RMB | Ibid |
| Employee Cost | 140,000 | RMB | Calculated |
| Overhaul | 16,625 | RMB | Calculated using the experienced overhaul rate as 2.5% and cross checked with the Chinese standard of overhaul rate range ⁵⁹ |
| Coal consumption | 7,387 | tonne | Calculated |
| Fuel Cost | 4,062,993 | RMB | Calculated |
| Total heat generation | 144,427 | GJ | Calculated |
| O&M Cost excluding the fuel cost | 422,625 | RMB | Calculated |

The levelized cost of a coal fired boiler for the heat user to supply heat to themselves independently is 31.5RMB/GJ⁶⁰. This demonstrates that the heat price for the project activity of 29.85RMB/GJ is reasonable.

The heat price is confirmed by an official document which was issued by the Administration Committee of Wanzai Industrial Park issued on February 25th, 2010⁶¹ the heat selling price for the Wanzai Kaidi biomass power project should not be higher than 30RMB/GJ (excluding VAT) in consideration of the consumer's procurement cost of heat.

Income Tax

⁵⁹ Financial evaluation and difficult question analysis for FSR research and bank loan project, Chen Pucai, China Planning Publishing Company, 2007

⁶⁰ Spreadsheet of the Levelized cost of a new coal fired boiler to supply heat to the heat users itself, provided to the auditor

⁶¹ Clarifications on taking Wanzai Kaidi Biomass Power Generation Project as the district heating system in Wanzai Industrial Park, WanGongHan [2010] 10



The EB51 Annex 58 –Guidance on the assessment of investment analysis (Version 03) indicates that “ *In cases where a post-tax benchmark is applied the DOE shall ensure that actual interest payable is taken into account in the calculation of income tax. In such situations interest should be calculated according to the prevailing commercial interest rates in the region, preferably by assessing the cost of other debt recently acquired by the project developer and by applying a debt-equity ratio used by the project developer for investments taken in the previous three years.*”

The benchmark used for the proposed project is a post-tax benchmark. Therefore, according to the guidance mentioned above, the income tax after interest is used for IRR calculation for the proposed project.

The interest rate, pay back period and debt ratio are taken from the FSR and applied in the IRR calculation.

No ash revenue is predicted

✧ *The ash revenue is not considered in the financial analysis in the FSR*

According to the FSR, there is expected to be 18.9 thousand ton ash per year generated by the project.

According to the EIA report, the ash is considered as solid residues which will lead to field occupation and pollutions to the soil and air, thus needs to be treated or utilized.

Although the ash is considered as a solid residues generated from the project, it could be utilized as fertilizer for the local farmers to improve the soil condition because it contains nutrient elements as K and P elements.

However, considering that the fuels utilized in the project is a mixed of biomass residues, the effective component in the ash would be low and not homogenous in nature. The ash is also alkali which means it is only good for the acidic soil, thus the local farmers are not interested in purchasing the ash as fertilizer at all.

Therefore, the project is designed not to build storeroom (there will be a temporary space) for the ash but to ask some local fertilizer company to transport it outside of the power plant and deal it on its own expense with no transaction between the two parties. Through this, the field occupied in the project site by the ash is saved and the project owner will realize the utilization of the ash required by the EIA report.

Therefore, there is no revenue from ash for the project and there is no ash revenue in the IRR calculation in the FSR.

✧ *There is no market for the ash based on experience from other operational biomass power plants*

The experience from the already commissioned biomass projects which belong to the project owner's parent company shows that the ash is in fact a “cost” instead of a “revenue”. Due to the EIA requirements as mentioned above, those projects have had to pay the local farmers to transport the ash outside of the power plant. The local farmers may bring it to the refuse dump or use it as additive to the construction material. Therefore, it is reasonable to predict that no revenue will be obtained from ash, but rather additional expenditure will be required.



However, to be conservative and to demonstrate that the ash revenue (if any) will not influence the additionality of the project, the ash price at which the revenues would bring the IRR over the benchmark has been calculated. The results show that the ash price should be higher than 372RMB/ton⁶² to increase the IRR to 8%. Given that the market price for cement is only around 300RMB/ton in China at the time of investment decision of the project⁶³, 372RMB for waste ash is not plausible and as such ash revenues cannot impact the additionality of this project.

2) Comparison of the project IRR and the financial benchmark

In the IRR calculation, the fixed input values were used by the project owner for the electricity tariff and O&M costs for the whole operation period. This is required by the national criteria. According to <Methods and Parameters> which is the national guidance for evaluation of new investments and is also the guidance for Design Institute to conduct the FSR⁶⁴, the tariff rates for both output and input values should be predicted at the beginning of the operation period and that these predictable tariff rates will be fixed and applied throughout the operation period. This is due to the fact that the operation period is long and it is difficult to predict the inflation rate and the outcome of that rate⁶⁵.

Furthermore, the tariff rates at the beginning of the project for both electricity and O&M also represent the rates which project owner can obtain and ensure to use for the investment analysis at the time of decision-making in the project. Accordingly, the decision to go ahead with the project is based on the assumptions of fixed O&M and electricity tariff rates.

Also in China, the electricity tariff is controlled by China government and it is hard for project owner to forecast the future electricity tariff rate and inflate rate for the O&M cost. The electricity tariff is related tightly to the national economy. The Government will only raise tariffs when it is absolutely necessary and therefore when the costs of power production have increased sufficiently to justify an increase. The power tariff is increased only due to the rise in operation costs (such as coal price, labour, transportation and interest rates) of the power generators. Because of fears that it could further drive up inflation and as a developing country it is important to keep prices down to ensure affordability across society⁶⁶.

Moreover, the published sector benchmark is based on the assumption of application of fixed input value. Compared to such a benchmark, the same assumption in the IRR calculation should be applied.

As such fixed input values were applied by the project owner for the electricity tariff and O&M costs. These were applied in the calculation of the IRR over the whole operation period in FSR by the Design Institute. Accordingly, these fixed input values from FSR were applied in IRR calculation. Any change in the electricity tariff is uncertain and this is dealt with by analysis of the IRR in the sensitivity analysis, where the robustness and the likelihood of the project exceeding the benchmark is dealt with.

⁶² IRR spreadsheet, it is provided to the Auditor.

⁶³ <http://www.m188.com/newsinfo/2008-1-4/200814-1627355472.html>

⁶⁴ P84 Method and Parameters (Version 3), published by the NDRC and the Ministry of Construction of China, 2006

⁶⁵ P84 Method and Parameters (Version 3)

⁶⁶ http://www.ndrc.gov.cn/xwfb/t20050628_27624.htm



TableB-9 shows the project IRR with and without the income from CERs sale. Without the sales of CERs, the project IRR is 3.21% which is lower than the financial benchmark. Thus the proposed project is not financially acceptable. Taking into account the CDM revenues, the project IRR is 11.38% which is higher than the financial benchmark, therefore, the CDM revenues enable the project to overcome the investment barriers.

Table B-9 Comparison of Project IRR with and without the income from CERs sale

| Item | Without CDM | Benchmark | With CDM |
|-------------|-------------|-----------|----------|
| Project IRR | 3.21% | 8% | 11.38% |

Sub-step 2d. Sensitivity analysis


For the proposed project, six parameters were selected as sensitive factors to assess the financial attractiveness:

- 1) Static total investment
- 2) Equivalent operation hour at full load
- 3) Electricity tariff
- 4) Heat Price
- 5) Biomass Cost
- 6) Total O&M Cost

Assuming the above six factors vary in the range of -10% to 10%, the project IRR (without the income from CERs sales) varies to different extents as shown in Table B-10 and Figure B-4 below.

TableB-10 Sensitivity analysis of the proposed project

| | -10% | -5% | 0 | 5% | 10% |
|--------------------------------|--------|-------|-------|--------|--------|
| Static total investment | 4.66% | 3.91% | 3.21% | 2.56% | 1.95% |
| Operational Hours | 0.26% | 1.78% | 3.21% | 4.57% | 5.71% |
| Biomass Cost | 6.50% | 5.09% | 3.21% | 0.91% | -2.28% |
| Electricity Tariff | -1.49% | 1.15% | 3.21% | 4.96% | 6.33% |
| Heat Price | 1.65% | 2.46% | 3.21% | 3.92% | 4.59% |
| Total O&M cost | 7.56% | 5.67% | 3.21% | -0.07% | |

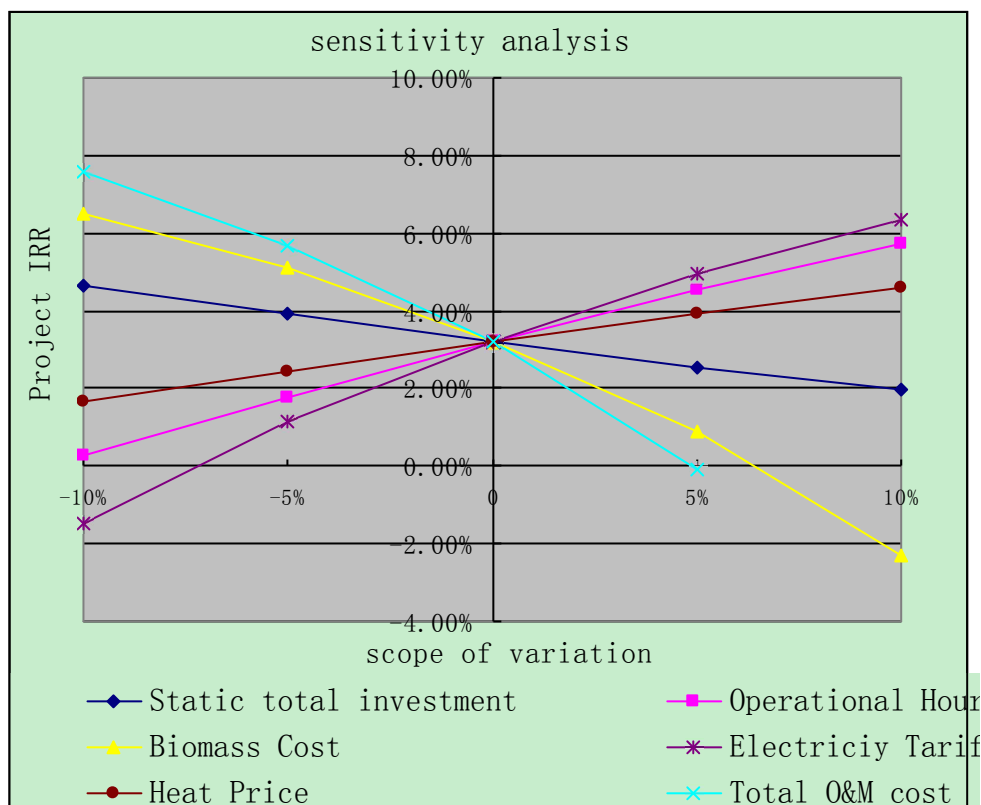

FigureB-4 Sensitivity analysis of the proposed project

When the Static total investment, Equivalent Operational Hour at full load, Tariff, Heat Price, Biomass Cost, Total O&M Cost are changing within the range of -10% to 10%, the IRR of the proposed project is always lower than the investment benchmark, and lacking of financial attractiveness. Nonetheless, the following text gives further discussion on the sensitivity of the input values.

Biomass Cost

It can be seen that the total O&M Cost is the most sensitive indicator. When it was decreased by 16%, the IRR would reach 8%. Of the total O&M Cost, biomass cost account for 78%, when the biomass cost dropped by 11%, the IRR will reach 8%. However, it is not possible for the biomass cost to decrease, and certainly not by 11%. This is because the biomass purchase price is determined based on actual costs for collection, transportation, and pretreatment. From 2002 to 2006, the general pricing index of the Jiangxi Labor cost, the transportation cost, the fuel and power cost are listed as follows⁶⁷:

| | 2002 | 2003 | 2004 | 2005 | 2006 |
|---|-------|-------|-------|-------|-------|
| Average Wages Index | 115.4 | 113.6 | 112.7 | 115.4 | 113.9 |
| Transportation Cost for Consumer Price Indices | 102.5 | 101.6 | 100.4 | 103.2 | 103.3 |
| Raw material, Fuel, Power Purchasing Index | 98.6 | 106.5 | 114.5 | 110.0 | 108.6 |

This table clearly shows an upward trend over last five years. Therefore the biomass price is not likely to decrease.

⁶⁷ <http://www.stats.gov.cn/tjsj/ndsj/>



Besides, the experience from the other early biomass projects in China shows that when the farmers realize the biomass residues could be a product, they would start to bargain fiercely and even when there is a surplus in supply it has been shown that the price will increase dramatically.

For example, the first biomass co-firing project in China, Shiliquan Biomass co-firing power plant, which was put into commission on December 2005 in Shandong Province, a biomass cost of 100RMB per tonne was assumed in the FSR. After commissioning, the price rose to 400RMB⁶⁸.

What is more, the purchase statements as well as the settlement log book shows that rice husks and forestry residues were between 270RMB/t and 340RMB/t (delivered price to plant) in January 2010⁶⁹, which confirms that the increasing trend rather than decreasing trend of the biomass cost.

Power Tariff

When the power tariff is increased by 17%, the IRR reaches the benchmark. This is not possible because in China, the tariff is strictly regulated by the Chinese Government and it is established according to strict regulations rather than by a market mechanism. The Government will only raise tariffs when it is absolutely necessary and therefore when the costs of power production have increased sufficiently to justify an increase. The power tariff is increased only due to the rise in operation costs (such as coal price, labour, transportation and interest rates) of the power generators. Because of fears that it could further drive up inflation and as a developing country it is important to keep prices down to ensure affordability across society⁷⁰

Additionally, according to *Renewable Energy Electricity Tariff and Cost Management Trial Regulations (fagaijiage [2006] 7)*, from year 2010, the subsidy for the newly approved biomass power projects in any given year will be reduced by 2% compared to the subsidy for the projects approved in the previous year. Therefore, there is very likely a decreasing trend on subsidy in the coming years for the biomass power projects in China.

Total Investment Cost

When the static total investment was reduced by 28%, the IRR would reach the benchmark. However, this is not a possible situation, given that in year 2003, 2004, 2005, 2006 and 2007, the national pricing index of purchasing prices of raw materials, fuels and power are 104.8, 111.4, 108.3, 106, 104.4 respectively. Also in 2003, 2004, 2005, 2006 and 2007 the national total price index of investment in fixed assets are 102.2, 105.6, 101.6, 101.5, 103.9 respectively⁷¹. There is clearly an increasing trend on investment costs.

Operational Hours

When the operational hours at full load was increased by 21%, reaching almost 7285 hours, then the IRR would reach the benchmark. However, based on the specific conditions of the proposed project,

⁶⁸ http://www.sdpc.gov.cn/zdxm/t20051229_55135.htm

⁶⁹ Statement Bills and log books of the fuel purchasing of Wanzai Kaidi biomass power generation project in from 1/1/2010 to 31/1/2010

⁷⁰ http://www.ndrc.gov.cn/xwfb/t20050628_27624.htm

⁷¹ China Statistic Year Book, 2004, 2005, 2006, 2007, 2008



considering the technical risk of the domestic biomass fired boiler, the biomass transmission system risk, biomass characteristics risk and the real operation conditions from the similar biomass power plant that are in operation, which have been mentioned above, it is practically impossible to happen⁷²

Heat Price

When the heat price was increased by 44% and reaching 43RMB/GJ (excluding VAT), the IRR would reach benchmark. This is not possible. It is a fact that for most of the cogeneration plants in China, the heat selling price is regulated by the local government. Generally, the profit rate for selling heat cannot be greater than 5% of the cost of producing the heat.⁷³ This is because heat is a basic service to people and Industrial and therefore the government of China regulates the price very closely to avoid inflation of the heat price which would be damaging to Chinese society.

In summary, the project would be lacking financial attractiveness without CER revenues.

Outcome of Step 3:

Based on the Investment Analysis above, the proposed project is not financially attractive without consideration of CERs sales revenues. The Combined Scenario a) *the proposed project not undertaken as a CDM project activity* is not feasible thus is eliminated.

So, the baseline scenario combination of the proposed project is Combined Scenario b) (which belongs to Scenario 2 in the methodology).

| Scenario | Power generation | Heat generation | Use of biomass residues |
|----------|------------------|-----------------|-------------------------|
| 2 | P4 | H6 | B1 or B3 |

STEP 4. Common practice analysis

Sub-step 4a. Analyze other activities similar to the proposed project activity.

According to the “Combined tool to identify the baseline scenario and demonstrate additionality”, CCPG is selected as the relevant geographical boundary of the project activity, which covers Henan Province, Hubei Province, Hunan Province, Jianxi Province, Sichuan Province and Chongqing City and includes more than 10 biomass residues power plants that are implemented or underway.

In China, the investment environment for each region is different. Specifically in terms of available resources, labour costs and electricity tariffs, these can vary significantly in different parts of China, even different province of China. Please see the table below including some typical indicators in different province of China in 2006, which shows that there is significant difference among different regions in China. Therefore, it is not appropriate to consider activities in the whole of China and CCPG is selected as the appropriate geographical scope for the common practice analysis.

⁷² Introduction on the operational hour ‘s calculation and assumption for Wanzai Kaidi Biomass Power projects

⁷³ <http://www.chinapower.com.cn/articleattachment/1000/art1029355.pdf>



| Power Grid | Province | Average Wage(Yuan/year) ⁷⁴ | Sales Price of electricity(RMB/MWh) ⁷⁵ | Trasimission and Distribution Price(RMB/MWh) ⁷⁶ | Water Prices (RMB/t) ⁷⁷ |
|-------------------------|----------------|---------------------------------------|---|--|------------------------------------|
| North China Power Grid | Beijing | 40117 | 525.32 | 156.18 | 2.8 |
| | Tianjin | 28682 | 525.32 | 156.18 | 3.4 |
| | Shanxi | 18300 | 408.63 | 123.47 | 2.1 |
| | Hebei | 18469 | 440.92 | 95.28 | 2 |
| | Shandong | 19228 | 478.48 | 90.59 | N/A |
| | Inner Mongolia | 18469 | 352.61 | 97.68 | 1.95 |
| East China Power Grid | Shanghai | 41188 | 649.6 | 196.76 | 1.03 |
| | Zhejiang | 27820 | 569.28 | 111.52 | N/A |
| | Jiangsu | 23782 | 590.13 | 160.75 | N/A |
| | Anhui | 17949 | 503.37 | 126.54 | N/A |
| | Fujian | 19318 | 490.13 | 113.65 | 1.3 |
| Center China Power Grid | Hubei | 16048 | 516.75 | 154.25 | N/A |
| | Henan | 16981 | 429.24 | 82.7 | 1.6 |
| | Hunan | 17850 | 496.41 | 149.6 | 1.02 |
| | Jiangxi | 15590 | 506.82 | 126.29 | N/A |
| | Sichuan | 17852 | 465.76 | 147.08 | 1.35 |
| | Chongqing | 19215 | 507.04 | 173.8 | 2.1 |
| Northwest Power Grid | Shaanxi | 16918 | 420.74 | 123.8 | N/A |
| | Gansu | 17246 | 356.65 | 129.22 | 0.9 |
| | Qinghai | 22679 | 291.43 | 108.75 | 1.3 |
| | Ningxia | 21239 | 358.72 | 130.83 | 1.15 |
| | Xinjiang | 17819 | 417.13 | 193.58 | 1.36 |
| Northeast Power Grid | Heilongjiang | 16505 | 482.22 | 160.78 | N/A |
| | Jinlin | 16583 | 485.62 | 136.24 | 2.5 |
| | Liaoning | 19624 | 508.55 | 151.05 | 1.6 |
| South Power Grid | Guangdong | 26186 | 681.9 | 180.93 | N/A |
| | Guangxi | 18064 | 449.7 | 111.57 | N/A |
| | Yunan | 18711 | 392.33 | 140.36 | 2.05 |
| | Guizhou | 16815 | 377.29 | 95.01 | 1.32 |
| | Tibet | 31518 | N/A | N/A | 0.6 |

⁷⁴ <http://www.stats.gov.cn/tjsj/ndsj/2007/indexch.htm>⁷⁵ http://www.sdpc.gov.cn/zjgx/t20070716_148654.htm⁷⁶ ibid⁷⁷ <http://price.h2o-china.com>



| | | | | | |
|-------------------|--------|-------|--------|--------|------|
| Hainan Power Grid | Hainan | 15890 | 615.23 | 215.44 | 1.06 |
| | Mean | 21053 | 476.44 | 138.00 | 1.64 |
| | Max | 41188 | 681.90 | 215.44 | 3.40 |
| | Min | 15590 | 291.43 | 82.70 | 0.60 |
| | STDEV | 6570 | 89.82 | 33.37 | 0.69 |

The biomass combustion power generation industry in China is quite new. Until 2006, no grid-connected biomass combustion power generation or cogeneration project with similar installed capacity (15-100MW) as the proposed project has been developed in China⁷⁸ and the first similar biomass combustion generation power plant in China is the Shandong Shanxian 1*25MW Biomass Power Plant Project which was registered as CDM projects in year 2007⁷⁹.

Below are the similar and operational projects in the CCPG⁸⁰: This list represents the full list of projects operational at the time of the investment decision and may be considered to be complete since it has been obtained by the NDRC.

Table B-11 Similar Project Activity in operation

| Project | Capacity | Comment |
|---|----------|---|
| Henan Luyi 25MW biomass cogeneration project | 25MW | Registered as a CDM project ⁸¹ |
| Henan Xun county biomass cogeneration project | 25MW | Applying for CDM registration ⁸² |
| Henan Changyuan 36MW biomass power generation project | 36MW | Applying for CDM registration ⁸³ |
| Henan Fugou biomass power generation project | 20MW | Applying for CDM registration ⁸⁴ |
| Xuchang Changge Hengguang Cogeneration Project | 15MW | Applying for CDM registration ⁸⁵ |

⁷⁸ <http://energy.people.com.cn/GB/71890/5116814.html>

⁷⁹ <http://cdm.unfccc.int/Projects/DB/TUEV-SUED1175012571.81/view>

⁸⁰ Subsidies for Renewable Project commissioned between January and September 2007 issued by NDRC and SERC: <http://www.ccchina.gov.cn/WebSite/CCChina/UpFile/2008/200812111144663.pdf>

Subsidies for Renewable Project commissioned between October 2007 and June 2008 issued by NDRC and SERC: <http://www.sdpc.gov.cn/jggj/zcfg/W020080407569102971887.pdf>

⁸¹ <http://cdm.unfccc.int/Projects/Validation/DB/GQ2NUQA6LMC3MRC76ESSETBPSFTH50/view.html>

⁸² <http://cdm.unfccc.int/Projects/Validation/DB/E7AWX2BGFNL02N1MNPMSMVEEZAFJE9O/view.html>

⁸³ <http://cdm.unfccc.int/Projects/Validation/DB/19GNBOAW3BNBAM4BIW2WIJ8B7CVYI2/view.html>

⁸⁴ http://cdm.ccchina.gov.cn/website/CDM/pdf/Item_new/Item_new4419.pdf

⁸⁵ <http://cdm.unfccc.int/UserManagement/FileStorage/JP7W6GI42CUX0KERQ58ZTYHNOF1LDV>



Below are the similar projects that are currently under construction, but not operational. These projects have been found through internet searches as well as checking the UNFCCC and China DNA website.

Table B-12 Similar Projects in CCPG under construction

| Project | Capacity | Comment |
|---|----------|---|
| Henan Puyang 24MW biomass direct burning power generation project | 24MW | Applying for CDM registration ⁸⁶ |
| Henan Xinxiang 24MW Bio-based Cogeneration Project | 15MW | Applying for CDM registration ⁸⁷ |
| Hunan Juntai biomass power generation project | 70MW | Applying for CDM registration ⁸⁸ |
| Hunan Lixian 15MW Biomass Direct Burning Power Plant Project | 15MW | Applying for CDM registration ⁸⁹ |
| Hunan Yueyang kaidi biomass power project | 48MW | Applying for CDM registration ⁹⁰ |
| Hunan Yiyang Kaidi Biomass power project | 48MW | Applying for CDM registration ⁹¹ |
| Hunan Qidong Kaidi Biomass power project | 48MW | Applying for CDM registration ⁹² |
| Hubei Yicheng biomass cogeneration project | 24MW | Applying for CDM registration ⁹³ |
| Qichun Kaidi biomass power project | 24MW | Applying for CDM registration ⁹⁴ |
| Poyang Kaidi biomass power project | 24MW | Applying for CDM registration ⁹⁵ |
| Jianli Kaidi biomass power project | 24MW | Applying for CDM registration ⁹⁶ |
| Jingshan Kaidi biomass power project | 24MW | Applying for CDM registration ⁹⁷ |

⁸⁶ <http://cdm.unfccc.int/Projects/Validation/DB/RKAXQG6LHX64CBV4PVDZJ7AB4P6F17/view.html>

⁸⁷ <http://cdm.unfccc.int/Projects/Validation/DB/5WDK7SQ8Z7OYEG7TW3X25RU72VCM74/view.html>

⁸⁸ <http://cdm.unfccc.int/Projects/Validation/DB/BDE8MXZNOI25W8JO2W0IA7PJPGGDZ/view.html>

⁸⁹ <http://cdm.unfccc.int/Projects/Validation/DB/WYFP4RF43D83YLCZ4NNBJRBD3D0F3/view.html>

⁹⁰ <http://cdm.unfccc.int/Projects/Validation/DB/TBK7QML7QUL5BD8EUISDXEZRX31FE/view.html>

⁹¹ <http://cdm.unfccc.int/Projects/Validation/DB/YPQRM9TRIIHFJTJXNB2OOXIJOKJGFH/view.html>

⁹² <http://cdm.unfccc.int/Projects/Validation/DB/VM71WQ7NGHENFLOL6S1X57OM8M2FSD/view.html>

⁹³ <http://cdm.unfccc.int/Projects/Validation/DB/8J8WAZ0YD76CKQWT0XB7XXJP2RMTIS/view.html>

⁹⁴ <http://cdm.unfccc.int/Projects/Validation/DB/34TZ5Z5ZOCUNYOOBNS45X2DLN37CY0/view.html>

⁹⁵ <http://cdm.unfccc.int/Projects/Validation/DB/QA3ZY26J4L9BL0AKFEGBHN48RSAID/view.html>

⁹⁶ <http://cdm.unfccc.int/Projects/Validation/DB/DSMF6QJOX7TA6TT2UMMDWWVXS6TWB9/view.html>

⁹⁷ <http://cdm.unfccc.int/Projects/Validation/DB/OH5SLTPALDNQFR7EU7U7QT6K9RIEOS/view.html>



| | | |
|--|------|---|
| Hubei Dangyang 25MW biomass power generation project | 25MW | Applying for CDM registration ⁹⁸ |
|--|------|---|

Sub-step 4b. Discuss any similar options that accruing.

Based on the above information, we can see that all operational and underway grid-connected biomass power projects (15-100MW) are applying for CDM in CCPG, therefore, the proposed project is not common practice and it is additional.

In conclusion, the proposed project activity passed all criteria of the “combined tool to identify the baseline scenario and demonstrate additionality”. The baseline scenario 2 in the methodology is the realistic and credible baseline scenario and the proposed project is additional.

| |
|--|
| B.5. Description of how the anthropogenic emissions of GHG by sources are reduced below those that would have occurred in the absence of the registered CDM project activity (assessment and demonstration of additionality): |
|--|

>>

ACM0006 requires that the “Combined tool to identify the baseline scenario and demonstrate additionality” is used. Therefore, please refer to the section above where the additionality has been determined.

The CDM consideration and decision making process is presented as follows:

The proposed project is one of the 12 projects that are developed by Wuhan Kaidi Investment Holding Ltd (the parent company of the project owner). In March 2007, the parent company commissioned Wuhan Kaidi Electric Engineering Limited to conduct a research on development prospect of biomass power plant. The focus of the research includes operation of existing biomass power plants, biomass material supply, construction condition, available technology, investment cost in seven provinces including Hunan, Hubei, Anhui, Jiangsu, Jiangxi, Sichuan, Guangxi.etc⁹⁹.

Based on the findings of the research report, the board of the parent company proposed an initial plan to develop a batch of biomass power projects in 12 counties. The 12 projects were planned to develop by using exactly the same equipments and technology¹⁰⁰. According to the board decision, the feasibility studies of the 12 projects were carried out in phases. In the phase I, the feasibility studies of three pilot projects, Jianli, Yueyang, and Yiyang Biomass power plants were carried out.

The results of the financial analysis from 3 pilot projects of the batch, Jianli, Yueyang, and Yiyang Biomass power plants (FSR date respectively: September 2007, June 2007 and August 2007) shows that the IRRs without CDM revenues of those projects (Jianli 3.03%, Yueyang 4.83%, Yiyang 5.28%)¹⁰¹ are all

⁹⁸ <http://cdm.ccchina.gov.cn/website/cdm/pdf/Item/Item3018.pdf>

⁹⁹ A research report on the analysis to current situation of biomass power plants and development prospect, Wuhan Kaidi Electric Engineering Limited

¹⁰⁰ Board meeting minutes, 5th April 2007

¹⁰¹ Jianli FSR, Yueyang FSR, Yiyang FSR



lower than the sector's benchmark. Given that 12 projects apply the same technology provided by the same supplier, this kind of projects is obviously not financial attractiveness without CDM finance or other supports.

Knowing that similar biomass projects are seeking CDM finance, the management board considered CDM could be also a finance channel to improve the financial position of the projects. The financial analysis showed that with CDM revenue included, those project are financial feasible and carbon finance is strongly suggested in their FSRs. Therefore, the management board decided to develop the 12 projects in the batch all as CDM projects. Accordingly, the company signed the batch of equipments purchase agreement with the same the supplier in order to reduce the procurement cost of equipments on 6th November 2007.

Based on the same assumption in investment analysis, the outcome of the project FSR also reconfirms that CDM revenue is necessary for the proposed project by showing that without CER revenue the project is not feasible and pointed out clearly to implement the project as CDM project can make the project financially attractive.

TableB-13 Timelines in Project Implementation and CDM application activities

| Time | Project Implementation Activities | CDM Application Activities |
|----------------|---|---|
| March 2007 | A research report on the analysis to current situation of biomass power plants and development prospect was conducted | |
| April 2007 | The management board proposed to initiate development plan of 12 biomass power generation projects based on the findings of research report | |
| June 2007 | EIA was finished | |
| August 2007 | EIA was approved by Environment Protection Bureau of Jiangxi Province | |
| September 2007 | | Based on financial results of the internal similar projects included in the same batch in the developing plan of the holding company, the management board's decision was made and issued to undertake the proposed project as CDM project ¹⁰² . |
| November 2007 | | Carbon Assets Development Agreement was signed with Camco ¹⁰³ |
| November 2007 | Turbine Purchase agreement signed for all the projects in the same batch | Project Starting Date in the PDD |

¹⁰² Boarding minutes

¹⁰³ Signature pages of the Carbon Assets Development Agreement



| | | |
|-----------------------------|--|--|
| | including the proposed project ¹⁰⁴ | |
| March 2008 | FSR was finished, which reconfirm that without CER revenue, the project is not feasible and pointed out clearly to implement the project as CDM project can make the project financially attractive ¹⁰⁵ . | |
| June 2008 | Project was approved by DRC of Jiangxi Province | |
| December 2007- July 2008 | | PDD writing, Emission Reduction Purchase Agreement negotiating and DOE selecting |
| August 2008 | | Validation Contract was signed with DOE |
| September 2008 | | Application documents were submitted to NDRC |
| November 2008 | Construction started | |
| February 2009 | | PDD was published on UNFCCC website for Global stakeholder consultation |
| February 2009 | | Global stakeholder consultation finished, no comments were received |
| March 2009 | | Validation Site Visit |
| June 2009 | | CDM application is approved by NDRC of China |

Based on the analysis in B.4 and the above description, the CDM was a serious consideration in the decision to proceed with the project and the proposed project is additional.

B.6. Emission reductions:

B.6.1. Explanation of methodological choices:

EMISSION REDUCTION

The Project reduces CO₂ emissions through substitution of power and heat generation with fossil fuels by energy generation with biomass residues. The emission reduction ER_y by the project during a given year y is the difference between the emission reductions through substitution of electricity generation with fossil fuels ($ER_{\text{electricity},y}$), the emission reductions through substitution of heat generation with fossil fuels ($ER_{\text{heat},y}$), project emissions (PE_y), emissions due to leakage (L_y) and, where this emission source is included in the project boundary and relevant, baseline emissions due to the natural decay or burning of anthropogenic sources of biomass residues ($BE_{\text{biomass},y}$), as equation (1):

¹⁰⁴ Signature pages of the equipment purchase agreement

¹⁰⁵ FSR Volume 3 Page 7,-9



$$ER_y = ER_{heat,y} + ER_{electricity,y} + BE_{biomass,y} - PE_y - L_y \quad (1)$$

Where,

ER_y = Emissions reductions of the Project during the year y (tCO₂/yr)

$ER_{heat,y}$ = Emission reductions due to displacement of heat during the year y (tCO₂/yr)

$ER_{electricity,y}$ = Emission reductions due to displacement of electricity during the year y (tCO₂/yr)

$BE_{biomass,y}$ = Baseline emissions due to natural decay or burning of anthropogenic source of biomass residues during the year y (tCO₂/yr)

PE_y = Project emissions during the year y (tCO₂/yr)

L_y = Leakage emissions during the year y (tCO₂/yr)

The baseline, project, and leakage emissions are calculated respectively as following:

A. PROJECT EMISSIONS

According the Table in B.3, the project emissions include:

- CO₂ emissions from transportation of biomass residues to the project site (PET_y),
- CO₂ emissions from on-site consumption of fossil fuels due to the project ($PEFF_y$),
- CO₂ emissions from consumption of electricity ($PE_{EC,y}$)
- Where this emission source is included in the project boundary and relevant: CH₄ emissions from the combustion of biomass residues ($PE_{biomass,CH_4,y}$)

Project emissions are calculated as follows:

$$PE_y = PET_y + PEFF_y + PE_{EC,y} + GWP_{CH_4} \times PE_{biomass,CH_4,y} \quad (2)$$

Where,

PET_y = CO₂ emissions during the year y due to transportation of the biomass residues to the project site (tCO₂/yr)

$PEFF_y$ = CO₂ emissions during the year y due to fossil fuel consumption at the project site that is attributable to the project (tCO₂/yr)

$PE_{EC,y}$ = CO₂ emissions during the year y due to electricity consumption at the project site that is attributable to the project (tCO₂/yr)

GWP_{CH_4} = Global Warming Potential for methane valid for the relevant commitment period

$PE_{biomass,CH_4,y}$ = CH₄ emissions from the combustion of biomass residues during the year y (tCH₄/yr)

**a) Carbon dioxide emissions from combustion of fossil fuels for transportation of biomass residues to the project plant (PET_y)**

Because the biomass residues will be transported to the power plant around the project site by trucks, CO₂ emissions from vehicles should be determined. According to the methodology ACM0006, it could be calculated by the following formula based on the distance and vehicle type (option 1):

$$PET_y = N_y \times AVD_y \times EF_{km,CO_2,y} \quad (3)$$

Where,

PET_y = CO₂ emissions during year y due to transport of the biomass residues to the project plant (tCO₂/yr)

N_y = Number of truck trips during the year y

AVD_y = Average round trip distance (from and to) between the biomass residue fuel supply sites and the site of the Project plant during the year y (km)

EF_{km,CO₂,y} = Average CO₂ emission factor for the trucks measured during the year y (tCO₂/km);

b) Carbon dioxide emissions from on-site consumption of fossil fuels (PEFF_y)

According to the Feasibility Study Report, the fossil fuels (diesel oil) are only used for boiler start-up, the emissions from combusting fossil fuels are calculated as “Tool to calculate project or leakage CO₂ emissions from fossil fuel combustion” as following:

$$\begin{aligned} PEFF_y &= PE_{FC,j,y} = \sum_i FC_{i,j,y} \times COEF_{i,y} \\ &= \sum_i (FF_{projectplant,i,y} + FF_{projectsite,i,y}) \times COEF_{i,y} \end{aligned} \quad (4)$$

Where,

PE_{FC,j,y} = CO₂ emissions from fossil fuel combustion in process j during the year y (tCO₂ / yr);

FC_{i,j,y} = Quantity of fossil fuel type i combusted at the project site that are attributable to the project activity during the year y (mass or volume unit per year)

FF_{projectplant,i,y} = Quantity of fossil fuel type i combusted in the biomass residue fired power plant during the year y (mass or volume unit per year)

FF_{projectsite,i,y} = Quantity of fossil fuel type i combusted at the project site for other purposes that are attributable to the project activity during the year y (mass or volume unit per year)

COEF_{i,y} = CO₂ emission coefficient of fuel type i in year y (tCO₂ / mass or volume unit);

i = fuel types combusted in process j during the year y.

The “Tool to calculate project or leakage CO₂ emissions from fossil fuel combustion” provides two procedures to determine COEF_{i,y}.

Option A: The CO₂ emission coefficient COEF_{i,y} is calculated based on the chemical composition of the fossil fuel type i, using the following approach:

If FC_{i,j,y} is measured in a mass unit: $COEF_{i,y} = w_{C,i,y} \times 44 / 12$ (5)

If FC_{i,j,y} is measured in a volume unit: $COEF_{i,y} = w_{C,i,y} \times \rho_{i,y} \times 44 / 12$ (6)

Where:

COEF_{i,y}=Is the CO₂ emission coefficient of fuel type i (tCO₂/mass or volume unit);

w_{C,i,y}=Is the weighted average mass fraction of carbon in fuel type i in year y (tC/mass unit of the fuel);

ρ_{i,y}=Is the weighted average density of fuel type i in year y (mass unit/volume unit of the fuel)

i=Are the fuel types combusted in process j during the year y

Option B: The CO₂ emission coefficient COEF_{i,y} is calculated based on net calorific value and CO₂ emission factor of the fuel type i, as follows:

$$COEF_{i,y} = NCV_{i,y} \times EF_{CO2,i,y}$$

(7)

Where,

NCV_{i,y} = weighted average net calorific value of the fuel type i in year y (GJ/mass or volume unit);

EF_{CO2,i,y} = weighted average CO₂ emission factor of fuel type i in year y (tCO₂/GJ);

Since there is no information of the carbon volume of the fuel provided by the fuel supplier in the invoices and it will cost the project owner a plenty of money to do the measurements by some laboratories having ISO17025 accreditation for each fuel delivery according to the methodology, which is not economically practical to such a small amount of uncontinuous consumption for the project owner, therefore, carbon volume of the fuel is not practically available and Option A is not chosen here and Option B is chosen for the project.

c) CO₂ emissions from electricity consumption (PE_{EC,y})

CO₂ emissions from on-site electricity consumption (PE_{EC,y}) should be calculated using the latest approved version of the “Tool to calculate baseline, project and/or leakage emissions from electricity consumption”. Little electricity will be consumed for the biomass residues mechanical treatment by the project plant. The emissions are calculated as Scenario A in Generic approach of the “Tool to calculate baseline, project and/or leakage emissions from electricity consumption” as follows:

$$PE_{EC,y} = \sum_j EC_{PJ,j,y} \cdot EF_{EL,j,y} \cdot (1 + TDL_{j,y})$$

(8)

Where,



$PE_{EC,y}$ = project emissions from electricity consumption in year y (tCO_2 / yr);

$EC_{PJ,j,y}$ = quantity of electricity consumed by the Project electricity consumption source j in year y (MWh);

$EF_{EL,j,y}$ = emission factor for electricity generation for source j in year y . (tCO_2/MWh)

$TDL_{j,y}$ = average technical transmission and distribution losses for providing electricity to source j in year y . The default value of 20% is used here.

j = source of electricity consumption in the Project.

In this case, refer to the description of project boundary; the only source of j is the CCPG

According to the “Tool to calculate baseline, project and/or leakage emissions from electricity consumption” (Version 01), the proposed project belongs to Scenario A: Electricity consumption from the grid, so, we choose Option A1: Calculate the combined margin emission factor of the applicable electricity system, using the procedures in the latest approved version of the “Tool to calculate the emission factor for an electricity system” ($EF_{EL,j/k/y} = EF_{grid,CM,y}$).

d) Methane emissions from Biomass residues combustion

Emissions from this source are calculated as follows:

$$PE_{Biomass,CH_4,y} = EF_{CH_4,BF} \cdot \sum_k BF_{k,y} \cdot NCV_k$$

(9)

where:

$PE_{biomass,CH_4,y}$: Project emissions from biomass controlled burning (tCH_4/yr)

$BF_{k,y}$: Quantity of biomass residue type k combusted in the project plant during the year y (ton of dry matter or litter)

NCV_k : Net calorific value of the biomass residue type k (GJ/ton of dry matter or GJ/liter)

$EF_{CH_4,BF}$: CH_4 emission factor for the combustion of biomass residues in the project plant (tCH_4/GJ)

This PDD calculates EF_{CH_4} using the following IPCC default data from Table4 and Table5 of the methodology. The biomass residues used in the proposed project are rice husk and forestry residues which can be the best characterized as other solid biomass residues in line with relevant decisions by the Executive Board:

| A | B | C | D | E |
|------------------------------|---|---------------------|-------------------------|---|
| Waste type | Default emission factor(kg CH ₄ /TJ) | Assumed uncertainty | Conservativeness factor | Conservative EF,B×D(kg CH ₄ /TJ) |
| Other solid biomass residues | 30 | 300% | 1.37 | 41.1 |

Therefore, a conservative emission factor of 41.1 kg CH₄/TJ is obtained.

B. EMISSION REDUCTIONS DUE TO DISPLACEMENT OF ELECTRICITY

According to the methodology ACM0006, emission reductions due to the displacement of electricity are calculated by multiplying the net quantity of increased electricity generated with biomass residues as a



result of the project activity (EG_y) with the CO_2 baseline emission factor for the electricity displaced due to the project ($EF_{electricity,y}$), as follows:

$$ER_{electricity,y} = EG_y \cdot EF_{electricity,y} \quad (10)$$

Where,

$ER_{electricity,y}$ = Emission reductions due to displacement of electricity during the year y (tCO_2/yr)

EG_y = Net quantity of increased electricity generation as a result of the Project (incremental to baseline generation) during the year y (MWh).

$EF_{electricity,y}$ = CO_2 emission factor for the electricity displaced due to the Project during the year y (tCO_2/MWh)

In this case, all the electricity displaced is from the CCPG.

STEP 1: Determination of $EF_{electricity,y}$

The Project has been identified as the scenario 2 of ACM0006, i.e. the baseline of the power generation is P4 – “The generation of power in the grid”, the emission factor for the displacement of electricity should correspond to the grid emission factor ($EF_{electricity,y} = EF_{grid,y}$). As the installed capacity of the Project is more than 15MW, the $EF_{grid,y}$ shall be determined as a combined margin (CM), following the guidance in the section “Baselines” in the “Consolidated baseline methodology for grid-connected electricity generation from renewable sources” (ACM0002).

Referring to the relevant chapter of ACM0002, the combined margin (CM) should be calculated according to the “Tool to calculate the emission factor for an electricity system” (hereafter referred to as the Emission Factor Tool).

Sub-step 1: Identify the relevant electricity systems

According to the latest guidelines issued on 30th, December 2008 by China’ DNA⁴, the geographical boundary of CCPG covers, Jiangxi Power Grid, Henan Power Grid, Hunan Power Grid, Hubei Power Grid, Sichuan Power Grid and Chongqing Power Grid. For the purpose of determining the operating margin emission factor, the methodology provides following four options to determine the CO_2 emission factor for net electricity import from the CCPG:

- (a) 0 tCO_2/MWh , or
- (b) The weighted average operating margin (OM) emission rate of the exporting grid; or
- (c) The simple operating margin emission rate of the exporting grid; or
- (d) The simple adjusted operating margin emission rate of the exporting grid.

For this project activity, we choose option (b) to calculate the OM emission rate of the CCPG.

Sub-step 2: Choose whether to include off-grid power plants in the project electricity system

Option I: Only grid power plants are included in the calculation.

Optional II: Both grid power plants and off-grid power plants are included in the calculation.



Option I corresponds to the procedure contained in earlier versions of the tool. Option II allows the inclusion of off-grid power generation in the grid emission factor.

According to Chinese administrative regulation for power plants, all power plants should be connected to power grid. The power grids undertake most of power supply. Therefore, only grid power plants are included in the calculation. Accordingly, Option I is applicable to the project activity.

Sub-step 3: Select an operating margin (OM) method

The calculation of the operating margin emission factor ($EF_{grid,OM,y}$) is based on one of the following methods:

- a) Simple OM
- b) Simple adjusted OM
- c) Dispatch data analysis OM
- d) Average OM

Option b needs the annual load duration curve of the grid. The data required by this method is not publicly available in China. This option is not applicable.

Option c requires the detailed operating and dispatch data of power plants within the grid, but the dispatch data for the Central China Power Network is not publicly available. This option is not applicable.

Option d can be only used when low-cost/ must run resources account for more than 50% of the total amount of grid power generation. As shown in table A1 of annex 3, the CCPG is a coal-fired dominated power grid, where the installed capacity of low cost and must run plants account for 35.95%, 43.81%, 37.89%, 38.60% and 35.12% in 2002, 2003, 2004, 2005 and 2006 respectively. The fractions are all below 50%, so this option is not applicable.

Therefore the Simple OM is selected and the emission factor is calculated using the following data vintage:

Ex-ante option: A 3-year generation weighted average, based on the most recent data available at the time of submission of the CDM-PDD to the DOE for validation, without requirement to monitor and recalculate the emissions factor during the crediting period.

Sub-step 4: Calculate the operating margin emission factor according to selected method

The Simple Operating Margin emission factor $EF_{grid,OM,y}$ is defined as the generation-weighted average emissions per unit net electricity generation (tCO_2/MWh) of all generating sources serving the system, not including low-operating cost and must-run power plants. Two options can be selected to calculate the simple OM:

Option A: Based on the net electricity generation and a CO_2 emission factor of each power unit; or

Option B: Based on the total net electricity generation of all power plants serving the system and the fuel types and total fuel consumption of the project electricity system.

Option B can only be used if:

- (a) The necessary data for Option A is not available; and



- (b) Only nuclear and renewable power generation are considered as low-cost / must-run power sources and the quantity of electricity supplied to the grid by these sources is known; and
- (c) Off-grid power plants are not included in the calculation (i.e. if Option I has been chosen in Step 2).

For data of each power station and power unit is not public available in China, it can't adopt option A. Meanwhile, only nuclear and renewable power generation are considered as low-cost / must-run power sources and the quantity of electricity supplied to the grid by these sources is known from "China Electric Power Yearbook" and "China Energy Statistical Yearbook". Therefore, option B could be used to calculate OM emission factor.

The formula of $EF_{grid,OM,simple,y}$ is:

$$EF_{grid,OM,simple,y} = \frac{\sum_i FC_{i,y} \cdot NCV_{i,k} \times EF_{CO_2,i,y}}{EG_y} \quad (11)$$

Where:

$EF_{grid,OM,simple,y}$ = Simple operating margin CO₂ emission factor in year y (tCO₂/MWh)

$FC_{i,y}$ = Amount of fossil fuel type i consumed in the project electricity system in year y (mass or volume unit),

$NCV_{i,y}$ = net calorific value (energy content) of fossil fuel type i in year y (TJ/mass or volume unit)

$EF_{CO_2,i,y}$ = CO₂ emission factor of fossil fuel type i in year y (tCO₂/TJ)

EG_y = net electricity generated and delivered to the grid by all power sources serving the system, not including low-cost/must-run power plants/units, in year y (MWh)

i = All fossil fuel types combusted in power sources in the project electricity system in year y

y = Three most recent years for which data is available at the time of submission of the CDM-PDD to the DOE for validation (ex-ante option)

Based on calculation from the China DNA (see Annex 3), the OM Emission Factor of the Central China Power Grid is 1.2783 tCO₂e/MWh.

Sub-step 5: Identify the cohort of power units to be included in the build margin (BM)

According to the tool to calculate the emission factor for an electricity system, the sample group of power units m used to calculate the build margin could consist of either:

- (a) the set of five power plants that have been built most recently, or
- (b) the set of power capacity additions in the electricity system that comprise 20% of the system generation (in MWh) and that have been built most recently;

The tool also states that project participants should use the set of power units that comprises the larger annual generation. In this case option (b) is used.



In terms of the vintage of the data Option 1 is chosen: For the first crediting period, the build margin emission factor is calculated ex-ante based on the most recent information available on units already built for sample group m at the time of CDM-PDD submission to the DOE for validation. For the second crediting period, the build margin emission factor should be updated based on the most recent information available on units already built at the time of submission of the request for renewal of the crediting period to the DOE. For the third crediting period, the build margin emission factor calculated for the second crediting period should be used. This option does not require monitoring the emission factor during the crediting period.

Sub-step 6: Calculate the build margin emission factor

According to the tool, the build margin emission factor is the generation-weighted average emission factor (tCO₂/MWh) of all power units m during the most recent year y for which power generation data is available, calculated as follows:

$$EF_{\text{grid, BM, } y} = \frac{\sum_m EG_{m, y} \cdot EF_{EL, m, y}}{\sum_m EG_{m, y}} \quad (12)$$

Where:

$EF_{\text{grid, BM, } y}$ = Build margin CO₂ emission factor in year y (tCO₂/MWh)

$EG_{m, y}$ = Net quantity of electricity generated and delivered to the grid by power unit m in year y (MWh)

$EF_{EL, m, y}$ = CO₂ emission factor of power unit m in year y

m = Power units included in the build margin

y = Most recent historical years for which power generation data is available

Following guidance issued by the CDM Executive Board in response to a request for guidance from an accredited DOE on the determination of the Build Margin in methodology AM0005 in China¹⁰⁶, $EF_{\text{BM, } y}$ is calculated as the capacity weighted average emissions factor of new installed capacity rather than the generation weighted factor. Furthermore, it is suggested in the same guidance note that the efficiency level of the best technology commercially available in the provincial/regional or national grid of China is used as a conservative proxy for each fuel type in estimating the fuel consumption when calculating the Build Margin. The suggested approach is followed in the determination of the Build Margin for the purposes of this project.

Because capacities of technologies using coal, oil and gas cannot be separated from the total thermal power generation from available statistics, the following method is used for the calculation: first, use the recent one year available energy balance data and calculate percentages of CO₂ emissions of power generation using solid, liquid and gas fuel in the total CO₂ emission. Second, calculate grid thermal power emission factors, using the percentages (as weights) and emission factors of technologies corresponding to best

¹⁰⁶http://cdm.unfccc.int/UserManagement/FileStorage/AM_CLAR_QEJWJEF3CFBP1OZAK6V5YXPQKK7WYJ

available efficiencies. Lastly, the thermal power emission factor is multiplied by the percentage of thermal power in the newest 20% capacity in the grid, and the result is the Build Margin emission factor of the grid.

The steps and equations are as follows:

1. Calculate percentages of CO₂ emission of power generation using solid, liquid and gas fuel in total CO₂ emission.

$$\lambda_{Coal,y} = \frac{\sum_{i \in COAL,j} F_{i,j,y} \times NCV_{i,y} \times EF_{CO_2,i,j,y}}{\sum_{i,j} F_{i,j,y} \times NCV_{i,y} \times EF_{CO_2,i,j,y}} \quad (13)$$

$$\lambda_{Oil,y} = \frac{\sum_{i \in OIL,j} F_{i,j,y} \times NCV_{i,y} \times EF_{CO_2,i,j,y}}{\sum_{i,j} F_{i,j,y} \times NCV_{i,y} \times EF_{CO_2,i,j,y}} \quad (14)$$

$$\lambda_{Gas,y} = \frac{\sum_{i \in GAS,j} F_{i,j,y} \times NCV_{i,y} \times EF_{CO_2,i,j,y}}{\sum_{i,j} F_{i,j,y} \times NCV_{i,y} \times EF_{CO_2,i,j,y}} \quad (15)$$

Where,

$F_{i,j,y}$ = amount of fuel i (tce) consumed by power plants m in year y ,

COAL, OIL and GAS refer to coal fuel, oil fuel and gas fuel in the subscript set.

2. Calculate thermal emission factor

$$EF_{Thermal} = \lambda_{Coal} \times EF_{Coal,Adv} + \lambda_{Oil} \times EF_{Oil,Adv} + \lambda_{Gas} \times EF_{Gas,Adv} \quad (16)$$

Where,

$EF_{Coal,Adv}$, $EF_{Oil,Adv}$ and $EF_{Gas,Adv}$ are emission factors corresponding to commercially optimal efficient power generation technology using coal, oil and gas.

3. Calculate the BM of the Grid

$$EF_{Grid,BM,y} = \frac{CAP_{Thermal}}{CAP_{Total}} \times EF_{Thermal} \quad (17)$$

Where,

CAP_{Total} = newest 20% added total capacity,



$CAP_{Thermal}$ = newly added thermal power capacity.

The data used to calculate OM and BM emission factors are all publicly available. The generation data and average self consumption rate data are from publicly available China Electric Power Yearbooks. The data of fuel consumption per electricity generated and net calorific values of fuels are from the China Energy Statistical Yearbooks. The $OXID_i$ and $EF_{CO2,i}$ data by fuels are from the “2006 IPCC Guidelines for National Greenhouse Gas Inventories,” Volume 2 Energy.

According to the announcement “China's Regional Grid Baseline Emission Factors Renewed”, the weighted average of coal consumption per kWh supplied of 30 new built 600 MW sub critical units in 2006 is adopted to determine the emission factor of the best advanced coal fired generation technology, which is 329.94gce/kWh. In other words, the efficiency of best advanced coal fired generation technology is 37.28%.

The maximum electricity supplied efficiency of oil and gas fired generation plants are regarded as approximate estimation of commercially optimal efficiency technology. Similarly, the fuel consumption per kWh supplied of best advanced oil and gas fired generation technology is determined to be 252 gce/kWh, which means a generation efficiency of 48.81%.

According to the Chinese DNA⁴, the $EF_{Grid,BM,y}$ for the Central China Power Grid is 0.6687 tCO₂e/MWh. For the data source and the calculations, please see Annex 3.

Sub-step 7: Calculate the combined margin emissions factor

The combined margin emissions factor is calculated as follows:

$$EF_y = w_{OM} \cdot EF_{Grid,OM,y} + w_{BM} \cdot EF_{Grid,BM,y} \quad (18)$$

Where,

$EF_{grid,OM,y}$ = Operating margin CO₂ emission factor in year y (tCO₂/MWh)

$EF_{grid,BM,y}$ = Build margin CO₂ emission factor in year y (tCO₂/MWh)

w_{OM} = Weighting of operating margin emissions factor (%)

w_{BM} = Weighting of build margin emissions factor (%)

The defaults weights are used, i.e. each of the Operating Margin and Build Margin is weighted equally.

$$w_{OM} = w_{BM} = 0.5$$

In this case, for the first crediting period:

$$EF_{grid,CM,y} = 0.5 \times EF_{grid,OM,y} + 0.5 \times EF_{grid,BM,y} = 0.9735 \text{ tCO}_2/\text{MWh}$$

STEP 2: Determination of EG_y

Where scenario 2 applies, EG_y corresponds to the net quantity of electricity generation in the Project plant ($EG_y = EG_{\text{project plant},y}$).

C. EMISSION REDUCTIONS OR INCREASES DUE TO DISPLACEMENT OF HEAT



The proposed project will not claim GHG emission reductions from displacing heat that would otherwise be produced within Wanzai Industrial Park.

$$ER_{\text{heat},y} = 0$$

D. BASELINE EMISSIONS DUE TO NATURAL DECAY OR UNCONTROLLED BURNING OF BIOMASS RESIDUES

$BE_{\text{biomass},y}$ is determined in 2 steps:

Step1: Determination of the quantity of biomass residues used as a result of the project activity

Step2: Estimation of methane emissions, consistent with the baseline scenario for the use of biomass residues

Step1 Determination of the quantity of biomass residues used as a result of the project activity ($BF_{PJ,k,y}$)

Where scenario 2 applies, the total quantity of biomass residues used in the project plant ($\sum BF_{k,y}$) is attributable to the project activity and hence $BF_{PJ,k,y} = BF_{k,y}$, namely the quantity of biomass residues combusted in the project plant during the year y (tons of dry matter or litter)

Step 2 Estimation of methane emissions

As shown above, the baseline scenario is B1 and B3 (uncontrolled burning or aerobic decay of the biomass residues), therefore the emissions from avoided disposal of the biomass to be used by the project activity in year y can be calculated as shown below. This assumes that for both B1 and B3, that the biomass residues would be burned in an uncontrolled manner.

$$BE_{\text{biomass},y} = GWP_{CH_4} \cdot \sum_k BF_{PJ,k,y} \cdot NCV_k \cdot EF_{\text{burning},CH_4,k,y} \quad (20)$$

where:

$BE_{\text{biomass},y}$: Baseline emissions due to natural decay or burning of anthropogenic sources of biomass residues during the year y (tCO₂e/yr)

GWP_{CH_4} : Global Warming Potential of methane valid for the commitment period (tCO₂e/tCH₄)

$BF_{PJ,k,y}$: Incremental quantity of biomass residue type k used as a result of the project activity in the project plant during the year y (tons of dry matter or litter), for this project, $BF_{PJ,k,y} = BF_{k,y}$

NCV_k : Net calorific value of the biomass residue type k (GJ/ton of dry matter or GJ/litter)

$EF_{\text{burning},CH_4,k,y}$: CH₄ emission factor for uncontrolled burning of the biomass residue type k during the year y (tCH₄/GJ)



As lack of more accurate information, the IPCC value 0.0027tCH₄ per ton of biomass is used as default value for the product of NCV_k and $EF_{burning,CH_4,k,y}$ which is recommended by the baseline methodology.

Furthermore, the uncertainty can be deemed to be greater than 100%, resulting in a conservativeness factor of 0.73, according to Table 6 of the methodology. This conservativeness factor is then multiplied with the estimate for the CH₄ emission factor given above. Thus the emission factor of 0.001971t CH₄/t of biomass residue is used here.

E. LEAKAGE

Option L2 (ACM0006, Section Leakage) is used to demonstrate that there is an abundant surplus of biomass residue in the region of the project activity, and then the leakage can be neglected.

L2: Demonstrate that there is an abundant surplus of the biomass residue in the region of the project activity which is not utilized. For this purpose, demonstrate that the quantity of available biomass residue of type k in the region is at least 25% larger than the quantity of biomass residues of type k that are utilized, including the project plant.

The geographical boundary in the biomass availability report is covering a radius of 70 km around the project site.

The biomass residue availability report was done by the FSR designer with support from the local authorities on the plantation area and crop yield and forestry residues. The Rice Husk amount is from local public statistic. The loss rates for forestry residues and rice husk are experienced data. The consumption amounts for uses other than the project are done by related official department.

Based on the feasibility study report and the biomass residue availability research report, currently, the biomass residues to be used in the proposed project are: rice husk, branch, barks and saw dust, and their Availabilities are summarized as follows:

Table B-14 Biomass availabilities¹⁰⁷

| Demonstration of abundant surplus of biomass availability | | | | |
|---|-----------------|--------------|-----------|---------------|
| Biomass Type | Rice husks (kt) | Branches(kt) | Barks(kt) | Saw dust (kt) |
| Total biomass generation in the region | 200.74 | 450.00 | | |
| Biomass loss | 20.07 | 45.00 | | |
| Available Biomass in the region | 180.67 | 405.00 | | |
| Biomass utilised out of the project | 18.07 | 60.75 | | |
| Biomass utilised by the project | 85.00 | 60.00 | 35.00 | 31.00 |
| Total biomass utilised, including the project | 103.07 | 186.75 | | |

¹⁰⁷ Note: A statistic is issued by a reputed institute on the biomass availability



| | | |
|---|------|------|
| Available Biomass/Total biomass utilised | 175% | 217% |
| Available Biomass/Total biomass utilised - 100% | 75% | 117% |
| Abundant surplus? (more than 25%) | Yes | Yes |

As the biomass residue type changed, the new values of biomass quantity used by the project have been calculated by the FSR institute. In the same condition of 6000 operational hours at full load, the total energy input from biomass residues is 2142.10TJ, which is almost equal to the value in the project FSR. The new values of biomass consumption quantity, moisture and NCV are given in table B-15.

Table B-15 Biomass consumption in the project plant and energy input calculation

| Biomass consumption in the project plant and energy input calculation | | | | |
|---|------------|-----------|-----------|-----------|
| Biomass Type | Rice husk | Branches | Barks | Saw dust |
| Wet Weight(t) | 85000 | 60000 | 35000 | 31000 |
| Moisture(%) | 12.67% | 22.29% | 30.34% | 37.02% |
| Dry Weight(t) | 74231 | 46626 | 24381 | 19524 |
| NCV (GJ/t) | 13.23 | 13.80 | 12.74 | 10.55 |
| Energy input(GJ) | 982069.52 | 643438.80 | 310613.94 | 205976.09 |
| Total Energy input(GJ) | 2142098.35 | | | |

Based the analysis above, we can find out that the quantity of available biomass residues in the defined geographical boundary are far larger than 25% the quantity of biomass residues utilized in the project. Thus the utilization of the biomass residues by the project plant is considered to have no influence on the current biomass usage, and therefore the leakage of proposed project is considered to be 0. The project owner will guarantee the consumption volume of biomass residue type not exceeding the limited volume mentioned in the above table to avoid leakage.

In conclusion, the Project does not result increase of fossil fuel consumptions, i.e. the leakage is zero ($L_y = 0 \text{ tCO}_2\text{e}$). The real situation of Leakage will be monitored once the project owner begins collecting biomass residues.

B.6.2. Data and parameters that are available at validation:

| | |
|--|---|
| Data / Parameter: | GWP_{CH_4} |
| Data unit: | tCO ₂ e/tCH ₄ |
| Description: | Global warming potential for CH ₄ |
| Source of data used: | IPCC 2006 Revised Guidelines |
| Value applied: | 21 for the first commitment period. Shall be updated according to any future COP/MOP decisions. |
| Justification of the choice of data or description of measurement methods | IPCC 2006 default value |



CDM – Executive Board

page 67

| | |
|-----------------------------------|---|
| and procedures actually applied : | |
| Any comment: | - |

| | |
|---|---|
| Data / Parameter: | $FC_{i,y}$ |
| Data unit: | t (m ³) |
| Description: | Consumed quantity of fuel i in year(s) y by power plants in CCPG |
| Source of data used: | China Energy Statistical Yearbooks |
| Value applied: | Refer to annex 3 |
| Justification of the choice of data or description of measurement methods and procedures actually applied : | Detailed fuel consumption data of individual thermal power plants is not available to the public. The total consumption of various fuels is used instead. |
| Any comment: | - |

| | |
|---|---|
| Data / Parameter: | $COEF_i$ |
| Data unit: | tCO ₂ /t(m ³) |
| Description: | CO ₂ emission coefficient of fuel i (tCO ₂ / mass or volume unit of the fuel) |
| Source of data used: | Calculated |
| Value applied: | Refer to annex 3 |
| Justification of the choice of data or description of measurement methods and procedures actually applied : | Calculated according to the methodology |
| Any comment: | - |

| | |
|---|--|
| Data / Parameter: | $GEN_{i,y}$ |
| Data unit: | MWh |
| Description: | $GEN_{j,y}$ is the electricity (MWh) delivered to the CCPG from power plant using fuel i in year(s) y (Excluding low cost/must run power plants) |
| Source of data used: | China Electric Power Yearbooks |
| Value applied: | Refer to annex 3 |
| Justification of the choice of data or description of measurement methods and procedures actually applied : | Operation data of individual power plants is not available to the public. Summary data is adopted instead. |
| Any comment: | - |

| | |
|--------------------------|-------------|
| Data / Parameter: | $CAP_{i,y}$ |
|--------------------------|-------------|



CDM – Executive Board

page 68

| | |
|---|--|
| Data unit: | MW |
| Description: | Installed capacity of power plants using fuel i in year(s) y in CCPG |
| Source of data used: | China Electric Power Yearbooks |
| Value applied: | Refer to annex 3 |
| Justification of the choice of data or description of measurement methods and procedures actually applied : | Operation data of individual power plants is not available to the public. Summary data is adopted instead. |
| Any comment: | - |

| | |
|---|--|
| Data / Parameter: | $CAP_{Total,y}$ |
| Data unit: | MW |
| Description: | New added total capacity in year(s) y in CCPG |
| Source of data used: | China Electric Power Yearbooks |
| Value applied: | Refer to annex 3 |
| Justification of the choice of data or description of measurement methods and procedures actually applied : | Operation data of individual power plants is not available to the public. Summary data is adopted instead. |
| Any comment: | - |

| | |
|---|--|
| Data / Parameter: | $CAP_{Thermal,y}$ |
| Data unit: | MW |
| Description: | new added thermal power capacity in year(s) y in CCPG |
| Source of data used: | China Electric Power Yearbooks |
| Value applied: | Refer to annex 3 |
| Justification of the choice of data or description of measurement methods and procedures actually applied : | Operation data of individual power plants is not available to the public. Summary data is adopted instead. |
| Any comment: | - |

| | |
|---|--|
| Data / Parameter: | NCV_i |
| Data unit: | TJ/t(m ³) |
| Description: | Net calorific value of fuel i |
| Source of data used: | China Energy Statistical Yearbooks |
| Value applied: | Refer to annex 3 |
| Justification of the choice of data or description of | According to the requirement of methodology, country specific value is used. |



CDM – Executive Board

page 69

| | |
|---|---|
| measurement methods and procedures actually applied : | |
| Any comment: | - |

| | |
|---|---|
| Data / Parameter: | $OXID_i$ |
| Data unit: | % |
| Description: | $OXID_i$ is the oxidation factor of the fuel i |
| Source of data used: | IPCC default value |
| Value applied: | Refer to annex 3 |
| Justification of the choice of data or description of measurement methods and procedures actually applied : | According to the requirement of methodology, IPCC default value is adopted. |
| Any comment: | - |

| | |
|---|---|
| Data / Parameter: | Eff_i |
| Data unit: | % |
| Description: | Power generation efficiency of commercially applicable technology of fuel i in CCPG at present time |
| Source of data used: | China CDM DNA |
| Value applied: | Refer to annex 3 |
| Justification of the choice of data or description of measurement methods and procedures actually applied : | According to the deviation method of EB, technology with maximum efficiency utilized can be the representative of such kind technology. |
| Any comment: | - |

| | |
|---|---|
| Data / Parameter: | $EF_{CO2,i}$ |
| Data unit: | tCO ₂ /TJ |
| Description: | Carbon content of fuel used for power generation |
| Source of data used: | IPCC default value |
| Value applied: | Refer to annex 3 |
| Justification of the choice of data or description of measurement methods and procedures actually applied : | According to the requirement of methodology, IPCC default value is adopted. |
| Any comment: | - |

| | |
|--------------------------|-------------|
| Data / Parameter: | $TDL_{i,y}$ |
|--------------------------|-------------|



| | |
|---|---|
| Data unit: | % |
| Description: | average technical transmission and distribution losses for providing electricity to source j in year y. |
| Source of data used: | Tool to calculate baseline, project and/or leakage emissions from electricity consumption |
| Value applied: | 20 |
| Justification of the choice of data or description of measurement methods and procedures actually applied : | Because the data is not available within host country, the default value (20%) can be adopted for project emission calculation according to the Tool to calculate baseline, project and/or leakage emissions from electricity consumption. Since in China, the average TDL for the power sector during 2008-2006 has been estimated to be between 7%-9% only and it is expected to be decreased to about 6% by year 2020 ¹⁰⁸ , therefore, the value used here is conservative. |
| Any comment: | - |

| | |
|---|--|
| Data / Parameter: | $EF_{CH_4,BF}$ |
| Data unit: | kgCH ₄ /TJ |
| Description: | CH ₄ emission factor for controlled burning of the biomass residue in the project plant |
| Source of data used: | IPCC 2006 Default Value ; ACM0006 |
| Value applied: | 41.1 Where the default CH ₄ emission factor of 30kg/TJ is used, the uncertainty is estimated to be 300%, resulting in a conservativeness factor of 1.37. Thus, in this case the value of this parameter is: $EF_{CH_4,BF}=30*1.37=41.1$ |
| Justification of the choice of data or description of measurement methods and procedures actually applied : | It is calculated using the conservative IPCC 2006 default values. The conservative factor is applied, as specified in the baseline methodology. |
| Any comment: | - |

| | |
|--------------------------|--|
| Data / Parameter: | $NCV_k * EF_{burning,CH_4,k,y}$ |
| Data unit: | tCH ₄ /tonne |
| Description: | CH ₄ emission factor for uncontrolled burning of the biomass residue |
| Source of data used: | IPCC 2006 Default Value ; ACM0006 |
| Value applied: | 0.001971 Where the default CH ₄ emission factor of 0.0027 CH ₄ /t biomass is used, the uncertainty can be deemed to be greater than 100%, resulting in a conservativeness factor of 0.73. Thus this value is used according |

¹⁰⁸ <http://www.okokok.com.cn/Htmls/GenCharts/080314/7505.html>



| | |
|---|--|
| | to ACM0006 |
| Justification of the choice of data or description of measurement methods and procedures actually applied : | The conservative factor is applied, as specified in the baseline methodology |
| Any comment: | - |

B.6.3 Ex-ante calculation of emission reductions:

Project emissions

a) Carbon dioxide emissions from combustion of fossil fuels for transportation of biomass residues to the project plant (PET_y)

According to the Explanation on the Biomass Adaptability for Wanzai Project, the Project is designed to consume 85,000 tons rice husk and 126,000 tons of forestry residues annually (for details see Table B-15). Wet quantity of the biomass is used to calculate PET_y, which is conservative.

The farthest distance the trucks travel will not be more than 70km away from the project site, which is from the biomass collection plan. Therefore, the longest distance and the smallest loading capacity is chosen, namely: AVD_y is adopted as 140km (2*70).

Since the direct measurement of diesel consumption per unit distance is costly and complicated, the CO₂ emission factor for the trucks 0.001097 tCO₂e/km is used, which is IPCC default value from the for Moderate control US Heavy Duty Diesel Trucks and is conservative.

The conservativeness of the emission factor chosen is depicted as follows:

The trucks used in the project is expected to use light diesel with an average load of 3t, with the weight of the truck included, the weight of the fully loaded truck should be no more than 10t. It is stated that the average diesel consumption for trucks with load around 10t will be around 20 liter/100km in China¹⁰⁹. Using the IPCC 2006 default NCV(0.043TJ/t) and EF(20.2 tc/tj) for diesel¹¹⁰ and the diesel density of 0.85kg/liter¹¹¹, the CO₂ emission factor for trucks is just:

$20\text{liter}/100\text{km} \times 0.85\text{kg}/\text{liter} \times 0.043\text{tj}/\text{t} \times 20.2\text{tc}/\text{tj} \times 44/12 = 0.00054 \text{ tCO}_2\text{e}/\text{km}$, which shows that 0.001097 tCO₂e/km used as the emission factor here is conservative.

Refer to the equation (3), the emissions from biomass residues transportation are calculated as follow:
 $\text{PET}_y = (85,000 + 126,000) \text{ t} / 3\text{t} \times 140\text{km} \times 0.001097\text{tCO}_2\text{e}/\text{km} = 10,802 \text{ tCO}_2\text{e}$.

¹⁰⁹ http://www.moc.gov.cn/zhuzhan/jiaotongxinwen/xinwenredian/200706xinwen/200709/t20070926_416413.html

¹¹⁰ 2006 IPCC guidance for National Greenhouse Gas Inventories, Chapter 1, Volume 2, Table 1.2 and 1.3

¹¹¹ <http://en.wikipedia.org/wiki/Diesel>

**b) Carbon dioxide emissions from on-site consumption of fossil fuels (PEFF_y)**

The on-site consumption of fossil fuels is from two sources. The first one is from the start-up diesel whose consumption is estimated as 25t per year. The second source is from the diesel consumption for forklifts at collections sites and project site whose consumption is estimated as 50t per year. There is no co-firing fossil fuels consumption in the project site.

Since the direct measurement of NCV of diesel is not economically practical to such a small amount of uncontinuous consumption and the reliable China Energy Statistical Yearbook is available and updated annually. Therefore, 0.042652 TJ/t is used as the NCV of diesel which is from China Energy Statistical Yearbook 2007.

Since the direct measurement of EF of diesel is not feasible and the reliable local or national data is not available, therefore, 74.1tCO₂e/TJ is used as the EF of diesel which is IPCC default value.

Therefore the PEFF_y is calculated as follow:

$$PEFF_y = (25+50)t \times 0.042652 \text{ TJ/t} \times 74.1\text{tCO}_2\text{e/TJ} = 237\text{tCO}_2\text{e}.$$

c) CO₂ emissions from electricity consumption (PEEC_y)

According to the data from Table B-16, the quantity of rice husk, branch, barks and saw dust consumed annually are 85,000t, 60,000t, 35,000t and 31,000t (wet weight) which will be shredded to small pieces before combusting in the boiler. The electricity consumption is 0.010MWh for per ton biomass residues, which means it will take a total electricity consumption of 2,110 MWh for the pretreatment of biomass in one year

EF_{EL,j,y} (=EF_{grid,CM,y}) is calculated in Annex 3 as 0.9735 tCO₂e/MWh, thus the CO₂ emissions from electricity consumption (PEEC_y) can be calculated as:

$$PEEC_y = 2,110\text{MWh} \times 0.9735\text{tCO}_2\text{e/MWh} \times (1+20\%) = 2,465\text{tCO}_2\text{e}$$

d) Methane emission from Biomass residues combustion (PE_{biomass,CH₄,y})

According to the data from Table B-16, the quantity of rice husk, branch, barks and saw dust consumed annually are 74,231t, 46,626t, 24,381t and 19,524t (dry weight). The weighted mean of NCVs of the four types biomass is 13.0012GJ/T.

The CH₄ emission factor for controlled burning of the biomass residue in the project plant, EF_{CH₄,BF}=41.1kgCH₄/TJ, which is calculated using the IPCC default values described in the methodology. So, PE_{biomass,CH₄,y}= 164,761t × 0.0130012TJ/tonne × 41.1kgCH₄/TJ/1000=88.04tCH₄

Therefore the project emissions are calculated as:

$$\begin{aligned} PE_y &= PET_y + PEFF_y + PEEC_y + GWP_{CH_4} \times PE_{biomass,CH_4,y} \\ &= 10,802\text{tCO}_2\text{e} + 237\text{tCO}_2\text{e} + 2,465\text{tCO}_2\text{e} + 21 \times 88.04 = 15,353\text{tCO}_2\text{e} \end{aligned}$$

Emission reductions due to displacement of electricity**Step 1: Determination of EF_{electricity,y}**

Based on the description in B.6.1 and detailed calculation in Annex 3, the EF_{electricity,y} = EF_{grid,y} = 0.9735 tCO₂e/MWh.

**Step 2: Determination of EG_y**

According to the Feasibility Study Report, the delivered electricity is 126,720MWh per year, i.e. $EG_y = 126,720\text{MWh}$. Therefore:

$$ER_{\text{electricity},y} = 126,720\text{MWh} \times 0.9735\text{tCO}_2/\text{MWh} = 123,362\text{tCO}_2\text{e}$$

Emission reductions or increases due to displacement of heat

The proposed project will not claim GHG emission reductions from displacing heat that would otherwise be produced within Wanzai Industrial Park.

$$ER_{\text{heat},y} = 0$$

Uncontrolled burning or decay of biomass baseline emission**Step 1 Determination of the quantity of biomass residues used as a result of the project activity**

The quantity of rice husk, branch, barks and saw dust consumed annually are 74,231t, 46,626t, 24,381t and 19,524t (dry weight).

Step2 Estimation of methane emissions

As lack of more accurate information, the emission factor 0.001971 tCH₄/tonne biomass residue is used in the PDD, which is suggested by the baseline methodology.

So, Baseline emissions due to natural decay or burning of anthropogenic sources of biomass residues during the year y ,

$$BE_{\text{biomass},y} = GWP_{\text{CH}_4} \cdot \sum_k BF_{PJ,k,y} \cdot NCV_k \cdot EF_{\text{burning},\text{CHA},k,y}$$

$$= 21\text{tCH}_4/\text{tCO}_2 \times 164,761\text{t} \times 0.001971 \text{ tCH}_4/\text{tonne} = 6,820 \text{ tCO}_2\text{e}$$

Leakage

Based on the description in B.6.1, the leakage of the Project is zero, i.e. $L_y = 0\text{tCO}_2\text{e}$

Emission Reductions

Refer to the equation (1), the emission reductions are calculated as:

$$ER_y = ER_{\text{heat},y} + ER_{\text{electricity},y} + BE_{\text{biomass},y} - PE_y - L_y = 114,828\text{tCO}_2\text{e}$$

B.6.4 Summary of the ex-ante estimation of emission reductions:

| Year | Estimation of project activity emissions (tonnes of CO ₂ e) | Estimation of baseline emissions (tonnes of CO ₂ e) | Estimation of leakage (tonnes of CO ₂ e) | Estimation of overall emission reductions (tonnes of CO ₂ e) |
|------|--|--|---|---|
| 2011 | 15,353 | 130,181 | 0 | 114,828 |
| 2012 | 15,353 | 130,181 | 0 | 114,828 |
| 2013 | 15,353 | 130,181 | 0 | 114,828 |



| | | | | |
|--|--------|---------|---|---------|
| 2014 | 15,353 | 130,181 | 0 | 114,828 |
| 2015 | 15,353 | 130,181 | 0 | 114,828 |
| 2016 | 15,353 | 130,181 | 0 | 114,828 |
| 2017 | 15,353 | 130,181 | 0 | 114,828 |
| Total (tonnes of CO₂e) | | | | 803,796 |

| |
|--|
| B.7 Application of the monitoring methodology and description of the monitoring plan: |
|--|

| |
|---|
| B.7.1 Data and parameters monitored: |
|---|

| | |
|--|--|
| Data / Parameter: | BF_{k,v} |
| Data unit: | tons of dry matter |
| Description: | Quantity of each biomass residue combusted in the project plant in year y. |
| Source of data to be used: | On-site measurements |
| Value of data applied for the purpose of calculating expected emission reductions in section B.5 | Rice husk: 74,231t Branch:46,626t Barks:24,381t Saw dust:19,524t |
| Description of measurement methods and procedures to be applied: | Use belt weighers. Adjust for the moisture content in order to determine the quantity of dry biomass. The quantity shall be crosschecked with the quantity of electricity and heat generated and any fuel purchase receipts. Monitoring frequency: Continuously, energy balance will be prepared annually. |
| QA/QC procedures to be applied: | The belt weighers will undergo calibration/maintenance subject to appropriate industrial standards. Direct measurements at the plant site will be cross-checked with an annual energy balance that is based on purchased quantities and stock changes |
| Any comment: | - |

| | |
|--|---|
| Data / Parameter: | Moisture content of the biomass residues |
| Data unit: | % water content |
| Description: | Moisture content of the biomass residues |
| Source of data to be used: | On-site measurements |
| Value of data applied for the purpose of calculating expected emission reductions in section B.5 | Rice husk: 12.67 Branch:22.29 Barks:30.34 Saw dust:37.02 |
| Description of measurement methods and procedures to be applied: | The data will be sampled periodically and analyzed daily by the moisture analyzers in the laboratory of the plant. Monitoring frequency: |



CDM – Executive Board

page 75

| | |
|---------------------------------|---|
| applied: | Continuously sampled at fixed time period and analyzed daily, Mean values will be calculated at least annually. |
| QA/QC procedures to be applied: | The monitoring procedures in the laboratory of the plant will be done according to authoritative instructions or guidance |
| Any comment: | In case of dry biomass, monitoring of this parameter is not necessary. |

| | |
|--|--|
| Data / Parameter: | NCV_K |
| Data unit: | GJ/ton of dry matter |
| Description: | Net calorific value of each biomass residue |
| Source of data to be used: | Measurements |
| Value of data applied for the purpose of calculating expected emission reductions in section B.5 | Rice husk: 13.23 Branch:13.80 Barks:12.74 Saw dust:10.55 |
| Description of measurement methods and procedures to be applied: | Measurements will be carried out at reputed laboratories and according to relevant international standards. NCV_K will be measured based on dry biomass. Monitoring frequency: At least every six months, taking at least three samples for each measurement |
| QA/QC procedures to be applied: | The consistency of the measurements will be checked by comparing the measurement results with measurements from previous years, relevant data sources. If the measurement results differ significantly from previous measurements or other relevant data sources, Additional measurements will be conducted. |
| Any comment: | - |

| | |
|--|---|
| Data / Parameter: | AVD_y |
| Data unit: | Km |
| Description: | Average round trip distance (from and to) between the biomass fuel supply sites and the project plant during the year y |
| Source of data to be used: | On site records maintained in the log books |
| Value of data applied for the purpose of calculating expected emission reductions in section B.5 | 140 |
| Description of measurement methods and procedures to be applied: | The data is recorded in the log books based on the information given by the truck driver about the distance from biomass supply site to the project site. Monitoring frequency; Continuously |
| QA/QC procedures to | The data on distance of fuel supply site from the plant can be verified |



CDM – Executive Board

page 76

| | |
|--------------|---|
| be applied: | by cross checking data records on the distances available with Information from other sources (e.g. maps). If data is missing for a particular round trip, the following backup data apply in their order: <ul style="list-style-type: none"> ♦ The round trip distance between the farthest biomass fuel supply site and the project plant will be used. ♦ If the farthest biomass fuel supply site could not be verified, 200km would be used for conservativeness |
| Any comment: | - |

| | |
|--|--|
| Data / Parameter: | N_y |
| Data unit: | - |
| Description: | Number of truck trips for the transportation of biomass |
| Source of data to be used: | On site records maintained in the log books |
| Value of data applied for the purpose of calculating expected emission reductions in section B.5 | 70,333 |
| Description of measurement methods and procedures to be applied: | Each time every truck which transports biomass residue to the plant will be counted and recorded in the log books. Monitoring frequency; Continuously |
| QA/QC procedures to be applied: | The consistency of the number of truck trips will be checked with the quantity of biomass combusted by the relation with previous years |
| Any comment: | - |

| | |
|--|---|
| Data / Parameter: | EF_{km,CO2} |
| Data unit: | tCO ₂ e/km |
| Description: | Average CO ₂ Emission Factor for transportation of biomass with trucks during year y |
| Source of data to be used: | IPCC default value |
| Value of data applied for the purpose of calculating expected emission reductions in section B.5 | 0.001097 Revised 1996 IPCC Guidelines for National Greenhouse Gas Inventories (Table 1-32 on Page 1.75) of the Reference Manual (Estimated Emission Factors for US Heavy Duty Diesel Vehicles) |
| Description of measurement methods and procedures to be applied(if any): | Choose emission factors applicable for the truck types used from the literature in a conservative manner. The appropriateness of the data will be reviewed annually |
| QA/QC procedures to be applied: | - |
| Any comment: | - |



| | |
|--|---|
| Data / Parameter: | EF_{CO₂,i,y} |
| Data unit: | kgCO ₂ e/TJ |
| Description: | CO ₂ emission factor for fossil fuel type i (diesel) |
| Source of data to be used: | IPCC default value |
| Value of data applied for the purpose of calculating expected emission reductions in section B.5 | 74,100 IPCC 2006 default value (Volume2.Chapter2.P16) , diesel emission factor |
| Description of measurement methods and procedures to be applied,(if any): | The appropriateness of the data will be reviewed annually |
| QA/QC procedures to be applied: | - |
| Any comment: | The plant is designed to use diesel at this stage. Should any other fossil fuel be used during operation, the same monitoring procedures apply. |

| | |
|--|---|
| Data / Parameter: | NCV_i |
| TJ/tonne | TJ/tonne |
| Description: | Net Calorific Value(NCV _i) of fossil fuel type i(diesel) |
| Source of data to be used: | Reliable National Data |
| Value of data applied for the purpose of calculating expected emission reductions in section B.5 | 0.042652 China Energy Statistical Yearbook 2007,Diesel NCV |
| Description of measurement methods and procedures to be applied: | The appropriateness of the data will be reviewed annually |
| QA/QC procedures to be applied: | - |
| Any comment: | The plant is designed to use diesel at this stage. Should any other fossil fuel be used during operation, the same monitoring procedures apply. |

| | |
|----------------------------|---|
| Data / Parameter: | FF_{project plant i, y} |
| Data unit: | Tonnes |
| Description: | Quantity of fossil fuel type i(diesel) combusted in the project plant during year y |
| Source of data to be used: | On-site measurements |



CDM – Executive Board

page 78

| | |
|--|--|
| Value of data applied for the purpose of calculating expected emission reductions in section B.5 | 25t |
| Description of measurement methods and procedures to be applied: | The consumption of diesel will be monitored using volume flow meters and recorded by the project participants. This will be converted to the mass of diesel consumed using the standard density of diesel (0.85 kg/litre). Monitoring frequency: Continuously |
| QA/QC procedures to be applied: | The meter will under go calibration/maintenance subject to appropriate industrial standards. The measurements will be cross-checked by the purchased quantities and stock changes if available. |
| Any comment: | This includes diesel used for start-up. The plant is designed to use diesel at this stage. Should any other fossil fuel be used during operation, the same monitoring procedures apply. |

| | |
|--|--|
| Data / Parameter: | $FF_{project\ site,i,y}$ |
| Data unit: | Tonnes |
| Description: | Quantity of fossil fuel type i combusted in the project site(including the collection sites) for other purposes that are attributable to the project activity during year y |
| Source of data to be used: | On site consumption records maintained in the log books |
| Value of data applied for the purpose of calculating expected emission reductions in section B.5 | 50 |
| Description of measurement methods and procedures to be applied: | The consumption of diesel will be monitored using Diesel purchase and consumption log book. Monitoring frequency: Continuously |
| QA/QC procedures to be applied: | The data will be cross checked by the purchase receipts. |
| Any comment: | This should not include fossil fuels co-fired in the project plant but any other fuel consumption at the project site (including the biomass collections sites) that is attributable to the project activity (e.g. for mechanical preparation of the biomass residues). If there is any fossil fuel used from shredders, forklift or other machines for the mechanical preparation of the biomass residues, it will be recorded. They are supposed to use diesel at this stage. Should any other fossil fuel be used during operation, the same monitoring procedures apply. |

| | |
|--------------------------|-------------|
| Data / Parameter: | $EC_{PJ,y}$ |
|--------------------------|-------------|



| | |
|--|--|
| Data unit: | MWh |
| Description: | On-site electricity consumption (including the electricity consumption for the mechanical treatment of the biomass in the biomass collection sites and the project site) attributable to the project activity during the year y |
| Source of data to be used: | On-site measurements by meter or calculated conservatively as the weight of biomass residues smashed in tons and the electricity consumption factor (kWh/ton) |
| Value of data applied for the purpose of calculating expected emission reductions in section B.5 | It is estimated as 2,110MWh . |
| Description of measurement methods and procedures to be applied: | <p>When the biomass residue is mechanically pretreated, the proposed project needs a certain amount of electricity from grid. This amount will be metered or calculated conservatively.</p> <p>If the monitoring data is missing, or it is not feasible to install a dedicated meter to monitor this indicator, it will be calculated conservatively as the weight of biomass residues smashed in tons and the electricity consumption factor (kWh/ton). The electricity factor can be calculated as follows:</p> <ol style="list-style-type: none"> 1) Collecting all the nameplates power (in kW) and capacity(t/h) of every biomass residue crackers 2) Calculating the electricity factor corresponding to each cracker in kWh/t 3) Using the largest number as a conservative electricity factor for the calculation <p>Monitoring frequency: Continuously ,aggregated at least annually</p> |
| QA/QC procedures to be applied: | Cross-check measurement results with invoices for purchased electricity if available |
| Any comment: | - |

| | |
|--|--|
| Data / Parameter: | EG_{project plant,y} |
| Data unit: | MWh |
| Description: | Net quantity of increased electricity generated in the project plant during the year y |
| Source of data to be used: | On-site measurements |
| Value of data applied for the purpose of calculating expected emission reductions in section B.5 | 126,720 |
| Description of | Electricity supplied to the grid and purchased from the grid will be |



CDM – Executive Board

page 80

| | |
|---|---|
| measurement methods and procedures to be applied: | <p>monitored by a double way meter and the data will be cross-checked by the invoices and the power transaction note if available.</p> <p>Electricity imported from a 10kv backup power will be monitored by meter and the amount of electricity imported through this line will be checked by the invoice if available.</p> <p>The net electricity equals to electricity supplied to the grid minus electricity purchased from the grid minus electricity purchased from the 10kv backup power.</p> <p>The meters are 0.5 double-way meters.</p> <p>Monitoring frequency: Continuously</p> |
| QA/QC procedures to be applied: | <p>The consistency of the data will be cross-checked with receipts from electricity sales and invoices, if available; and the quantity of fuels fired to see whether the electricity generation divided by the quantity of fuels fired results in a reasonable efficiency.</p> |
| Any comment: | - |

| | |
|--|---|
| Data / Parameter: | - |
| Data unit: | Tons |
| Description: | Quantity of each biomass residues that are utilized in the defined geographical region |
| Source of data to be used: | Surveys or Statistics |
| Value of data applied for the purpose of calculating expected emission reductions in section B.5 | Table B-14 |
| Description of measurement methods and procedures to be applied: | <p>Surveys or statistics from local related official department or official public resource. If they are not available, the project owner will ask specialized institute or consulting company to do the biomass availability research.</p> <p>Monitoring frequency: Annually</p> |
| QA/QC procedures to be applied: | This parameter will be reviewed annually according to the project data and official data. |
| Any comment: | This parameter is applicable since approach L ₂ is utilized to rule out leakage. |

| | |
|--------------------------|---|
| Data / Parameter: | - |
|--------------------------|---|



| | |
|--|---|
| Data unit: | Tons |
| Description: | Quantity of each biomass residues that are available in the region |
| Source of data to be used: | Surveys or statistics |
| Value of data applied for the purpose of calculating expected emission reductions in section B.5 | Table B-14 |
| Description of measurement methods and procedures to be applied: | Surveys or statistics from local related official department or other official public resource. If they are not available, the project owner will ask specialized institute or consulting company to do biomass availability research Monitoring frequency: annually |
| QA/QC procedures to be applied: | - |
| Any comment: | This parameter is applicable since approach L ₂ is utilized to rule out leakage. |

B.7.2 Description of the monitoring plan:

This monitoring plan is to serve as a guideline for the project owner to monitor the emission reduction of the proposed project. The contents of the Monitoring Plan are highlighted as follows:

1. The CDM monitoring management

There is a CDM team underway for the proposed project comprising of personnel picked from the power plant who will perform the dual functions of power plant O&M and compliance with the CDM procedures to monitor the project emission reductions and any leakage effects to make sure that the project compliance with the CDM monitoring and verification requirements.

The plant manager will be in charge of approving the monitoring report, appointing the CDM manager and the relevant monitoring team members and responsible for the monitoring outcome.

The CDM manager will be responsible for liaising with DOE and the buyers, organizing the relevant training, reviewing all the documents related to the monitoring of the project, correcting any errors in time and acting as the quality supervisor of the monitoring process.

The Operating Manger will be responsible for the monitoring associated with operation of the plant, the net electricity generation, the start-up diesel consumption and the dry biomass combusted. In addition, the Operating Manager will supervise meter maintenance and manage the calibration process.

The Biomass Collecting Manager will be responsible for the monitoring associated with biomass collection, the transportation emission, the mechanical biomass pretreatment emission and assisting the annual leakage analysis.

The Financing & Data filing Manager will prepare the available original invoices or receipts associated with the whole monitoring process. Besides, the Financing & Data filing Manager will collect the relevant data from the Operating Manager and the Biomass Collecting Manager summarizes the data, file the data and submit reports to the CDM manager in time.

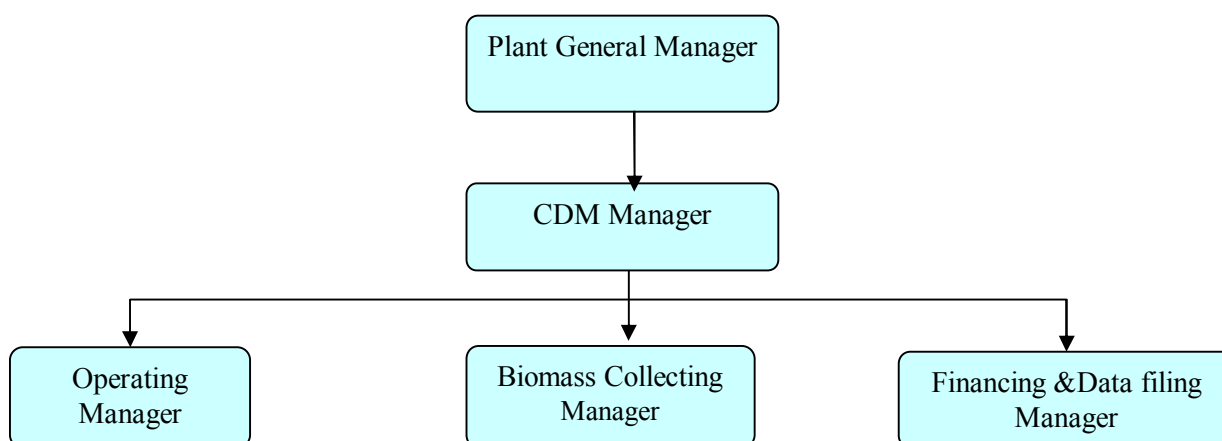


Figure B-3 The CDM monitoring management

2. Monitoring System Design

2.1 Net electricity generation

There will be a double way meter installed on the project site monitoring the electricity generation supplied to the grid and purchased from the grid.

In addition, a 10KV backup power supply will be available in site in the early time of the proposed project and the amount of electricity imported through this line will be monitored and checked by the invoice if available.

The data of electricity supplied to the grid and purchased from the grid will be measured and cross-checked by the invoices and the power transaction note if available.

The accuracy of all the meters will not be lower than 0.5%.

2.2 Biomass residues consumption

The amount of biomass residues combusted in the boiler will be monitored by the belt weigher. The moisture of the biomass residues combusted will also be monitored by sampled continuously at fixed time period and analyzed daily. An energy balance will be recorded monthly to assist verifying the biomass combusted. The accuracy of the belt weigher will not be lower than 1%

2.3 Fossil Fuel Consumption in the power plant

For fossil fuel used for starting up, flow meters will be equipped in the supply and return pipe to monitor the quantity of diesel consumption. The accuracy of the flow meters will not be lower than 1%.



If there is any fossil fuel used for the shredders, forklifts or any other machines for the mechanical biomass pretreatment in the project site (including the biomass collection sites) will be monitored by the diesel purchase and consumption log book.

The purchase receipt will be used for cross-check. If there is any data missing or significant error exists, the entire quantity of fossil fuel purchased in a particular monitoring period would be considered as combusted in the power plant for conservativeness.

2.4 Transportation of Biomass residues

The project developer of the proposed project will structure a recording and monitoring system within the biomass residues supply and management system covering all the biomass collection sites established by the proposed project. Each time each truck transporting the biomass into the project site will be counted and recorded in the log book. The transportation distance to the collection sites will be recorded by company staffs at the sites and the data will be recorded in the log books. The data on distance of fuel supply site from the plant can be verified by cross checking data records on the distances available with information from other sources (e.g. maps).

If data is missing for a particular round trip, the following backup data apply in their order:

- The round trip distance between the farthest biomass fuel supply site and the project plant will be used.
- If the farthest biomass fuel supply site could not be verified, 200km would be used for conservativeness

2.5 Electricity consumed on site

When the biomass residue is mechanically pretreated, the proposed project needs a certain amount of electricity from grid. This amount will be metered or calculated conservatively.

If the monitoring data is missing, or it is not feasible to install a dedicated meter to monitor this indicator, it will be calculated conservatively as the weight of biomass residue smashed in tons and the electricity consumption factor (kWh/ton). The electricity factor can be calculated as follows:

- 1) Collecting all the nameplates power (in kW) and capacity(t/h) of every biomass residue crackers
- 2) Calculating the electricity factor corresponding to each cracker in kWh/t
- 3) Using the largest number as a conservative electricity factor for the calculation

If a dedicated meter is installed to monitor this indicator, the accuracy of the meter will not be lower than 0.5%.

2.6 Leakage

The project consumption and availabilities in the defined geographical area of each type of biomass residue not only the biomass types mentioned above but also other biomass residues utilized in the project will be monitored to check the leakage effect brought by the operation of the proposed project. This will be obtained from surveys or statistics from local related official department or other official public resource. If they are not available, the project owner will ask specialized institute or consulting company to do biomass availability research.

3. Calibration & Maintenance procedures



The meters or monitoring equipment installed in the monitoring system will be calibrated by a certified Party in accordance with the manufacturer's recommendations and National Regulations for ensuring reliability of the system. Calibrations shall be evidenced with certificates of calibration for the relevant meter(s) issued by a qualified body. A calibration and error log will be maintained to provide transparency and sound management. The calibration frequency is once a year.

4. Training, Record Keeping, Error or emergency handling and Reporting Procedures

4.1 Training

Members of staff who are involved in the CDM project will be given training on the CDM and reporting requirements, prior to registration of the project. New members of staff joining the CDM project team will also be given training in relation to their responsibilities. Full training procedures and a training plan will be detailed in the CDM Manual.

4.2 Record Keeping and Internal Reporting Procedure

The data associated with the emission reduction will be kept for at least 2 years after the end of the crediting period or the last issuance of CERs, whichever occurs later.

4.3 Error Handling Procedure

In the event that a meter has lost calibration over the allowable error limit then this shall be corrected at the earliest opportunity and re-calibrated and the data recorded from this meter since the last successful calibration shall be ignored.

The check of the CDM Project manager and then the third party verifier prior to issuance of the CERs is considered adequate for errors in the calculations. Where errors in the calculations are discovered by either of these Parties, the monitoring report shall be modified and the corrected version shall be resubmitted to the verifier.

4.4 External Reporting Procedure

After signing by the CDM Project manager, the report is sent to the third party verifier who is contracted to verify the emissions reductions during the crediting period of the project.

4.5 Procedure for corrective actions arising

The CDM manager is responsible for identifying corrective actions arising from the above procedures and for liaising with the purchaser, the third party verifiers and other stakeholders to take necessary steps to implement the corrective actions.

4.6 Emergency procedures

In the unlikely event of an emergency, set procedures will be followed. Details of the procedures to be followed are described in the relevant Operation Manuals. The key points include:



CDM – Executive Board

page 85

- The Distributed Control System (DCS) will automatically shut off the boilers upon detecting an emergency.
- The operators can also remotely shut off the boilers if they find an emergency situation has occurred.

B.8. Date of completion of the application of the baseline study and monitoring methodology and the name of the responsible person(s)/entity(ies)

>>

Date of completion: 27/07/ 2012

Name of persons determining the baseline study and monitoring methodology:

| Contact Information of the responsible person | Is organisation a Project Participant <i>Yes/No</i> |
|---|---|
| SUN Li GONG Jing LIU Yanan Camco International Limited Floor 14, Lucky Tower A, No. 3 North Road, East 3rd Ring Road, Chaoyang District, Beijing, China, 100027 Tel: (86 10) 8448 1623 Fax: (86 10) 8448 2432 email: lilian.sun@camcoglobal.com kerry.gong@camcoglobal.com melody.liu@camcoglobal.com Website: www.camcoglobal.com | Yes |

**SECTION C. Duration of the project activity / Crediting period****C.1. Duration of the project activity:****C.1.1. Starting date of the project activity:**

>>

06/11/2007 (Key Equipment Purchase Contract Signed Date, the construction start date is 12/11/2008)

C.1.2. Expected operational lifetime of the project activity:

>>

20 years

C.2. Choice of the crediting period and related information:**C.2.1. Renewable crediting period****C.2.1.1. Starting date of the first crediting period:**

>>

01/01/2011 or the date of registration which ever comes late

C.2.1.2. Length of the first crediting period:

>>

7 years

C.2.2. Fixed crediting period:**C.2.2.1. Starting date:**

>>

Not applicable

C.2.2.2. Length:

>>

Not applicable

**SECTION D. Environmental impacts**

>>

D.1. Documentation on the analysis of the environmental impacts, including transboundary impacts:

>>

The EIA of the proposed project was completed by Jiangxi Meteorological Science Institute and approved by Jiangxi Environmental Protection bureau. The summary of this evaluation is as following:

1. Air

In the construction period, the waste gas resource is mainly from, such as the road dust during the transporting process, automobile emission, emissions from excavator and bulldozer, and so on. Some measures will be taken to reduce these negative effects: sprinkling to repress the dust, keep the ground humidity, and clear the soil daggered out in time.

After the project being implemented, there will be waste gas from the boiler. Then, the boiler waste gas will be treated by the bag filter, the dust removal efficiency of which is higher than 99.72%. Therefore, the main pollutants contained in the waste gas, such as dust, SO₂, NO₂ and so on, can meet the pollutants emission standard requirements of the thermal power generation boiler for resource comprehensive utilization, which is regulated in the <Pollutant emission standard for fossil-fuel power plant>. Furthermore, the waste gas will be out though the high chimney (100m height, 2.5m internal diameter) to reduce the air pollution by the air diffusion and self-clean ability.

2. Waste Water

During construction, the waste water is mainly from: rainwater, wash water from all kinds of machinery and automobiles, and domestic wastewater. The wash water mainly contains the suspended sediment, and it will be collected by a simple drain, and discharged out through some treatment. The domestic wastewater will be treated by swage tank.

When the project is operated, all kinds of waste water will be treated separately and reused after reach the 1st standard of <waste water comprehensive discharge standard>: (1) acid-alkali wastewater will be neutralized and then reused as industrial water; (2) Oily wastewater will be separated the oil and water by the oil-water separator and then reused as industrial water; (3) Waste water from boiler and other clean system will be regulated PH, and then flocculated, clarified and then reused as industrial water; (4) The domestic waste water will be treated by contact oxidation process and then transmit into the industrial park sewage pipe network.

3. Noise

During construction, the project noise is mainly from: fixed and successive drilling, construction machinery noise, and fluid traffic noise. At night, the noise machinery will not work, and the impact that the noise have on the residential area will in the standard scope. So the impact is limited.

When the project is operated, the noise source is mainly from machinery noise and gas dynamic noise from



the exhaust pipe. The noise control measures include: choosing the equipments with high efficiency and little noise, taking vibration reduction measures when fixing equipments, taking sound proof measures to the noisy equipments, to control the noise in the standard range.

4. Solid Waste

The solid waste produced in the construction period is mainly the construction residues and the domestic waste from workers. During project operation, the solid waste is mainly: boiler ash residues, domestic waste and sludge from the water treatment station. All kinds of the solid waste will be collected separately. The construction waste will be collected and treated as soon as possible. The metal will be recycled, and the domestic waste will be collected and treated in time. The ash residues will be used for producing White Carbon Black.

The solid waste produced in the proposed project is the common waste, and all of them can be treated and reused. So the solid waste has little negative effect on the environment.

5. Conclusion

After the above measurements performed, the negative impacts on environments will be minimized below the requirements of laws and regulations during the construction and implementation. Furthermore, as renewable power project, the proposed project can reduce the consumption of fossil fuel sources and GHG emission.

D.2. If environmental impacts are considered significant by the project participants or the host Party, please provide conclusions and all references to support documentation of an environmental impact assessment undertaken in accordance with the procedures as required by the host Party:

>>

According to EIA, no significant environmental impacts are discovered by the project participants or the host party. Jiangxi Environmental Protection Bureau has approved the EIA in Aug., 17th, 2007.

**SECTION E. Stakeholders' comments**

>>

E.1. Brief description how comments by local stakeholders have been invited and compiled:

There are two ways utilized to invite the local stakeholders to give comments:

(1) By websites and posters

A summary of the project's introduction, EIA, questionnaires, contact information of the project was published near the construction site of the proposed project to invite the local stakeholder to give comments on the project during the EIA report compiling period.

(2) By questionnaires

The project owner, together with the EIA organization, carried out the investigation stakeholders in the project site in April, 2007. Questionnaire was implemented by filling the stakeholder comments investigation form. The interviewees are mainly the villagers near around the project site. 50 copies questionnaires were distributed and 49 of them were collected. The recovery rate is 98%. The interviewees include farmer, official, worker and stuff covering different age and they have different education level. The basic information about the interviewee is described as following table:

Table E-1 Interviewee Statistics

| Occupation | Farmer 17 | worker 17 | Official 1 | Stuff 13 | Others 1 |
|------------|------------------------|-------------------------------|------------------------|---------------|-----------------|
| Education | Primary school 9 | Junior Middle School 19 | Middle School 11 | High School 4 | College above 6 |
| Age | <20 1 | | 20~40 35 | 40~60 13 | |
| Gender | Female 16 | | | Male 33 | |

The relevant questions in the questionnaire are:

Are you familiar with the proposed project?

What do you think the environmental pollution after the project operation?

What do you think the influence on the local economic development?

Which kind of the pollutants is your most concerned?

Do you support the construction of the proposed project?

E.2. Summary of the comments received:

>>

10% of the interviewees are familiar with the proposed project, 55% know partly and 35% are not familiar. 20% of them think it will have a little negative impacts on the local environment and 80% thinks there will be no significant impacts.

92% of the interviewees think the proposed project can improve local economic development, and 8% have no idea. For the most concerned pollutant, 39% is water pollution, 31% noise, and 12% others.



As far as the environmental protection is concerned, all of them support this project construction, and no opponent comments have been received.

| |
|---|
| E.3. Report on how due account was taken of any comments received: |
|---|

>>

The residents and local government are all very supportive to the proposed project. No negative comments have been received on the project. However, there are few persons who express some concerns about waste water and noise. The specific measures to reduce the impacts can be found in the EIA report.

Furthermore, the project owner will make best use of the CDM chance and facilitate the project construction. In the future project operation period, the project owner will keep good contact with the local stakeholders, and invite them to supervise their actions for environmental protection.

**Annex 1****CONTACT INFORMATION ON PARTICIPANTS IN THE PROJECT ACTIVITY**

| | |
|------------------|---|
| Organization: | Wanzai Kaidi Green Energy Development Co., Ltd. |
| Street/P.O.Box: | T1 Jiangxia Avenue, Eastlake Newtech Development Zone |
| Building: | Kaidi Building |
| City: | Wuhan |
| State/Region: | Hubei Province |
| Postfix/ZIP: | 433300 |
| Country: | P.R. China. |
| Telephone: | +86-27-87992876 |
| FAX: | +86-27-87992893 |
| E-Mail: | Cdm_kaidi@yahoo.cn |
| URL: | |
| Represented by: | (Primary Signatory) |
| Title: | Ms. |
| Salutation: | |
| Last Name: | Hao |
| Middle Name: | |
| First Name: | Jing |
| Department: | |
| Mobile: | |
| Direct FAX: | +86-27-87992893 |
| Direct tel: | +86-27-87992876 |
| Personal E-Mail: | Cdm_kaidi@yahoo.cn |
| Represented by: | (Secondary Signatory) |
| Title: | Ms |
| Salutation: | |
| Last Name: | Li |
| Middle Name: | |
| First Name: | Jiawei |
| Department: | |
| Mobile: | |
| Direct FAX: | +86-27-67869283 |
| Direct tel: | +86-27-67869280 |
| Personal E-Mail: | Ellenleigh8work@126.com |

| | |
|-----------------|-----------------------------|
| Organization: | Camco International Limited |
| Street/P.O.Box: | Green Street |
| Building: | Channel House |
| City: | St Helier |
| State/Region: | Jersey |
| Postfix/ZIP: | JE2 4UH |



CDM – Executive Board

page 92

| | |
|------------------|--|
| Country: | Channel Islands |
| Telephone: | +44 (0)1534 834 618 |
| FAX: | +44 (0)1534 834 601 |
| E-Mail: | |
| URL: | www.camcoglobal.com |
| Represented by: | (Primary Signatory) |
| Title: | Mrs |
| Salutation: | Qualification Director |
| Last Name: | Rawlins |
| Middle Name: | |
| First Name: | Madeleine |
| Department: | |
| Mobile: | |
| Direct FAX: | +86 10 8448 2432 |
| Direct tel: | +86 10 8448 1623 |
| Personal E-Mail: | Project.participant.cn@camcoglobal.com |
| Represented by: | (Secondary Signatory) |
| Title: | Ms |
| Salutation: | Carbon Development Director |
| Last Name: | Urgel Esteban |
| Middle Name: | |
| First Name: | Beatriz |
| Department: | |
| Mobile: | |
| Direct FAX: | +44 207 1216 101 |
| Direct tel: | +44 207 1216 121 |
| Personal E-Mail: | Project.participant.cn@camcoglobal.com |

| | |
|-----------------|--|
| Organization: | Camco Carbon Limited |
| Street/P.O.Box: | Green Street |
| Building: | Channel House |
| City: | St Helier |
| State/Region: | Jersey |
| Postfix/ZIP: | JE2 4UH |
| Country: | Channel Islands |
| Telephone: | +44 (0)1534 834 618 |
| FAX: | +44 (0)1534 834 601 |
| E-Mail: | |
| URL: | www.camcoglobal.com |
| Represented by: | (Primary Signatory) |
| Title: | Mrs |
| Salutation: | Qualification Director |
| Last Name: | Rawlins |
| Middle Name: | |
| First Name: | Madeleine |



CDM – Executive Board

page 93

| | |
|------------------|--|
| Department: | |
| Mobile: | |
| Direct FAX: | +86 10 8448 2432 |
| Direct tel: | +86 10 8448 1623 |
| Personal E-Mail: | Project.participant.cn@camcoglobal.com |
| Represented by: | (Secondary Signatory) |
| Title: | Ms |
| Salutation: | Carbon Development Director |
| Last Name: | Urgel Esteban |
| Middle Name: | |
| First Name: | Beatriz |
| Department: | |
| Mobile: | |
| Direct FAX: | +44 207 1216 101 |
| Direct tel: | +44 207 1216 121 |
| Personal E-Mail: | Project.participant.cn@camcoglobal.com |



Annex 2

INFORMATION REGARDING PUBLIC FUNDING

There is no public funding in the project activity.

**Annex 3****BASELINE INFORMATION**

According to the approved methodology ACM0002 and the document “China's Regional Grid Baseline Emission Factors Renewed”, released at <http://cdm.ccchina.gov.cn/> on 30 December 2008, the $EF_{grid,CM,y}$, $EF_{grid,OM,y}$, and $EF_{grid,BM,y}$ of Central China Power Grid could be calculated as following:

A. Electricity Generation of Central China Power Grid (2002-2006)**Table A1. Electricity Generation of Central China Power Grid (2002-2006)**

| Year | Electricity Generation (Unit: 10 ⁸ KWh) | | | | | Split of low-cost/must-run resources |
|------|--|---------|---------|---------|--------|--------------------------------------|
| | Total | Hydro | Thermal | nuclear | Others | |
| 2002 | 3127.88 | 1124.40 | 2003.47 | 0 | 0 | 35.95% |
| 2003 | 8345.05 | 3655.70 | 4689.35 | 0 | 0 | 43.81% |
| 2004 | 4396.36 | 1665.89 | 2730.47 | 0 | 0 | 37.89% |
| 2005 | 4964.30 | 1915.48 | 3048.25 | 0 | 0.57 | 38.60% |
| 2006 | 5478.59 | 1922.96 | 3554.53 | 0 | 1.02 | 35.12% |

Sources: China Electric Power Yearbook 2002-2007

B. Calculation of Operating Margin Emission Factor ($EF_{grid,OM,y}$)**Table B1. Electricity Generation of Central China PowerGrid in 2004**

| | Electricity generation of fuel-fired power plants (MWh) | Auxiliary power ratio (%) | Total Electricity Supplied to the Grid (MWh) |
|--------------|---|---------------------------|--|
| Jiangxi | 30127000 | 7.04 | 28,006,059 |
| Henan | 109352000 | 8.19 | 100,396,071 |
| Hubei | 43034000 | 6.58 | 40,202,363 |
| Hunan | 37186000 | 7.47 | 34,408,206 |
| Chongqing | 16520000 | 11.06 | 14,692,888 |
| Sichuan | 34627000 | 9.41 | 31,368,599 |
| Total | | | 249,074,186 |

Sources: China Electric Power Yearbook 2005

Table B2. Electricity Generation of Central China Power Grid in 2005

| | Electricity generation of fuel-fired power plants (MWh) | Auxiliary power ratio (%) | Total Electricity Supplied to the Grid (MWh) |
|--|---|---------------------------|--|
| | | | |



| | | | |
|--------------|-----------|------|-------------|
| Jiangxi | 30000000 | 6.48 | 28,056,000 |
| Henan | 131590000 | 7.32 | 121,957,612 |
| Hubei | 47700000 | 2.51 | 46,502,730 |
| Hunan | 39900000 | 5 | 37,905,000 |
| Chongqing | 17584000 | 8.05 | 16,168,488 |
| Sichuan | 37202000 | 4.27 | 35,613,475 |
| Total | | | 286,203,305 |

Sources: China Electric Power Yearbook 2006

Table B3. Electricity Generation of Central China Power Grid in 2006

| | Electricity generation of fuel-fired power plants (MWh) | Auxiliary power ratio (%) | Total Electricity Supplied to the Grid (MWh) |
|--------------|--|--------------------------------------|---|
| Jiangxi | 34449000 | 6.17 | 32,323,497 |
| Henan | 151235000 | 7.06 | 140,557,809 |
| Hubei | 54841000 | 2.75 | 53,332,873 |
| Hunan | 46408000 | 4.95 | 44,110,804 |
| Chongqing | 23487000 | 8.45 | 21,502,349 |
| Sichuan | 44193000 | 4.51 | 42,199,896 |
| Total | | | 334,027,226 |

Sources: China Electric Power Yearbook 2007; China Energy Statistical Yearbook 2007



Table B4. Calculation of Operating Margin Emission Factor of Central China Power Grid in 2004

| Fuel | Unit | Jiangxi A | Henan B | Hubei C | Hunan D | Chongqing E | Sichuan F | Total G=A+ ... +F | Emission Factor ¹ (tC/TJ) H | Oxidation ² (%) I | Average Low Caloric Value ³ (MJ/t or km ³) J | CO ₂ Emission (tCO ₂ e) K=G*H*I*F*44/12/1000 (mass) K=G*H*I*F*44/12/1000 (Volume) |
|---|--------------------------------|--------------|------------|------------|------------|----------------|--------------|----------------------|--|---------------------------------|---|--|
| Raw Coal | 10 ⁴ t | 1863.8 | 6948.5 | 2510.5 | 2197.9 | 875.5 | 2747.9 | 17144.1 | 25.8 | 100 | 20908 | 339,092,605 |
| Cleaned coal | 10 ⁴ t | | 2.34 | | | | | 2.34 | 25.8 | 100 | 26344 | 58,316 |
| Other Washed Coal | 10 ⁴ t | 48.93 | 104.22 | | | 89.72 | | 242.87 | 25.8 | 100 | 8363 | 1,921,441 |
| Coke | 10 ⁴ t | | 109.61 | | | | | 109.61 | 29.2 | 100 | 28435 | 3,337,011 |
| Coke Oven Gas | 10 ⁸ m ³ | | | 1.68 | | 0.34 | | 2.02 | 12.1 | 100 | 16726 | 149,900 |
| Other Gas | 10 ⁸ m ³ | | | | | 2.61 | | 2.61 | 12.1 | 100 | 5227 | 60,527 |
| Crude Oil | 10 ⁴ t | | 0.86 | 0.22 | | | | 1.08 | 20 | 100 | 41816 | 33,118 |
| Gasoline | 10 ⁴ t | | 0.06 | | | 0.01 | | 0.07 | 18.9 | 100 | 43070 | 2,089 |
| Diesel Oil | 10 ⁴ t | 0.02 | 3.86 | 1.7 | 1.72 | 1.14 | | 8.44 | 20.2 | 100 | 42652 | 266,627 |
| Fuel Oil | 10 ⁴ t | 1.09 | 0.19 | 9.55 | 1.38 | 0.48 | 1.68 | 14.37 | 21.1 | 100 | 41816 | 464,893 |
| PLG | 10 ⁴ t | | | | | | | 0 | 17.2 | 100 | 50179 | 0 |
| Refinery Gas | 10 ⁴ t | 3.52 | 2.27 | | | | | 5.79 | 15.7 | 100 | 46055 | 153,506 |
| Natural Gas | 10 ⁸ m ³ | | | | | | 2.27 | 2.27 | 15.3 | 100 | 38931 | 495,775 |
| Other Petroleum Products | 10 ⁴ t | | | | | | | 0 | 20 | 100 | 38369 | 0 |
| Other Coking Products | 10 ⁴ t | | | | | | | 0 | 25.8 | 100 | 28435 | 0 |
| Other Energy | 10 ⁴ tce | | 16.92 | | 15.2 | 20.95 | | 53.07 | 0 | 100 | 0 | 0 |
| | | | | | | | | | Total CO ₂ Emission: 346,035,810 | | | |
| Total emission of the Central China Power Grid(tCO ₂ e) | | | | | | | | | 346,035,810 | | | |
| Fossil power supply of the Central China Power Grid(MWh) | | | | | | | | | 249,074,186 | | | |
| OM emission factor of the East China Power Grid(tCO ₂ e/MWh) | | | | | | | | | 1.38929 | | | |

Sources: China Energy Statistical Yearbook 2005

2006 IPCC Guidelines for National Greenhouse Gas Inventories, Volume 2 Energy, chapter 1, page 1.21-1.24, table 1.3 and 1.4.



China Energy Statistical Yearbook 2007, Page 287

Table B5. Calculation of Operating Margin Emission Factor of Central China Power Grid in 2005

| Fuel | Unit | Jiangxi A | Henan B | Hubei C | Hunan D | Chongqing E | Sichuan F | Total G=A+ ... +F | Emission Factor ¹ (tC/TJ) H | Oxidation ² (%) I | Average Low Caloric Value ³ (MJ/t or km ³) J | CO ₂ Emission (tCO ₂ e) K=G*H*I*F*44/12/1000 (mass) K=G*H*I*F*44/12/1000 (Volume) |
|---|--------------------------------|--------------|------------|------------|------------|----------------|--------------|----------------------|--|---------------------------------|---|--|
| Raw Coal | 10 ⁴ t | 1869.29 | 7638.87 | 2732.15 | 1712.27 | 875.4 | 2999.77 | 17827.75 | 25.8 | 100 | 20908 | 352,614,497 |
| Cleaned coal | 10 ⁴ t | 0.02 | | | | | | 0.02 | 25.8 | 100 | 26344 | 498 |
| Other Washed Coal | 10 ⁴ t | | 138.12 | | | 89.99 | | 228.11 | 25.8 | 100 | 8363 | 1,804,669 |
| Coke | 10 ⁴ t | | 25.95 | | 105 | | | 130.95 | 29.2 | 100 | 28435 | 3,986,695 |
| Coke Oven Gas | 10 ⁸ m ³ | | | 1.15 | | 0.36 | | 1.51 | 12.1 | 100 | 16726 | 112,054 |
| Other Gas | 10 ⁸ m ³ | | 10.2 | | | 3.12 | | 13.32 | 12.1 | 100 | 5227 | 308,897 |
| Crude Oil | 10 ⁴ t | | 0.82 | 0.36 | | | | 1.18 | 20 | 100 | 41816 | 36,185 |
| Gasoline | 10 ⁴ t | | 0.02 | | | 0.02 | | 0.04 | 18.9 | 100 | 43070 | 1,194 |
| Diesel Oil | 10 ⁴ t | 1.3 | 3.03 | 2.39 | 1.39 | 1.38 | | 9.49 | 20.2 | 100 | 42652 | 299,798 |
| Fuel Oil | 10 ⁴ t | 0.64 | 0.29 | 3.15 | 1.68 | 0.89 | 2.22 | 8.87 | 21.1 | 100 | 41816 | 286,959 |
| PLG | 10 ⁴ t | | | | | | | 0 | 17.2 | 100 | 50179 | 0 |
| Refinery Gas | 10 ⁴ t | 0.71 | 3.41 | 1.76 | 0.78 | | | 6.66 | 15.7 | 100 | 46055 | 176,572 |
| Natural Gas | 10 ⁸ m ³ | | | | | | 3 | 3 | 15.3 | 100 | 38931 | 655,209 |
| Other Petroleum Products | 10 ⁴ t | | | | | | | 0 | 20 | 100 | 38369 | 0 |
| Other Coking Products | 10 ⁴ t | | | | 1.5 | | | 1.5 | 25.8 | 100 | 28435 | 40,349 |
| Other Energy | 10 ⁴ tce | | 2.88 | | 1.74 | 32.8 | | 37.42 | 0 | 100 | 0 | 0 |
| | | | | | | | | | Total CO ₂ Emission: 360,323,575 | | | |
| Total emission of the Central China Power Grid(tCO ₂ e) | | | | | | | | | 360,323,575 | | | |
| Fossil power supply of the Central China Power Grid(MWh) | | | | | | | | | 286,203,305 | | | |
| OM emission factor of the East China Power Grid(tCO ₂ e/MWh) | | | | | | | | | 1.25898 | | | |



Sources: China Electric Power Yearbook 2006

Table B6. Calculation of Operating Margin Emission Factor of Central China Power Grid in 2006

| Fuel | Unit | Jiangxi A | Henan B | Hubei C | Hunan D | Chongqing E | Sichuan F | Total G=A+ ... +F | Emission Factor ¹ (tC/TJ) H | Oxidation ² (%) I | Average Low Caloric Value ³ (MJ/t or km ³) J | CO ₂ Emission (tCO ₂ e) K=G*H*I*F*44/12/1000 (mass) K=G*H*I*F*44/12/1000 (Volume) |
|--------------------------|--------------------------------|--------------|------------|------------|------------|----------------|--------------|----------------------|--|---------------------------------|---|--|
| Raw Coal | 10 ⁴ t | 1926.02 | 8098.01 | 3179.79 | 2454.48 | 1184.3 | 3285.22 | 20127.82 | 25.8 | 100 | 20908 | 398,107,508 |
| Cleaned coal | 10 ⁴ t | | | | | 5.79 | | 5.79 | 25.8 | 100 | 26344 | 144,295 |
| Other Washed Coal | 10 ⁴ t | 4.51 | 104.12 | | 8.59 | 79.21 | | 196.43 | 25.8 | 100 | 8363 | 1,554,036 |
| Briquette | | | | | | | 0.01 | 0.01 | 26.6 | 100 | 20908 | 204 |
| Coke | 10 ⁴ t | | 17.23 | | 0.32 | | | 17.55 | 29.2 | 100 | 28435 | 534,299 |
| Coke Oven Gas | 10 ⁸ m ³ | | 0.52 | 1.07 | 4.24 | 0.38 | 0.01 | 6.22 | 12.1 | 100 | 16726 | 461,572 |
| Other Gas | 10 ⁸ m ³ | 12.69 | 3.95 | | 1.7 | 4.36 | 0.01 | 22.71 | 12.1 | 100 | 5227 | 526,655 |
| Crude Oil | 10 ⁴ t | | 0.49 | | | | | 0.49 | 20 | 100 | 41816 | 15,026 |
| Gasoline | 10 ⁴ t | | 0.01 | | | | | 0.01 | 18.9 | 100 | 43070 | 298 |
| Diesel Oil | 10 ⁴ t | 0.91 | 2.23 | 1.41 | 1.78 | 0.96 | | 7.29 | 20.2 | 100 | 42652 | 230,298 |
| Fuel Oil | 10 ⁴ t | 0.51 | 1.26 | 1.31 | 0.8 | 0.57 | 3.49 | 7.94 | 21.1 | 100 | 41816 | 256,872 |
| PLG | 10 ⁴ t | | | | | | | 0 | 17.2 | 100 | 50179 | 0 |
| Refinery Gas | 10 ⁴ t | 0.86 | 8.1 | 1 | 0.97 | | | 10.93 | 15.7 | 100 | 46055 | 289,780 |
| Natural Gas | 10 ⁸ m ³ | | | 0.28 | | 0.16 | 18.63 | 19.07 | 15.3 | 100 | 38931 | 4,164,943 |
| Other Petroleum Products | 10 ⁴ t | | | | | | | 0 | 20 | 100 | 38369 | 0 |
| Other Coking Products | 10 ⁴ t | | | | | | 0.01 | 0.01 | 25.8 | 100 | 28435 | 269 |
| Other Energy | 10 ⁴ tce | 17.45 | 37.36 | 31.55 | 18.29 | 29.35 | | 134 | 0 | 100 | 0 | 0 |
| | | | | | | | | | Total CO ₂ Emission: 406,286,055 | | | |



| | |
|--|--------------------|
| Net electricity imported from Northwest China Grid (MWh) | 3,028,950 |
| The average emission factor of Northwest China Power Grid in 2006(tCO₂e/MWh) | 0.82214 |
| Total emission of the Central China Power Grid(tCO₂e) | 408,776,270 |
| Fossil power supply of the Central China Power Grid(MWh) | 337,056,176 |
| OM emission factor of the East China Power Grid(tCO₂e/MWh) | 1.212784 |

Sources: China Electric Power Yearbook 2007; China Energy Statistic Yearbook 2007



Table B7. Weighted-average OM emission factor of Central China Power Grid (2004-2006)

| | 2004 | 2005 | 2006 | Weighted-average OM emission factor |
|---|-------------|-------------|-------------|-------------------------------------|
| Total Emission, tCO ₂ | 346,035,810 | 360,323,575 | 408,776,270 | |
| Total power supply, MWh | 249,074,186 | 286,203,305 | 337,056,176 | |
| OM emission factor, tCO ₂ /MWh | 1.38929 | 1.25898 | 1.212784 | 1.27834 |

Therefore, the $EF_{grid,OM,simple}$ could be calculated as:

$$EF_{grid,OM,simple} = (346,035,810 + 360,323,575 + 408,776,270) / (249,074,186 + 286,203,305 + 337,056,176) = \mathbf{1.27834} \text{ tCO}_2\text{e/MWh}$$

C. Calculation of the Build Margin Emission Factor ($EF_{grid,BM,y}$)

Table C1 Emission Factor of Best Technology

| | Variable | Electricity supply efficiency | Emission factor of fuel (tC/TJ) | Oxidation rate | Emission factor (tCO ₂ /MWh) |
|-------------------------|-----------------|-------------------------------|---------------------------------|----------------|---|
| | | A | B | C | D=3.6/A/1000*B*C*44/12 |
| Coal-based power plants | $EF_{Coal,Adv}$ | 37.28% | 25.8 | 1 | 0.9135 |
| Gas-based power plants | $EF_{Gas,Adv}$ | 48.81% | 15.3 | 1 | 0.4138 |
| Oil-based power plants | $EF_{Oil,Adv}$ | 48.81% | 21.1 | 1 | 0.5706 |

Sources: China's grid baseline BM calculation progress, NRDC

Table C2 The Proportion Of CO₂ Emission From Solid、Liquid、Gas Fuel For Generating Electricity

| Fuel | Unit | Jiangxi | Henan | Hubei | Hunan | Chongqing | Sichuan | Total | Caloric | Emission | Oxidatio | Emis |
|-----------------|--------------------------------|---------|---------|---------|---------|-----------|---------|-----------|-----------|----------|----------|---------------------|
| | | A | B | C | D | E | F | G=A+...+F | H (KJ/kg) | I | J | K=F*G*H*I*44/12/100 |
| Raw Coal | 10 ⁴ t | 1926.02 | 8098.01 | 3179.79 | 2454.48 | 1184.3 | 3285.22 | 20127.82 | 20908 | 25.8 | 1 | 398,107,508 |
| Cleaned Coal | 10 ⁴ t | 0 | 0 | 0 | 0 | 5.79 | 0 | 5.79 | 26344 | 25.8 | 1 | 144,295 |
| Other Washed | 10 ⁴ t | 4.51 | 104.12 | 0 | 8.59 | 79.21 | 0 | 196.43 | 8363 | 25.8 | 1 | 1,554,036 |
| Briquette | 10 ⁴ t | 0 | 0 | 0 | 0 | 0 | 0.01 | 0.01 | 20908 | 26.6 | 1 | 204 |
| Coke | 10 ⁴ t | 0 | 17.23 | 0 | 0.32 | 0 | 0 | 17.55 | 28435 | 29.2 | 1 | 534,299 |
| Subtotal | | | | | | | | | | | | 400,340,342 |
| Crude Oil | 10 ⁴ t | 0 | 0.49 | 0 | 0 | 0 | 0 | 0.49 | 41816 | 20 | 1 | 15,026 |
| Gasoline | 10 ⁴ t | 0 | 0.01 | 0 | 0 | 0 | 0 | 0.01 | 43070 | 18.9 | 1 | 298 |
| Kerosene | 10 ⁴ t | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 43070 | 19.6 | 1 | 0 |
| Diesel Oil | 10 ⁴ t | 0.91 | 2.23 | 1.41 | 1.78 | 0.96 | 0 | 7.29 | 42652 | 20.2 | 1 | 230,298 |
| Fuel Oil | 10 ⁴ t | 0.51 | 1.26 | 1.31 | 0.8 | 0.57 | 3.49 | 7.94 | 41816 | 21.1 | 1 | 256,872 |
| Other Petroleum | 10 ⁴ t | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 38369 | 20 | 1 | 0 |
| Other Coking | 10 ⁴ t | 0 | 0 | 0 | 0 | 0 | 0.01 | 0.01 | 28435 | 25.8 | 1 | 269 |
| Subtotal | | | | | | | | | | | | 502,763 |
| Natural Gas | 10 ⁷ m ³ | 0 | 0 | 2.8 | 0 | 1.6 | 186.3 | 190.7 | 38931 | 15.3 | 1 | 4,164,943 |
| Coke Oven Gas | 10 ⁷ m ³ | 0 | 5.2 | 10.7 | 42.4 | 3.8 | 0.1 | 62.2 | 16726 | 12.1 | 1 | 461,572 |
| Other Gas | 10 ⁷ m ³ | 126.9 | 39.5 | 0 | 17 | 43.6 | 0.1 | 227.1 | 5227 | 12.1 | 1 | 526,655 |
| PLG | 10 ⁴ t | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 50179 | 17.2 | 1 | 0 |
| Refinery Gas | 10 ⁴ t | 0.86 | 8.1 | 1 | 0.97 | 0 | 0 | 10.93 | 46055 | 15.7 | 1 | 289,780 |
| Subtotal | | | | | | | | | | | | 5,442,950 |
| Total | | | | | | | | | | | | 406,286,055 |

Sources: China Energy Statistical Yearbook 2007



CDM – Executive Board

page 103

Calculate with relevant data and formulae, the value for λ_{Coal} is 98.54% the value for λ_{Oil} is 0.12% and the value for λ_{Gas} is 1.34%.

Therefore,

$$EF_{Thermal} = \lambda_{Coal} \times EF_{Coal,Adv} + \lambda_{Oil} \times EF_{Oil,Adv} + \lambda_{Gas} \times EF_{Gas,Adv} = 0.9064 \text{ tCO}_2\text{e/MWh.}$$

Table C3 Installed capacity of the Central China Power Grid in 2006

| Installed Capacity | Unit | Jiangxi | Henan | Hubei | Hunan | Chongqing | Sichuan | Total |
|--------------------|------|---------|-------|-------|-------|-----------|---------|--------|
| Fuel-fired | MW | 6568 | 32603 | 11623 | 10715 | 5594 | 9555 | 76658 |
| Hydro | MW | 3288 | 2553 | 8521 | 8648 | 1979 | 17730 | 42719 |
| Nuclear | MW | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Wind & Others | MW | 0 | 0 | 0 | 17 | 24 | 0 | 41 |
| Total | MW | 9856 | 35156 | 20144 | 19380 | 7597 | 27285 | 119418 |

Sources: China Electric Power Yearbook 2007

Table C4 Installed capacity of the Central China Power Grid in 2005

| Installed Capacity | Unit | Jiangxi | Henan | Hubei | Hunan | Chongqing | Sichuan | Total |
|--------------------|------|---------|---------|---------|---------|-----------|---------|---------|
| Fuel-fired | MW | 5906 | 26267.8 | 9526.3 | 7211.6 | 3759.5 | 7496 | 60167.2 |
| Hydro | MW | 3019 | 2539.9 | 8088.9 | 7905.1 | 1892.7 | 14959.6 | 38405.2 |
| Nuclear | MW | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Wind & Others | MW | 0 | 0 | 0 | 0 | 24 | 0 | 24 |
| Total | MW | 8925 | 28807.7 | 17615.2 | 15116.7 | 5676.2 | 22455.6 | 98596.4 |

Sources: China Electric Power Yearbook 2006

Table C5 Installed capacity of the Central China Power Grid in 2004

| Installed Capacity | Unit | Jiangxi | Henan | Hubei | Hunan | Chongqing | Sichuan | Total |
|--------------------|------|---------|---------|---------|---------|-----------|---------|---------|
| Fuel-fired | MW | 5496 | 21788.5 | 9590.3 | 6779.5 | 3271.1 | 6900.3 | 53825.7 |
| Hydro | MW | 2549.9 | 2438 | 7415.1 | 7448.2 | 1407.9 | 13382.9 | 34642 |
| Nuclear | MW | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Wind & Others | MW | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Total | MW | 8045.9 | 24226.5 | 17005.4 | 14227.7 | 4679 | 20283.2 | 88467.7 |

Sources: China Electric Power Yearbook 2005

Table C6. Calculation of BM Emission Factor of Central China Power Grid (2004-2006), MW



| | New Capacity 2004 | New Capacity 2005 | New Capacity 2006 | New Capacity 2005-2006 | Percentage of New Capacity Additions |
|----------------------------|----------------------|----------------------|----------------------|---------------------------|--|
| | A | B | C | D=C-A | |
| Fuel-fired (MW) | 53825.7 | 60167.2 | 76658 | 22832.3 | 73.77% |
| Hydro (MW) | 34642 | 38405.2 | 42719 | 8077 | 26.10% |
| Nuclear (MW) | 0 | 0 | 0 | 0 | 0.00% |
| Wind(MW) | 0 | 24 | 41 | 41 | 0.13% |
| Total | 88467.7 | 98596.4 | 119483 | 30950.3 | 100.00% |
| Percentage of Year 2006 | 74.08% | 82.56% | 100% | | |

$$EF_{grid,BM,y} = \frac{CAP_{Thermal}}{CAP_{Total}} \times EF_{Thermal} = 0.9064 \times 73.77\% = 0.6687 \text{ tCO}_2/\text{MWh}$$

D. Calculation of the Baseline Emission Factor ($EF_{grid,CM,y}$)

$$EF_{grid,CM,y} = 0.5 \times EF_{grid,OM,y} + 0.5 \times EF_{grid,BM,y} = 0.5 \times 1.2783 + 0.5 \times 0.6687 = 0.9735 \text{ tCO}_2/\text{MWh}$$



page 105

Annex 4

MONITORING INFORMATION

No Supplement Information.