



**MONITORING REPORT FORM (F-CDM-MR)**  
**Version 02.0**

**MONITORING REPORT**

<b>Title of the project activity</b>	Wanzai Kaidi Biomass Power Project
<b>Reference number of the project activity</b>	3071
<b>Version number of the monitoring report</b>	1.0
<b>Completion date of the monitoring report</b>	21/04/2012
<b>Registration date of the project activity</b>	13/01/2011
<b>Monitoring period number and duration of this monitoring period</b>	The 1st monitoring period, from 13/01/2011 to 31/12/2011
<b>Project participant(s)</b>	<b>United Kingdom of Great Britain and Northern Ireland</b> , involved indirectly authorized Participants: Camco International Limited, Camco Carbon Limited <b>Switzerland</b> , involved indirectly authorized Participants: Camco International Limited <b>project owner</b> , Wanzai Kaidi Green Energy Development Co., Ltd
<b>Host Party(ies)</b>	China
<b>Sectoral scope(s) and applied methodology(ies)</b>	Energy industries (renewable - / non-renewable sources) ACM0006 (Version 09) – “Consolidated methodology electricity generation from biomass residues” “Combined tool to identify the baseline scenario and demonstrate additionality”. (Version 02.2) ACM0002 (Version 10) – “Consolidated baseline methodology for grid-connected electricity generation from renewable sources” “Tool to calculate project or leakage CO <sub>2</sub> emissions from fossil fuel combustion” (Version 02) “Tool to calculate baseline, project and/or leakage emissions from electricity consumption” (Version 01) “Tool to calculate the emission factor for an electricity system” (Version 02)
<b>Estimated amount of GHG emission reductions or net anthropogenic GHG removals by sinks for this monitoring period in the registered PDD</b>	111,954 tonnes CO <sub>2</sub> e
<b>Actual GHG emission reductions or net anthropogenic GHG removals by sinks achieved in this monitoring period</b>	69,829 tonnes CO <sub>2</sub> e

**SECTION A. Description of project activity****A.1. Purpose and general description of project activity**

&gt;&gt;

Wanzai Kaidi Biomass Power Project (hereafter referred to as the project) is a biomass utilization project developed by Wanzai Kaidi Green Energy Development Co., Ltd. (hereafter referred to as the Project Owner) and is located in Wanzai Industrial park, Wanzai County, Jiangxi Province, P.R. China. The project is designed to produce 126,720MWh of electricity per year from burning biomass residues, displacing electricity generated by Central China Power Grid (CCPG), which is dominated by fossil fuel-fired power plants, and thus reducing greenhouse gas (CO<sub>2</sub>) emissions.

The project processes biomass residue, of which rice husk, branches, barks and saw dust are the biomass fuel. 2 sets of 65t/h Circulating Fluidized Bed (CFB) boiler and 2 sets of 12MW steam turbines generator units are installed. Therefore, the total installed capacity of the Project is 24MW, and is estimated to achieve 115,760 tonnes of CO<sub>2</sub>e emissions reduction annually.

The project began to construct on March 2009, and was put into operation since 05/07/2010. The project has been registered as a CDM project on 13/01/2011 (The version of registered PDD is version 4).

During current monitoring period (13/01/2011-31/12/2011), the project has achieved emission reductions of 69,829tonnes CO<sub>2</sub>e.

**A.2. Location of project activity**


&gt;&gt;

The proposed project activity is located in the Industrial Area, Wanzai County, Jiangxi Province.

The center of plant has geographical coordinates of 114°29'18" east longitude 28°7'37" north latitude.

Please refer to the following drawing for the geographic location of the project activity.

**Figure 1: Map showing the location of the project site**

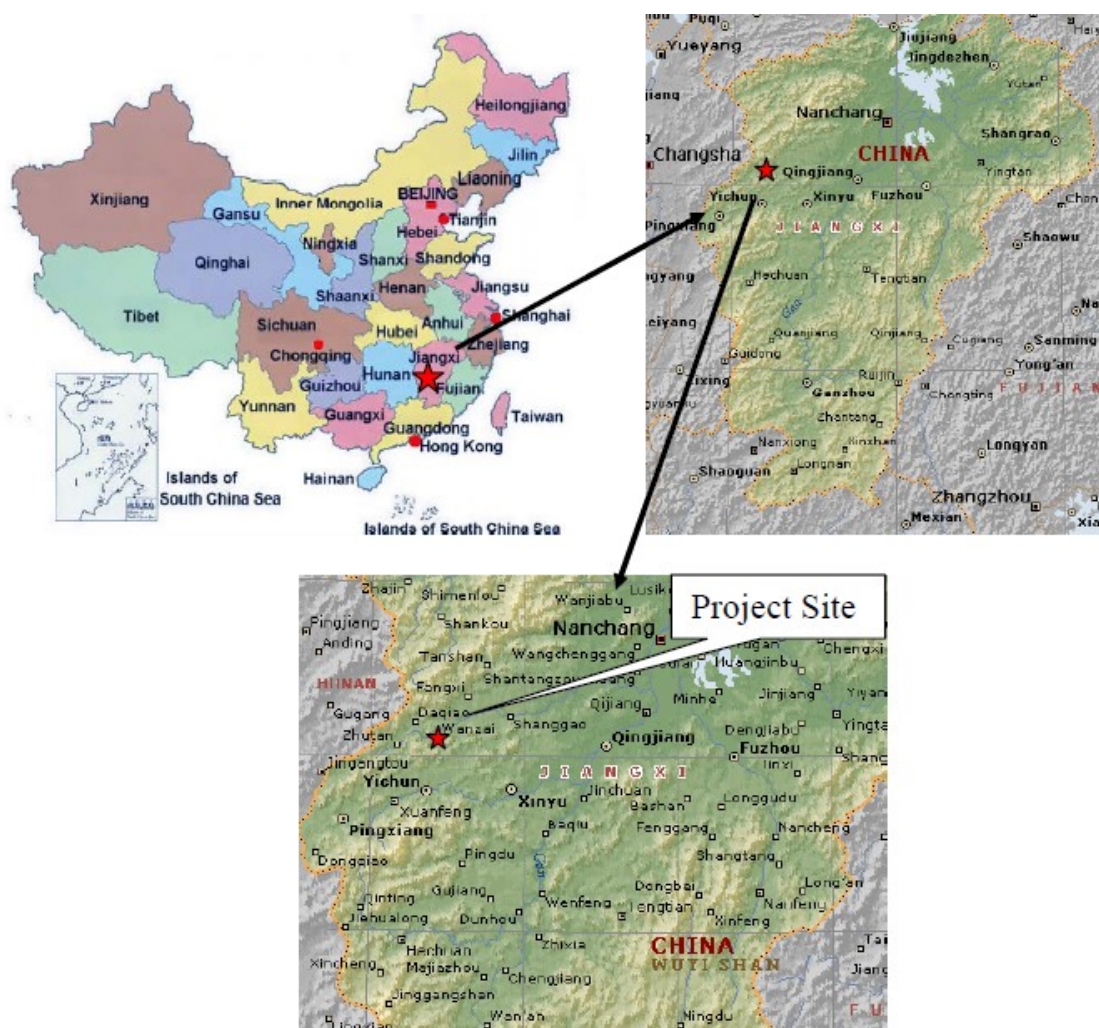

### A.3. Parties and project participant(s)

Party involved (host) indicates a host Party)	Private and/or public entity(ies) project participants (as applicable)	Indicate if the Party involved wishes to be considered as project participant (Yes/No)
Peoples' Republic of China (host)	Wanzai Kaidi Green Energy Development Co., Ltd	No
United Kingdom of Great Britain and Northern Ireland	Camco International Limited	No
United Kingdom of Great Britain and Northern Ireland	Camco Carbon Limited	No
Switzerland	Camco International Limited	No

### A.4. Reference of applied methodology

&gt;&gt;

1. ACM0006 (Version 09) – “Consolidated methodology electricity generation from biomass residues”
2. “Combined tool to identify the baseline scenario and demonstrate additionality”. (Version 02.2)

3. ACM0002 (Version 10) – “Consolidated baseline methodology for grid-connected electricity generation from renewable sources”
4. “Tool to calculate project or leakage CO<sub>2</sub> emissions from fossil fuel combustion” (Version 02)
5. “Tool to calculate baseline, project and/or leakage emissions from electricity consumption” (Version 01)
6. “Tool to calculate the emission factor for an electricity system” (Version 02)

For more information regarding the methodology, please refer to the link:

<http://cdm.unfccc.int/methodologies/PAmethodologies/approved.html>

#### A.5. Crediting period of project activity

>>

Crediting period: 13/01/2011 – 12/01/2018(Renewable)

The start date of the crediting period is 13/01/2011.

This monitoring period: 13/01/2011 – 31/12/2011

#### SECTION B. Implementation of project activity

##### B.1. Description of implemented registered project activity

>>

The project consists of one site, which began to construct on March 2009, and put into operation since 05/07/2010. Please refer to the following table for details.

Activity	Date	
	1# Generator	2# Generator
Start of construction	03/2009	
Commissioning of core equipment	01/07/2009	01/12/2011
Operation of core equipment	05/07/2010	05/12/2011

During current period, the project has been operating normally as described in the registered PDD. 1# steam turbine generator and 2# steam turbine generator were respectively shutdown 17 times and 1 time from 13/01/2011 to 31/12/2011.

No events or situations, which may impact the applicability of the methodology, occurred during the current monitoring period.

The technology employed by the project is advanced domestic technology. The project installed two sets of 65t/h circulating fluid bed (CFB) boilers with medium temperature and sub-high pressure. At the same time, two 12MW steam turbines and two associated generators are applied in the project. The steam turbine employed is medium temperature and sub-high pressure extraction condensing steam turbine. The total installed capacity of the project is 24MW.

The key technical specifications of the boiler, turbine and generator are listed in the table below.

Boiler	
Manufacturer	Jiangxi Jianglian Energy and Environmental Protection Co., Ltd
Model	KG65-450/5.29-FSWZ- I
Type	Medium temperature and sub-high pressure Circulating Fluidized Bed
Maximum evaporation volume	65t/h
Rated steam pressure	5.29MPa
Rated steam temperature	450°C
Feed water temperature	153.2°C
Feed water pressure	5.72MPa




Efficiency	≥86 %
Quantity	2
STEAM TURBINE	
Manufacturer	NanJing Steam Turbine(Group) Co., Ltd
Model	C12-4.90/0.981-12/435
Type	Medium temperature and sub-high pressure extraction condensing steam turbine
Rated power	12MW
Main steam pressure	4.9MPa
Main steam temperature	435°C
Rate extraction steam volume	15t/h
Maximum Extraction steam volume when Rate electricity capacity is 6.59MW	45t/h
Quantity	2
GENERATOR	
Manufacturer	NanJing Steam Turbine(Group) Co.,
Model	QFJ-15-2
Rated power	15MW <sup>1</sup>
Rated voltage	10.5KV
Power factor	0.8
Efficiency	≥97%
Rated rotating speed	3000r/min
Rated frequency	50Hz
Quantity	2

The electricity generated is transmitted through an 110kV cable to Wanzai 220kV substation and then supplied to the Central China Power Grid (CCPG) indirectly. The proposed project will therefore replace the equivalent capacity of power plants on the CCPG, which is predominantly made up of coal fired power plants. The heat generated will be supplied to the plants in the Wanzai Industrial Park to meet the process heat demand and replace the heat generated by the small coal-fired boilers within the independent industries.

The Flow Diagram of the Plant as follows:

<sup>1</sup> The generator is sized at 15MW and not 12MW to allow for possible peak generation and to avoid damage to the generation unit by sudden load change in abnormal situations.

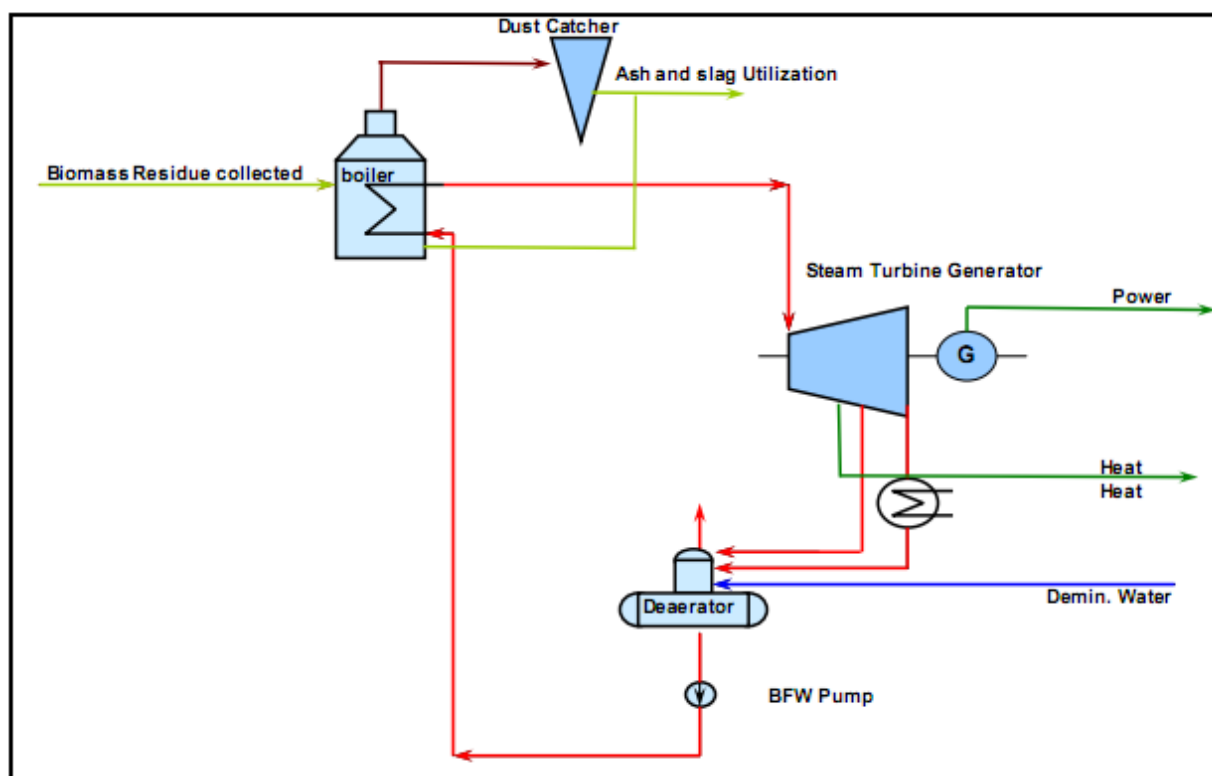**B.2. Post registration changes****B.2.1. Temporary deviations from registered monitoring plan or applied methodology**

&gt;&gt;

N/A

**B.2.2. Corrections**

&gt;&gt;

N/A

**B.2.3. Permanent changes from registered monitoring plan or applied methodology**

&gt;&gt;

N/A

**B.2.4. Changes to project design of registered project activity**

&gt;&gt;

N/A

**B.2.5. Changes to start date of crediting period**

&gt;&gt;

N/A

**B.2.6. Types of changes specific to afforestation or reforestation project activity**

&gt;&gt;

N/A


**SECTION C. Description of monitoring system**

&gt;&gt;

## 1. The organizational structure, roles and responsibilities of personnel:

In order to ensure monitoring of the project is in accordance with the monitoring plan and methodology, a specific CDM office had been established before the registration of the project. Figure 2 shows the organizational structure of the CDM office.

**Figure 2 Organizational structure of the CDM office**

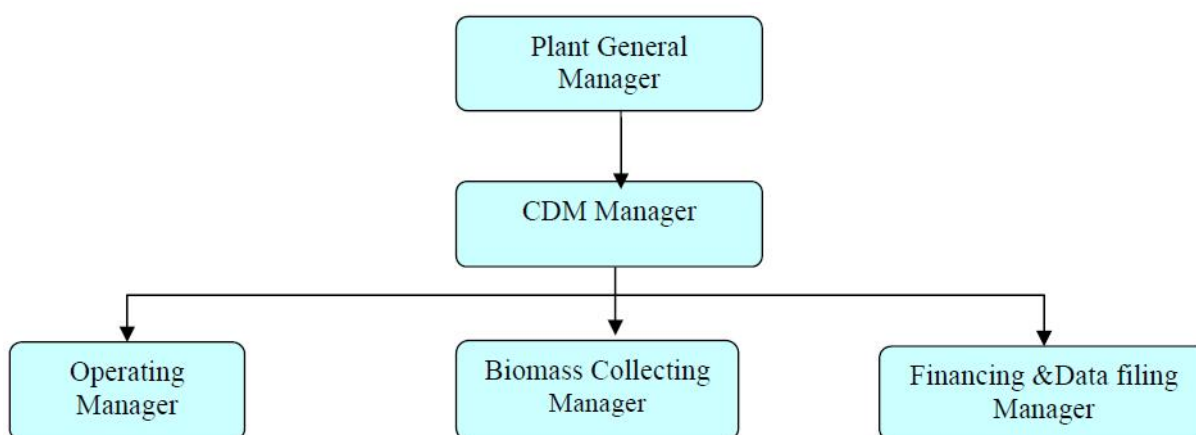

The responsibilities of the sections are briefly described as following:

The plant manager is in charge of approving the monitoring report, appointing the CDM manager and the relevant monitoring team members and responsible for the monitoring outcome.

The CDM manager is responsible for liaising with DOE and the buyers, organizing the relevant training, reviewing all the documents related with the monitoring of the project, correcting any errors in time and acting as the quality supervisor of the monitoring process.

The Operating Manager is responsible for the monitoring associated with operation of the plant, the net electricity generation, the start-up diesel consumption and the dry biomass combusted. In addition, the Operating Manager supervises meter maintenance and manages the calibration process.

The Biomass Collecting Manager is responsible for the monitoring associated with biomass collection, the transportation emission, the mechanical biomass pre-treatment emissions and assisting the annual leakage analysis.

The Financing & Data filing Manager prepares the available original invoices or receipts associated with the whole monitoring process. Besides, the Financing & Data filing Manager collects the relevant data from the Operating Manager and the Biomass Collecting Manager, summarize the data, file the data and submit reports to the CDM manager in time.

The monitoring report is generated based on the monthly reports before each verification. The monitoring report is reviewed by the office manager before submitted to DOE.

## 2. Monitoring system:

### 2.1 Net electricity generation

There is a gate way meter installed on the project site monitoring the electricity supplied to the grid and purchased from the grid. There is a back up meter installed at the project site monitoring the electricity supplied to the grid and purchased from the grid too.

In addition, a 10KV backup power supply is available in site in the early time of the project and the amount of electricity imported through this line is monitored and checked by the invoice if available.

The data of electricity supplied to the grid and purchased from the grid is measured and crosschecked by the invoices and the power transaction note if available.

### **2.2 Biomass residues consumption and moisture of the biomass residues**

The amount of biomass residues combusted in the boiler is monitored by the belt weigher. The moisture of the biomass residues combusted also is monitored by sampling continuously at fixed time period and analyzed daily. An energy balance is recorded monthly to assist verifying the biomass combusted

### **2.3 Fossil Fuel Consumption in the power plant**

For fossil fuel used for starting up, flow meters are equipped in the supply and return pipe to monitor the quantity of diesel consumption.

If there is any fossil fuel used for the shredders, forklifts or any other machines for the mechanical biomass pre-treatment in the project site (including the biomass collection sites) is monitored by the diesel purchase and consumption log book.

The purchase receipt is used for cross-check. If there is any data missing or significant error exists, the entire quantity of fossil fuel purchased in a particular monitoring period would be considered as combusted in the power plant for conservativeness.

### **2.4 Transportation of Biomass residues**

The project developer of the proposed project structures a recording and monitoring system within the biomass residues supply and management system covering all the biomass collection sites established by the project. Each time each truck transporting the biomass into the project site is counted and recorded in the log book. The transportation distance to the collection sites is recorded by company staffs at the sites and the data is recorded in the log books. The data on distance of fuel supply site from the plant can be verified by cross checking data records on the distances available with information from other sources (e.g. maps).

If data is missing for a particular round trip, the following backup data apply in their order:

- The round trip distance between the farthest biomass fuel supply site and the project plant is used.
- If the farthest biomass fuel supply site could not be verified, 200km would be used for conservativeness

### **2.5 Electricity consumed on site**

When the biomass residue is mechanically pre-treated, the proposed project needs a certain amount of electricity from grid. This amount is metered or calculated conservatively.

If the monitoring data is missing, or it is not feasible to install a dedicated meter to monitor this indicator, it is calculated conservatively as the weight of straws smashed in tons and the electricity consumption factor (kWh/ton). The electricity factor can be calculated as follows:

- 1) Collecting all the nameplates power (in kW) and capacity (t/h) of every straw crackers
- 2) Calculating the electricity factor corresponding to each cracker in kWh/t




- 3) Using the largest number as a conservative electricity factor for the calculation

## 2.6 Leakage

The project consumption and availabilities in the defined geographical area of each type of biomass residue not only the biomass types mentioned above but also other biomass residues utilized in the project is monitored to check the leakage effect brought by the operation of the proposed project. This is obtained from surveys or statistics from local agricultural bureau or other official public resource. If they are not available, the project owner will ask specialized institute or consulting company to do biomass availability research.

**Figure 3: The monitoring system and power system connection**

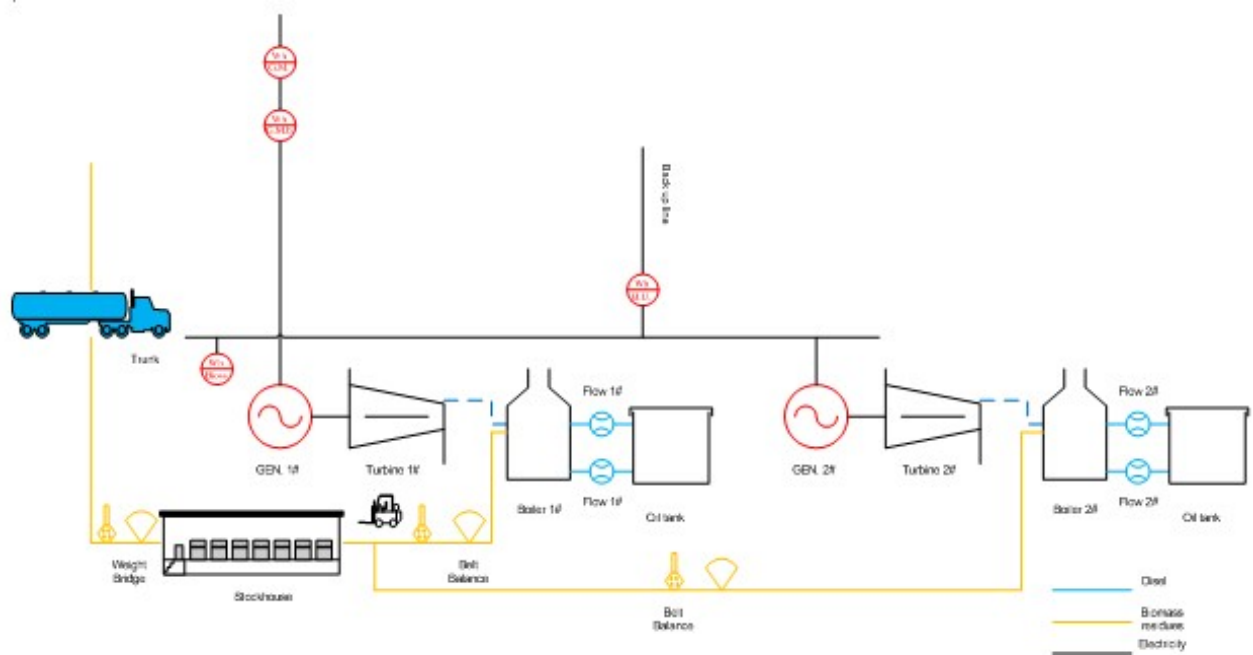

Wanzai Kaidi Biomass Power Plant

## 3. Data collection procedures

The meters or monitoring equipment installed in the monitoring system have been calibrated by a certified Party in accordance with the manufacturer's recommendations and National Regulations for ensuring reliability of the system. Calibrations shall be evidenced with certificates of calibration for the relevant meter(s) issued by a qualified body. A calibration and error log have been maintained to provide transparency and sound management.

All the electronic and paper documents relevant to CDM must be archived for more than two years since the end of the crediting period.

## 4. Emergency procedures for the monitoring system

### 4.1 Training

Members of staff who are involved in the CDM project are given training on the CDM and reporting requirements, prior to registration of the project. New members of staff joining the CDM project team

will also be given training in relation to their responsibilities. Full training procedures and a training plan are detailed in the CDM Manual.

#### 4.2 Record Keeping and Internal Reporting Procedure

The data associated with the emission reduction will be kept for at least 2 years after the end of the crediting period or the last issuance of CERs, whichever occurs later.

#### 4.3 Error Handling Procedure

In the event that a meter has lost calibration over the allowable error limit then this shall be corrected at the earliest opportunity and re-calibrated and the data recorded from this meter since the last successful calibration shall be ignored.

The check of the CDM Project manager and then the third party verifier prior to issuance of the CERs is considered adequate for errors in the calculations. Where errors in the calculations are discovered by either of these Parties, the monitoring report shall be modified and the corrected version shall be resubmitted to the verifier.

#### 4.4 External Reporting Procedure

After signing by the CDM Project manager, the report is sent to the third party verifier who is contracted to verify the emissions reductions during the crediting period of the project.

#### 4.5 Procedure for corrective actions arising

The CDM manager is responsible for identifying corrective actions arising from the above procedures and for liaising with the purchaser, the third party verifiers and other stakeholders to take necessary steps to implement the corrective actions.

#### 4.6 Emergency procedures

In the unlikely event of an emergency, set procedures will be followed. Details of the procedures to be followed are described in the relevant Operation Manuals. The key points include:

- The Distributed Control System (DCS) will automatically shut off the boilers upon detecting an emergency.
- The operators can also remotely shut off the boilers if they find an emergency situation has occurred.

### **SECTION D. Data and parameters**

#### **D.1. Data and parameters fixed ex ante or at renewal of crediting period**

<b>Data/Parameter</b>	EF <sub>y</sub>
<b>Unit</b>	t CO <sub>2</sub> e/MWh
<b>Description</b>	Baseline emission factor of Central China Power Grid
<b>Source of data</b>	The registered PDD Version 4
<b>Value(s) applied</b>	0.9735
<b>Purpose of data</b>	Baseline emission calculation
<b>Additional comment</b>	--



<b>Data/Parameter</b>	$GWP_{CH_4}$
<b>Unit</b>	t CO <sub>2</sub> e/t CH <sub>4</sub>
<b>Description</b>	Global warming potential for CH <sub>4</sub>
<b>Source of data</b>	The registered PDD Version 4
<b>Value(s) applied</b>	21
<b>Purpose of data</b>	Baseline emission calculation
<b>Additional comment</b>	--

<b>Data/Parameter</b>	$TDL_{j,y}$
<b>Unit</b>	%
<b>Description</b>	Average technical transmission and distribution losses for providing electricity to source j in year y.
<b>Source of data</b>	The registered PDD Version 4
<b>Value(s) applied</b>	20
<b>Purpose of data</b>	Project emission calculation
<b>Additional comment</b>	--

<b>Data/Parameter</b>	$EF_{CH_4,BF}$
<b>Unit</b>	t CH <sub>4</sub> /GJ
<b>Description</b>	CH <sub>4</sub> emission factor for controlled burning of the biomass residue in the project plant
<b>Source of data</b>	The registered PDD Version 4
<b>Value(s) applied</b>	41.1
<b>Purpose of data</b>	Project emission calculation
<b>Additional comment</b>	--

<b>Data/Parameter</b>	$NCV_k * EF_{burning,CH_4,k,y}$
<b>Unit</b>	t CH <sub>4</sub> /tonne
<b>Description</b>	CH <sub>4</sub> emission factor for uncontrolled burning of the biomass residue
<b>Source of data</b>	The registered PDD Version 4
<b>Value(s) applied</b>	0.001971
<b>Purpose of data</b>	Baseline emission calculation
<b>Additional comment</b>	--

**D.2. Data and parameters monitored**

Data/Parameter	BF <sub>k, y</sub>		
Unit	Tons of dry matter		
Description	Quantity of each biomass residue type k combusted in the project plant in year, y.		
Measured/Calculated /Default	Measured		
Source of data	On-site measurements		
Value(s) of monitored parameter	Type	Units	Data
	Rice husk	tonne	15881.60
	Branches	tonne	14788.41
	Barks	tonne	2592.65
	Scrap wood	tonne	7538.95
Monitoring equipment	Meter name	Belt balance 1#	Belt balance 2#
	Type/Model	ICS-ST4-1000	ICS-ST4-1000
	Accuracy	0.5%	0.5%
	SN	1003103	1003104
	Last calibration date	03-Jan-11	03-Jan-11
	Valid period	02-Jan-12	02-Jan-12
	Calibration Frequency	Once per year	Once per year
Measuring/Reading/ Recording frequency	Daily measurement and recording		
Calculation method (if applicable)	Use weigh meters, adjust for the moisture content in order to determine the quantity of dry biomass		
QA/QC procedures	The meter undergoes calibration/maintenance subject to appropriate industrial standards. Direct measurements at the plant site could be crosschecked with an annual energy balance that is based on purchased quantities and stock changes.		
Purpose of data	Baseline and project emissions		
Additional comment	-		



<b>Data/Parameter</b>	<i>Moisture content of the biomass residues</i>	
<b>Unit</b>	% water content	
<b>Description</b>	Moisture content of the biomass residues	
<b>Measured/Calculated/Default</b>	Measured	
<b>Source of data</b>	Measured by balance and dry cabinet	
<b>Value(s) of monitored parameter</b>	Please refer to the spread sheet	
<b>Monitoring equipment</b>	Meter name	Balance 1#
	Type/Model	YB2001
	Accuracy	1g
	SN	261
	Last calibration date	03-Jan-11
	valid Period	02-Jan-12
	Calibration frequency	Once per year
	Meter name	Dry cabinet 1#
	Type/Model	101-1B
	Accuracy	0.1 °C
	SN	0911028
	Last calibration date	03-Jan-11
	valid Period	02-Jan-12
	Calibration frequency	Once per year
<b>Measuring/Reading/Recording frequency</b>	Daily measurement and recording	
<b>Calculation method (if applicable)</b>	--	
<b>QA/QC procedures</b>	The monitoring procedures in the laboratory of the plant is done according to authoritative guidance	
<b>Purpose of data</b>	Baseline and project emissions	
<b>Additional comment</b>	--	



<b>Data/Parameter</b>	<i>NCV<sub>k</sub></i>			
<b>Unit</b>	GJ/ton of dry matter			
<b>Description</b>	Net calorific value of each biomass residue of type k			
<b>Measured/Calculated/Default</b>	Measured			
<b>Source of data</b>	Report from a reputed laboratory and according to relevant international standards.			
<b>Value(s) of monitored parameter</b>	Type	Units	Test Date	
			08/01/2011	06/07/2011
	Rice husk	MJ/Kg	12.91	13.55
	Branches	MJ/Kg	14.62	12.97
	Barks	MJ/Kg	12.33	13.12
	Scrap wood	MJ/Kg	10.74	10.36
<b>Monitoring equipment</b>	N/A			
<b>Measuring/Reading/Recording frequency</b>	Six months, taking three samples for each measurement.			
<b>Calculation method (if applicable)</b>	--			
<b>QA/QC procedures</b>	The consistency of the measurements is checked by comparing the measurement results with measurements from previous years, relevant data sources. If the measurement results differ significantly from previous measurements or other relevant data sources, Additional measurements are conducted.			
<b>Purpose of data</b>	Baseline emissions & project emission			
<b>Additional comment</b>	--			



<b>Data/Parameter</b>	$AVD_y$
<b>Unit</b>	km
<b>Description</b>	Average round trip distance (from and to) between the biomass fuel supply sites and the project plant during the year y
<b>Measured/Calculated /Default</b>	Measured
<b>Source of data</b>	On site records maintained in the log books
<b>Value(s) of monitored parameter</b>	44.5
<b>Monitoring equipment</b>	N/A
<b>Measuring/Reading/ Recording frequency</b>	Each time every truck which transports biomass residue to the plant is counted and recorded in the log books. Monitoring frequency: Every trip
<b>Calculation method (if applicable)</b>	Aggregated monthly and taken the average
<b>QA/QC procedures</b>	The data on distance of fuel supply site from the plant can be verified by cross checking data records on the distances available with information from other sources (e.g. maps). If data is missing for a particular round trip, the following backup data apply in their order: <ul style="list-style-type: none"> <li>➤ The round trip distance between the farthest biomass fuel supply site and the project plant will be used.</li> <li>➤ If the farthest biomass fuel supply site could not be verified, 200km would be used for conservativeness.</li> </ul>
<b>Purpose of data</b>	Project emission
<b>Additional comment</b>	--

<b>Data/Parameter</b>	$N_y$
<b>Unit</b>	--
<b>Description</b>	Number of truck trips for the transportation of biomass
<b>Measured/Calculated /Default</b>	Measured
<b>Source of data</b>	On site records maintained in the log books
<b>Value(s) of monitored parameter</b>	32,262
<b>Monitoring equipment</b>	N/A
<b>Measuring/Reading/ Recording frequency</b>	Each time every truck which transports biomass residue to the plant is counted and recorded in the log books. Monitoring frequency: Every trip
<b>Calculation method (if applicable)</b>	--
<b>QA/QC procedures</b>	The consistency of the number of truck trips could be checked with the quantity of biomass combusted by the relation with previous years
<b>Purpose of data</b>	Project emissions
<b>Additional comment</b>	--



<b>Data/Parameter</b>	$EF_{km,CO_2}$
<b>Unit</b>	tCO <sub>2</sub> e/km
<b>Description</b>	Average CO <sub>2</sub> Emission Factor for transportation of biomass with trucks during year y
<b>Measured/Calculated /Default</b>	Default
<b>Source of data</b>	IPCC default value
<b>Value(s) of monitored parameter</b>	0.001097 Revised 1996 IPCC Guidelines for National Greenhouse Gas Inventories ( Table 1-32 on Page 1.75) of the Reference Manual (Estimated Emission Factors for US Heavy Duty Diesel Vehicles )
<b>Monitoring equipment</b>	N/A
<b>Measuring/Reading/ Recording frequency</b>	Choose emission factors applicable for the truck types used from the literature in a conservative manner. The appropriateness of the data is reviewed annually
<b>Calculation method (if applicable)</b>	--
<b>QA/QC procedures</b>	--
<b>Purpose of data</b>	Project emission
<b>Additional comment</b>	--

<b>Data/Parameter</b>	$EF_{CO_2,I,y}$
<b>Unit</b>	kg CO <sub>2</sub> e/TJ
<b>Description</b>	CO <sub>2</sub> emission factor for fossil fuel type i (diesel)
<b>Measured/Calculated /Default</b>	Default
<b>Source of data</b>	IPCC default value
<b>Value(s) of monitored parameter</b>	74,100 IPCC 2006 default value (Volume2.Chapter2.P16) , diesel emission factor
<b>Monitoring equipment</b>	N/A
<b>Measuring/Reading/ Recording frequency</b>	The appropriateness of the data i reviewed annually
<b>Calculation method (if applicable)</b>	--
<b>QA/QC procedures</b>	The plant is designed to use diesel at this stage. Should any other fossil fuel be used during operation, the same monitoring procedures apply.
<b>Purpose of data</b>	Project emission
<b>Additional comment</b>	--





<b>Data/Parameter</b>	<i>NCV<sub>i</sub></i>
<b>Unit</b>	TJ/tonne
<b>Description</b>	Net Calorific Value( <i>NCV<sub>i</sub></i> ) of fossil fuel type i(diesel)
<b>Measured/Calculated /Default</b>	Default
<b>Source of data</b>	Reliable National Data
<b>Value(s) of monitored parameter</b>	0.042652 China Energy Statistical Yearbook 2010,Diesel NCV
<b>Monitoring equipment</b>	N/A
<b>Measuring/Reading/ Recording frequency</b>	The appropriateness of the data is reviewed annually
<b>Calculation method (if applicable)</b>	--
<b>QA/QC procedures</b>	The plant is designed to use diesel at this stage. Should any other fossil fuel be used during operation, the same monitoring procedures apply.
<b>Purpose of data</b>	Project emission
<b>Additional comment</b>	--



Data/Parameter	$FF_{project\ plant\ i,y}$		
Unit	tonne		
Description	Quantity of fossil fuel type $i$ (diesel) combusted in the project plant during year $y$		
Measured/Calculated /Default	Measured		
Source of data	Flow meters		
Value(s) of monitored parameter	18.02		
Monitoring equipment	Meter name	Flow meter 1#	Flow meter 2#
	Type/Model	LWY-10C	LWY-10C
	Accuracy	1.0%	1.0%
	SN	08026	08030
	Last calibration date	03-Jan-11	03-Jan-11
	valid Period	02-Jan-12	02-Jan-12
	Calibration frequency	Once per year	Once per year
Measuring/Reading/ Recording frequency	Read the fuel consumption data after boiler start-up every time and record accordingly. Monitoring frequency: continuously		
Calculation method (if applicable)	--		
QA/QC procedures	The meters undergo calibration/maintenance subject to appropriate industrial standards. The measurements could be cross-checked by the purchased quantities and stock changes if available.		
Purpose of data	Project emission		
Additional comment	--		



<b>Data/Parameter</b>	$FF_{project\ site, i, y}$
<b>Unit</b>	tonne
<b>Description</b>	Quantity of fossil fuel type $i$ combusted in the project site(including the collection sites) for other purposes that are attributable to the project activity during year $y$
<b>Measured/Calculated /Default</b>	Measured
<b>Source of data</b>	On site consumption records maintained in the log books
<b>Value(s) of monitored parameter</b>	110.94
<b>Monitoring equipment</b>	N/A
<b>Measuring/Reading/ Recording frequency</b>	Each time consumption of fossil fuel in the project is recorded on the log books. Monitoring frequency: continuously.
<b>Calculation method (if applicable)</b>	The consumption of diesel is monitored using diesel purchase and consumption log book.
<b>QA/QC procedures</b>	The data is cross checked by the purchase receipts.
<b>Purpose of data</b>	Project emission
<b>Additional comment</b>	--



Data/Parameter	EC <sub>PJ, y</sub>		
Unit	MWh		
Description	On-site electricity consumption(including the electricity consumption for the mechanical treatment of the biomass in the biomass collection sites and the project site) attributable to the project activity during the year y		
Measured/Calculated /Default	Measured		
Source of data	On-site measurements by meter or calculated conservatively as the weight of straws smashed in tons and the electricity consumption factor (kWh/ton)		
Value(s) of monitored parameter	256.35		
Monitoring equipment	Meter name	Meter 1#	Meter 2#
	Type/Model	PD866E-760	DTSDT9
	Accuracy	0.5%	0.5%
	SN	0907030220005	20101200006
	Last calibration date	03-Jan-11	03-Jan-11
	Valid Period	02-Jan-12	02-Jan-12
	Calibration Frequency	once per year	
Measuring/Reading/ Recording frequency	Daily measured and recorded accordingly. Monitoring frequency: continuously.		
Calculation method (if applicable)	When the biomass residue is mechanically pretreated, the proposed project needs a certain amount of electricity from grid. This amount could be metered or calculated conservatively.		
	If the monitoring data is missing, or it is not feasible to install a dedicated meter to monitor this indicator, it will be calculated conservatively as the weight of straws smashed in tons and the electricity consumption factor (kWh/ton). The electricity factor can be calculated as follows: <div><div>1) Collecting all the nameplates power (in kW) and capacity(t/h) of every straw crackers</div><div>2) Calculating the electricity factor corresponding to each cracker in kWh/t</div><div>3) Using the largest number as a conservative electricity factor for the calculation</div></div> Monitoring frequency: Continuously ,aggregated at least monthly.		
QA/QC procedures	Cross-check measurement results with invoices for purchased electricity if available		
Purpose of data	Project emission		
Additional comment	--		



Data/Parameter	EG <sub>project plant,y</sub>			
Unit	MWh			
Description	Net quantity of increased electricity generated in the project plant during the year y			
Measured/Calculated /Default	Measured			
Source of data	On-site measurements			
Value(s) of monitored parameter	70,943.02			
Monitoring equipment	Meter name	Gate meter	Backup Meter	10KV Meter
	Type/Model	ACE8000	ACE8000	PD866E-760
	Accuracy	0.2%	0.2%	0.5%
	SN	0089096	0089111	1101280200001
	Date	03-Jan-11	03-Jan-11	03-Jan-11
	Valid Period	02-Jan-12	02-Jan-12	02-Jan-12
	Frequency	Once per year		
Measuring/Reading/ Recording frequency	Daily measured and recorded accordingly. Monitoring frequency: continuously.			
Calculation method (if applicable)	The net electricity equals to electricity supplied to the grid minus electricity purchased from the grid minus electricity purchased from the 10kv backup power.			
QA/QC procedures	The consistency of the data is cross-checked with receipts from electricity sales and purchase invoices, if available; and the quantity of fuels fired to see whether the electricity generation divided by the quantity of fuels fired results in a reasonable efficiency.			
Purpose of data	Baseline emission			
Additional comment	--			



<b>Data/Parameter</b>	--
<b>Unit</b>	Tonnes
<b>Description</b>	Quantity of each biomass residues type k that are utilized in the defined geographical region
<b>Measured/Calculated /Default</b>	Measured
<b>Source of data</b>	Surveys or Statistics
<b>Value(s) of monitored parameter</b>	Please refer to Section E.3
<b>Monitoring equipment</b>	N/A
<b>Measuring/Reading/ Recording frequency</b>	Annually
<b>Calculation method (if applicable)</b>	N/A
<b>QA/QC procedures</b>	This parameter is reviewed annually according to the project data and official data.
<b>Purpose of data</b>	Leakage
<b>Additional comment</b>	--

<b>Data/Parameter</b>	--
<b>Unit</b>	Tonnes
<b>Description</b>	Quantity of each biomass residues type k that are available in the region
<b>Measured/Calculated /Default</b>	Measured
<b>Source of data</b>	Surveys or Statistics
<b>Value(s) of monitored parameter</b>	Please refer to Section E.3
<b>Monitoring equipment</b>	N/A
<b>Measuring/Reading/ Recording frequency</b>	Annually
<b>Calculation method (if applicable)</b>	N/A
<b>QA/QC procedures</b>	This parameter is reviewed annually according to the project data and official data.
<b>Purpose of data</b>	Leakage
<b>Additional comment</b>	--

The monitored parameters are given in the following table 1.

Table 1: Monitored Parameters



from		Rice husk			Branches		
		BF <sub>k,y</sub>	Moisture	NCV	BF <sub>k,y</sub>	Moisture	NCV
		tonne	%	GJ/ton	Tonne	%	GJ/ton
	to	A	B	C	D	E	F
13/01/2011	31/01/2011	1,296.56	12.55	12.91	1,440.47	22.35	14.62
01/02/2011	28/02/2011	1,368.13	12.74	12.91	1,224.08	21.37	14.62
01/03/2011	31/03/2011	3,366.24	13.08	12.91	3,368.51	21.93	14.62
01/04/2011	30/04/2010	3,810.47	12.77	12.91	4,215.26	23.16	14.62
01/05/2011	31/05/2010	2,041.07	13.12	12.91	2,621.37	21.72	14.62
01/06/2011	30/06/2011	5,397.47	12.66	12.91	4,246.23	22.45	14.62
01/07/2011	31/07/2011	2,107.23	13.11	13.55	4,756.74	22.37	12.97
01/08/2011	31/08/2011	1,719.34	12.55	13.55	6,689.72	22.08	12.97
01/09/2011	30/09/2011	2,182.98	11.77	13.55	5,530.15	23.43	12.97
01/10/2011	31/10/2011	1,916.33	12.19	13.55	6,346.61	21.65	12.97
01/11/2011	30/11/2011	1,038.74	12.42	13.55	9,418.54	22.64	12.97
01/12/2011	31/12/2011	757.15	13.10	13.55	0.00	23.36	12.97
Total		27,001.71		-	-	49,857.68	-

from		Barks			Saw dust		
		BF <sub>k,y</sub>	Moisture	NCV	BF <sub>k,y</sub>	Moisture	NCV
		tonne	%	GJ/ton	Tonne	%	GJ/ton
	to	G	H	I	J	K	L
13/01/2011	31/01/2011	1,028.74	29.24	12.35	433.23	36.45	10.74
01/02/2011	28/02/2011	806.54	28.46	12.35	682.90	36.75	10.74
01/03/2011	31/03/2011	770.89	29.97	12.35	1,585.52	36.38	10.74
01/04/2011	30/04/2010	1,201.96	30.10	12.35	2,514.11	37.17	10.74
01/05/2011	31/05/2010	0.00	0.00	0.00	1,498.27	36.71	10.74
01/06/2011	30/06/2011	0.00	0.00	0.00	5,561.56	36.85	10.74
01/07/2011	31/07/2011	3,166.49	31.22	13.12	870.16	38.21	10.36
01/08/2011	31/08/2011	1,705.24	30.53	13.12	1,628.37	37.76	10.36
01/09/2011	30/09/2011	3,944.92	31.32	13.12	1,474.79	37.56	10.36
01/10/2011	31/10/2011	2,477.65	29.69	13.12	2,651.09	36.59	10.36
01/11/2011	30/11/2011	1,447.12	31.64	13.12	1,202.12	37.23	10.36
01/12/2011	31/12/2011	16,252.91	31.21	13.12	4,786.03	36.62	10.36
Total		32,802.46		-	-	24,888.15	-



		VD <sub>y</sub>	N <sub>y</sub>	FF <sub>project plant,i,y</sub>	FF <sub>project site,i,y</sub>	EG <sub>export,y</sub>	EG <sub>import110kv,y</sub>
from	to	km	-	Tonnes	Tonnes	MWh	MWh
		M	N	O	P	Q	R
13/01/2011	31/01/2011	108,206	1,775	1.92	5.92	2,217.93	62.57
01/02/2011	28/02/2011	54,328	1,414	1.22	6.70	2,153.58	37.42
01/03/2011	31/03/2011	173,674	4,494	3.64	11.27	4,736.75	55.97
01/04/2011	30/04/2010	90,572	2,264	0.00	11.93	6,242.15	4.36
01/05/2011	31/05/2010	163,630	3,514	2.65	12.42	3,554.63	60.92
01/06/2011	30/06/2011	122,270	2,732	0.00	7.49	7,948.71	0.00
01/07/2011	31/07/2011	116,554	2,551	1.59	9.20	5,815.19	95.77
01/08/2011	31/08/2011	78,062	1,794	2.99	9.72	6,257.79	53.00
01/09/2011	30/09/2011	162,738	3,694	0.00	8.76	7,028.87	0.00
01/10/2011	31/10/2011	135,050	2,903	1.03	7.47	7,417.15	30.95
01/11/2011	30/11/2011	104,100	2,262	0.79	8.30	7,169.84	68.97
01/12/2011	31/12/2011	126,166	2,865	2.19	11.76	11,229.04	0.00
total		1,435,350	32,262	18.02	110.94	71,771.63	469.92

		EG <sub>import 10kv,y</sub>	EG <sub>project plant,y</sub>	EC <sub>PJ1,y</sub>	EC <sub>PJ2,y</sub>	EC <sub>PJ,y</sub>
from	to	MWh	MWh	MWh	MWh	MWh
		S	T=Q-R-S	U	V	W=U+V
13/01/2011	31/01/2011	4.16	2,151.20	11.33	3.08	14.41
01/02/2011	28/02/2011	21.67	2,094.49	11.48	4.39	15.87
01/03/2011	31/03/2011	56.33	4,624.46	6.38	27.46	33.84
01/04/2011	30/04/2010	38.12	6,199.67	13.41	23.47	36.89
01/05/2011	31/05/2010	88.59	3,405.13	14.41	25.87	40.28
01/06/2011	30/06/2011	70.56	7,878.15	17.19	17.50	34.69
01/07/2011	31/07/2011	33.47	5,685.96	13.07	4.95	18.02
01/08/2011	31/08/2011	18.58	6,186.21	10.41	8.75	19.16
01/09/2011	30/09/2011	24.01	7,004.86	8.85	8.84	17.70
01/10/2011	31/10/2011	3.21	7,382.98	6.64	6.79	13.43
01/11/2011	30/11/2011	0.00	7,100.87	1.75	2.77	4.52
01/12/2011	31/12/2011	0.00	11,229.04	2.23	5.31	7.54
total		358.69	70,943.02	117.15	139.20	256.35

### D.3. Implementation of sampling plan

&gt;&gt;

N/A



**SECTION E. Calculation of emission reductions or GHG removals by sinks****E.1. Calculation of baseline emissions or baseline net GHG removals by sinks**

&gt;&gt;

Baseline emissions are calculated as:

- a) Emission reduction due to displacement of electricity

$$ER_{electricity,y} = EG_y \times EF_{electricity,y} \quad (1)$$

Where:

$ER_{electricity,y}$	Emission reductions due to displacement of electricity during the year y (tCO <sub>2</sub> /yr)
$EG_y$	Net quantity of increased electricity generation as a result of the project activity (incremental to baseline generation) during the year y (MWh)
$EF_{electricity,y}$	CO <sub>2</sub> emission factor for the electricity displaced due to the project activity during the year y (tCO <sub>2</sub> /MWh), which is 0.9735 tCO <sub>2</sub> e/MWh (See registered PDD Version 4 available online at <a href="http://cdm.unfccc.int/Projects/DB/TUEV-RHEIN1256219572.25/view">http://cdm.unfccc.int/Projects/DB/TUEV-RHEIN1256219572.25/view</a> )

During the current monitoring period, the net electricity supplied to the grid is:

$$EG_y = 70,943.02 \text{ MWh}$$

Therefore,

$$ER_{electricity,y} = 70,943.02 \text{ MWh} \times 0.9735 \text{ tCO}_2\text{e} / \text{MWh} = 69,063.03 \text{ tCO}_2\text{e}$$

- b) Emission reductions or increases due to displacement of heat

Since there is no steam is supplied to user, so the  $ER_{heat,y} = 0$ 

- c) Baseline emissions due to natural decay or uncontrolled burning of anthropogenic sources of biomass residues

$$BE_{biomass,y} = GWP_{CH_4} \cdot \sum_k BF_{PJ,k,y} \cdot NCV_k \cdot EF_{burning,CH_4,k,y}$$

Where:

$BE_{biomass,y}$	Baseline emissions due to natural decay or burning of anthropogenic sources of biomass residues during the year y (tCO <sub>2</sub> e/yr)
$GWP_{CH_4}$	Global Warming Potential of methane valid for the commitment period (tCO <sub>2</sub> e/tCH <sub>4</sub> )
$BF_{PJ,k,y}$	Incremental quantity of biomass residue type k used as a result of the project activity in the project plant during the year y (tons of dry matter)
$NCV_k$	Net calorific value of the biomass residue type k (GJ/ton of dry matter)
$EF_{burning,CH_4,k,y}$	CH <sub>4</sub> emission factor for uncontrolled burning of the biomass residue type k during the year y (tCH <sub>4</sub> /GJ)
k	Types of biomass residues for which the identified baseline scenario is B1 or B3 and for which leakage effects could be ruled out with one of the approaches L1, L2 or L3 described in the leakage section

$$BE_{biomass,y} = 21 \text{ tCO}_2\text{e} / \text{CH}_4 \times 100,634.70 \text{ t} \times 0.001971 \text{ tCH}_4 / \text{t} = 4,165.37 \text{ tCO}_2\text{e}$$

So, the baseline emission reduction is:

$$BE_y = ER_{\text{electricity},y} + ER_{\text{heat},y} + BE_{\text{biomass},y} = 69,063.03 + 0 + 4,165.37 = 73,228.40 \text{ tCO}_2\text{e}$$

## E.2. Calculation of project emissions or actual net GHG removals by sinks

>>

According to methodology ACM0006 version9, the emissions of the project within the project boundary include:

- CO<sub>2</sub> emissions from transportation of biomass residues to the project site (PET<sub>y</sub>),
- CO<sub>2</sub> emissions from on-site consumption of fossil fuels due to the project activity (PEFF<sub>y</sub>),
- CO<sub>2</sub> emissions from consumption of electricity (PE<sub>EC,y</sub>),
- Where this emission source is included in the project boundary and relevant: CH<sub>4</sub> emissions from the combustion of biomass residues (PE<sub>Biomass,CH<sub>4</sub>,y</sub>),
- Where waste water from the treatment of biomass residues degrades under anaerobic conditions: CH<sub>4</sub> emissions from waste water.

Project emissions are calculated as follows:

$$PE_y = PET_y + PEFF_y + PE_{EC,y} + GWP_{CH_4} \cdot PE_{\text{biomass},CH_4,y}$$

Where:

PET <sub>y</sub>	CO <sub>2</sub> emissions during the year y due to transport of the biomass residues to the project plant (tCO <sub>2</sub> /yr)
PEFF <sub>y</sub>	CO <sub>2</sub> emissions during the year y due to fossil fuels co-fired by the generation facility or other fossil fuel consumption at the project site that is attributable to the project activity (tCO <sub>2</sub> /yr)
PE <sub>EC,y</sub>	CO <sub>2</sub> emissions during the year y due to electricity consumption at the project site that is attributable to the project activity (tCO <sub>2</sub> /yr)
GWP <sub>CH<sub>4</sub></sub>	Global Warming Potential for methane valid for the relevant commitment period
PE <sub>Biomass,CH<sub>4</sub>,y</sub>	CH <sub>4</sub> emissions from the combustion of biomass residues during the year y (tCH <sub>4</sub> /yr)

- a) Carbon dioxide emissions from combustion of fossil fuels for transportation of biomass residues to the project plant (PET<sub>y</sub>)

$$PET_y = N_y \cdot AVD_y \cdot EF_{km,CO_2,y}$$

Where:

PET <sub>y</sub>	CO <sub>2</sub> emissions during the year y due to transport of the biomass residues to the project plant (tCO <sub>2</sub> /yr)
N <sub>y</sub>	Number of truck trips during the year y
AVD <sub>y</sub>	Average round trip distance (from and to) between the biomass residue fuel supply sites and the site of the project plant during the year y (km)
EF <sub>km,CO<sub>2</sub>,y</sub>	Average CO <sub>2</sub> emission factor for the trucks measured during the year y (tCO <sub>2</sub> /km)

Therefore,

$$PET_y = 32,262 \times \frac{1,435,350 \text{ km}}{32,262} \times 0.001097 \text{ tCO}_2\text{e} / \text{km} = 1,574.58 \text{ tCO}_2$$

- b) Carbon dioxide emissions from on-site consumption of fossil fuels (PEFF<sub>y</sub>)

$$PEFF_y = PE_{FC,j,y} = \sum_i FC_{i,j,y} \times COEF_{i,y}$$

Where:

$PE_{FC,j,y}$	Are the CO <sub>2</sub> emissions from fossil fuel combustion in process j during the year y (tCO <sub>2</sub> /yr);
$FC_{i,j,y}$	Is the quantity of fuel type i combusted in process j during the year y (mass or volume unit/yr);
$COEF_{i,y}$	Is the CO <sub>2</sub> emission coefficient of fuel type i in year y (tCO <sub>2</sub> /mass or volume unit)
i	Are the fuel types combusted in process j during the year y

$$COEF_{i,y} = NCV_{i,y} \times EF_{CO2,i,y}$$

Where:

$COEF_{i,y}$	Is the CO <sub>2</sub> emission coefficient of fuel type i in year y (tCO <sub>2</sub> /mass or volume unit)
$NCV_{i,y}$	Is the weighted average net calorific value of the fuel type i in year y (GJ/mass or volume unit)
$EF_{CO2,i,y}$	Is the weighted average CO <sub>2</sub> emission factor of fuel type i in year y (tCO <sub>2</sub> /GJ)
i	Are the fuel types combusted in process j during the year y

Therefore,

$$PEFF_y = \sum_i FC_{i,j,y} \times NCV_{i,y} \times EF_{CO2,i,y}$$
$$= (18.02t + 110.94t) \times 0.042652TJ / t \times 74,100kgCO_2e / TJ / 1 \times 10^3 = 407.58tCO_2e$$

c) CO<sub>2</sub> emissions from electricity consumption ( $PE_{EC,y}$ )

$$PE_{EC,y} = \sum_i EC_{PJ,j,y} \times EF_{EL,j,y} \times (1 + TDL_{j,y})$$

Where:

$EC_{PJ,j,y}$	Quantity of electricity consumed by the project electricity consumption source j in year y (MWh/yr)
$EF_{EL,j,y}$	Emission factor for electricity generation for source j in year y (tCO <sub>2</sub> /MWh)
$TDL_{j,y}$	Average technical transmission and distribution losses for providing electricity to source j in year y

Therefore,

$$PE_{EC,y} = 256.35MWh \times 0.9735tCO_2e / MWh \times (1 + 20\%) = 299.46tCO_2e$$

d) Methane emissions from combustion of biomass residues ( $PE_{Biomass,CH4,y}$ )

$$PE_{biomass,CH4,y} = EF_{CH4,BF} \cdot \sum_k BF_{k,y} \cdot NCV_k$$

Where:

$BF_{k,y}$	Quantity of biomass residue type k combusted in the project plant during the year y (tons of dry matter)
$NCV_k$	Net calorific value of the biomass residue type k (GJ/ton of dry matter)
$EF_{CH4,BF}$	CH <sub>4</sub> emission factor for the combustion of biomass residues in the project plant (tCH <sub>4</sub> /GJ), according to ACM0006, Version 9, the $EF_{CH4,BF}$ = 41.1 kg CH <sub>4</sub> /TJ

Therefore,

$$\begin{aligned}
 PE_{biomass,CH_4,y} &= 41.1kgCH_4 / TJ \cdot (15,064.91t \times 12.91GJ / t + 8,511.00t \times 13.55GJ / t \\
 &+ 13,294.78t \times 14.62GJ / t + 25,398.47t \times 12.97GJ / t + 2,684.96t \times 12.35GJ / t \\
 &+ 19,983.58t \times 13.12GJ / t + 7,755.96t \times 10.74GJ / t + 7,941.04t \times 10.36GJ / t \\
 &)/1 \times 10^6 = 53.20tCH_4
 \end{aligned}$$

According to the data calculated above,

$$\begin{aligned}
 PE_y &= 1,574.58tCO_2e + 407.58tCO_2e + 299.46tCO_2e + 21tCO_2e / tCH_4 \times 53.20tCH_4 \\
 &= 3,398.92tCO_2e
 \end{aligned}$$

### E.3. Calculation of leakage

>>

According to methodology ACM0006 version 9, the main potential source of leakage for this project activity is an increase in emissions from fossil fuel combustion or other sources due to diversion of biomass residues from other uses to the project plant as a result of the project activity. Changes in carbon stocks in the LULUCF sector are expected to be insignificant since this methodology is limited to biomass residues.

A statistic is issued by a reputed institute on the biomass availability, and the data are as followed:

Demonstration of abundant surplus of biomass availability				
Biomass Type	Rice husks(kt)	Branches(kt)	Barks(kt)	Saw dust(kt)
Total biomass generation in the region	200.7	450.00		
Biomass loss	20.1	45.00		
Available Biomass in the region	180.7	405.00		
Biomass utilised out of the project	18.1	60.75		
Biomass utilised by the project	27.00	49.86	32.80	24.89
Total biomass utilised, including the project	45.07	168.30		
Available Biomass/Total biomass utilised	401%	241%		
Available Biomass/Total biomass utilised - 100%	301%	141%		
Abundant surplus? (more than 25%)	Yes	Yes		

From the data in the above table, that the leakage of the project within the project boundary is zero, i.e.  $LE_y = 0 \text{ tCO}_2e$ .

**E.4. Summary of calculation of emission reductions or net anthropogenic GHG removals by sinks**

&gt;&gt;

Time Period	Baseline emissions or baseline net GHG removals by sinks (tCO <sub>2</sub> e)	Project emissions or actual net GHG removals by sinks (tCO <sub>2</sub> e)	Leakage (tCO <sub>2</sub> e)	Emission reductions or net anthropogenic GHG removals by sinks (tCO <sub>2</sub> e)
Total	73, 228.40	3,398.92	0	69,829 (Rounded down)

**E.5. Comparison of actual emission reductions or net anthropogenic GHG removals by sinks with estimates in registered PDD**

&gt;&gt;

Item	Values estimated in ex-ante calculation of registered PDD	Actual values achieved during this monitoring period
Emission reductions or GHG removals by sinks (tCO <sub>2</sub> e)	111,954 <sup>2</sup>	69,829

**E.6. Remarks on difference from estimated value in registered PDD**

&gt;&gt;

From the data shown in the above table, the actual emission reduction achieved during current monitoring period is lower than the ex-ante estimation in registered CDM-PDD.

-----

**History of the document**

Version	Date	Nature of revision
02.0	EB 66 13 March 2012	Revision required to ensure consistency with the "Guidelines for completing the monitoring report form" (EB 66, Annex 20).
01	EB 54, Annex 34 28 May 2010	Initial adoption.
<b>Decision Class:</b> Regulatory <b>Document Type:</b> Form <b>Business Function:</b> Issuance		

---

<sup>2</sup>  $111,954tCO_2e = \frac{115,760tCO_2e}{365days} \times 353days$