



Monitoring report form for CDM project activity
(Version 07.0)

MONITORING REPORT

Title of the project activity	Small-Scale Hydropower Project Sahainivotry in Madagascar	
UNFCCC reference number of the project activity	3558	
Version number of the PDD applicable to this monitoring report	4.3	
Version number of this monitoring report	1.0	
Completion date of this monitoring report	01/09/2020	
Monitoring period number	7 th monitoring period	
Duration of this monitoring period	01/07/2019 to 27/08/2020	
Monitoring report number for this monitoring period	n/a	
Project participants	HYDELEC Madagascar	
Host Party	Madagascar	
Applied methodologies and standardized baselines	ACM0002 "Consolidated baseline methodology for grid-connected electricity generation from renewable sources" (version 13.0.0)	
Sectoral scopes	Sectoral scope 01: Energy industries (renewable - / non-renewable sources)	
Amount of GHG emission reductions or net anthropogenic GHG removals achieved by the project activity in this monitoring period	Amount achieved before 1 January 2013	Amount achieved from 1 January 2013
	-	40,803
Amount of GHG emission reductions or net anthropogenic GHG removals estimated ex ante for this monitoring period in the PDD	51,562	

SECTION A. Description of project activity

A.1. General description of project activity

The purpose of the Sahanivotry Hydro Power Plant (hereafter referred to as “SHPP”) is to generate renewable energy using clean hydropower and sell the output electricity into the regional grid of Antananarivo (hereafter referred to as RI TANA) operated by JIRAMA.

SHPP is a run-of-river hydropower plant with a capacity of 16.5 MW with an average electricity generation of 80 GWh (up to 90 GWh in optimal years). The project uses three new Pelton turbines and three new generators provided by Hunan Lingling Hengyuan Generating Equipment Co., Ltd (China).

The project construction was commenced in March 2007, and the hydropower plant started commercial operation in October 2008.

The project has been implemented according to the following time schedule:

Table 1 – Time schedule of project implementation

SL.N O	Milestones	Key Dates
1	Authorization	02/2001-11/2007
1.1	Concession for the installation and operation of SHPP with an installed capacity of 10 MW Issuing Authority: Ministry of Energy and Mines (MEM)	17/02/2001
1.2	Approbation of the concession contract for the production of energy at HPP with an installed capacity of 10 MW Issuing Authority: MEM	23/03/2001
1.3	Authorisation for starting construction and increasing capacity from 10 to 15 MW Issuing Authority: MEM	07/03/2007
1.4	Authorization for the increase of capacity by 5 MW at SHPP. Issuing authority: MEM	28/11/2007
2	Power Purchase Agreement with Jirama	02/2001-08/2007
2.1	Signature of Power Purchase Agreement (PPA)	17/02/2001
2.2	PPA amendment Nr. 1	27/06/2001
2.3	PPA amendment Nr. 2	12/10/2006
2.4	PPA amendment Nr. 3	16/08/2007
3	Financing	07-09/2007
3.1	Loan Agreement with African Development Bank (AfDB)	05/07/2007
3.2	Loan Agreement with BFV-Société Générale and Mauritius Commercial Bank (Madagascar) S.A.	06/09/2007
4	Construction	03/2007-09/2008
4.1	Start of construction	03/2007
4.2	Procurement and installation of HPP	05-09/2008
5	Start operation	01/10/2008
5.0	Initial gap monitoring period (VCS)	04/10/2008 to 27/08/2010
5.1	1 st monitoring period (CDM)	28/08/2010 to 31/12/2012
5.2	2 nd monitoring period (CDM)	01/01/2013 to 31/05/2015
5.3	3 rd monitoring period (VCS)	01/06/2015 to 31/05/2016
5.4	4 th monitoring period (VCS)	01/06/2016 to 31/08/2017
5.5	5 th monitoring period (VCS)	01/09/2017 to 31/05/2018

5.6	6 th monitoring period (CDM)	01/06/2018 to 30/06/2019
5.7	7th monitoring period (CDM)	01/07/2019 to 27/08/2020

Due to the fact that SHPP was registered under CDM only on 28/08/2010, the fixed CDM crediting period starts with the CDM registration date, and has now ended on 27/08/2020. As a result of exporting renewable energy to the fossil fuel intensive national grid, the accrued emission reductions from July 1st, 2019 until August 27th, 2020, amounted to 40,803 tCO₂.

A.2. Location of project activity

The project is located about 30 km from Antsirabé on the river Ampamehana within Sahanivotry village, Antananarivo Province, Madagascar. The Ministry of Energy granted to HYDELEC for a period of 30 years the right to use 70 ha of land that belongs to Sahanivotry village for the construction and operation of the SHPP. The geographical co-ordinates of the project are 47°08' East (longitude) and 20°12' South (latitude).



Figure 1 – The project location

A.3. Parties and project participants

Parties involved	Project participants	Indicate if the Party involved wishes to be considered as project participant (Yes/No)
Madagascar (host)	HYDELEC Madagascar SA (Private Entity)	No

A.4. References to applied methodologies and standardized baselines

The baseline and monitoring methodology ACM0002 “Consolidated baseline methodology for grid-connected electricity generation from renewable sources” (version 13.0.0 EB 67) is applied to the project activity.

In line with the application of the ACM0002 methodology, the project refers to the following tools:

- “Tool to calculate the emission factor for an electricity system” (version 03.0.0 EB 70),
- “Tool for the demonstration and assessment of additionality” (version 07.0.0 EB 70),
- “Tool to calculate project or leakage CO₂ emissions from fossil fuel combustion” (version 02 EB 41).

A.5. Crediting period type and duration

The fixed CDM crediting period is from 28/08/2010 (date of CDM registration) to 27/08/2020.

SECTION B. Implementation of project activity**B.1. Description of implemented project activity**

The project construction was commenced in March 2007, and the hydropower plant started commercial operation in October 2008 based on the following technical specifications, as per registered PDD.

Table 2 – Installed equipment characteristics

Turbines	Manufacturer	Model	Type	Rated Power	Rated head	Rated flow
3	Hunan Lingling Hengyuan Generating Equipment Co., Ltd (China)	CJA237-W-140/2x18	Pelton	5,676 kW	210 m	3.12m ³ /s
Generator	Manufacturer	Model	Type	Rated Power	Rated voltage	Rated rotation speed
3	Hunan Lingling Hengyuan Generating Equipment Co., Ltd (China)	SFW5500-14/2420	-	5.5 MW	6.3 kV	428.6 r/min

The project's 6.6/63 kV transformers (LB-66GYWZ x3) feed into COELEME 66kV busbar at JIRAMA delivery station.

Regular maintenance is undertaken unit after unit in order to minimize impacts on overall continuous production, according to maintenance schedule. Routine sand removal operations take place up to twice or thrice a month during rainy season, for short durations of 8 to 10 hours only, usually conducted in parallel of JIRAMA grid maintenance.

During this monitoring period, the project has operated continuously and satisfactorily, with the exception of short interruptions due to above maintenance and JIRAMA line defaults.

No legislation change occurred in Madagascar since the Concession Agreement with Ministry of Energy and the Power Purchase Agreement with JIRAMA were signed.

B.2. Post-registration changes

B.2.1. Temporary deviations from the registered monitoring plan, applied methodologies, standardized baselines or other methodological regulatory documents

N/A

B.2.2. Corrections

N/A

B.2.3. Changes to the start date of the crediting period

N/A

B.2.4. Inclusion of monitoring plan

N/A

B.2.5. Permanent changes to the registered monitoring plan, or permanent deviation of monitoring from the applied methodologies, standardized baselines, or other methodological regulatory documents

A post-registration changes was undertaken during 1st monitoring period (reference PRC-3558-001 approved on Nov 12, 2013); no other changes occurred subsequently.

B.2.6. Changes to project design

A post-registration changes was undertaken during 1st monitoring period (reference PRC-3558-001 approved on Nov 12, 2013); no other changes occurred subsequently.

B.2.7. Changes specific to afforestation or reforestation project activity

N/A

SECTION C. Description of monitoring system

The data to be monitored is the net electricity supplied to the regional grid and any diesel consumed by the emergency back-up diesel generator.

Energy meters

Two bi-directional energy meters M1 and M2 (ACTARIS SL 7000 Type SL 761 B/C 060 manufactured by ACTARIS France with a respective accuracy of 0.5% and 1%) have been installed for monitoring the generated power, according to the national practice set by JIRAMA.

The meters register the following information:

- Active power
- Reactive power
- Apparent power
- Voltage
- Phase's current
- Active energy
- Frequency

- Event record
- Harmonies

The electricity delivered from SHPP to the regional grid is thus continuously monitored through these metering equipments installed at project site, two bi-directional electricity meters M1 and M2:

Table 3 – Electricity meters characteristics

Meters label	Serial Number	Characteristics	Accuracy	Use
M1 (<i>main</i>)	33055428	bi-directional	0,5 %	Monitoring of net electricity supplied by the project
M2 (<i>back-up</i>)	36050447	bi-directional	1 %	Used in case of failure of M1

M1 (and M2 backup) readings are measured thanks to bi-directional meters, allowing to deduct SHPP's eventual power import from the grid for its auxiliary consumption when not operational (and alternatively to its emergency diesel generator). Billing is then processed under a monthly invoice from Hydelec to JIRAMA based on measurements of electricity exported, double-checked by JIRAMA headquarters and Antsirabe sub-station before payment.

Table below provides indicative information along monitoring period regarding activities/observation/measures taken for monitoring energy generated by the project mentioning with which meter information has been collected.

Table 4 – Monitoring events

Period	Activities	Observations/Measures taken
01.07.2019 to 27.08.2020	M1 and M2 in function	Data collection from M1

The following grid connection diagram indicates the principles of positioning of metering instruments that have been used in the monitoring of the emission reductions. Staff record the operation status and reading of metering equipments daily on site (6:00 am), which log-sheet of production recorded daily is provided to DOE. Furthermore, designated staff collect the measured electricity weekly before it is checked by the company administrator or supervisor regularly.


Two additional meters M3 (n°36050437 at Antsirabe sub-station) and M4 (n°73305393 at Holcim Ibity cement factory) are used by JIRAMA as a cross-check at Antsirabe's substation and Ibity end-user connection.

Table 5 – Cross-check meters characteristics

Electric meters	Meters label	Serial Number	Characteristics	Use
JIRAMA : Antsirabe	M3	36050437	bi-directional	Use by JIRAMA to control the electricity supplied by Hydelec
HOLCIM : Ibity	M4	73305393	bi-directional	



SEXCB	:low voltage excitation disconnecter	SB	:bus bar disconnecter
SEXCM	:Medium voltage excitation disconnecter	DL	:line's circuit breaker
TREXC	:excitation transformer	GS	:generator
DG	:generator's circuit breaker	SGRS	:emergency diesel generator's disconnecter
SG	:generator's disconnecter	STL	:line's earthing switch
CB	:tank circuit	SLa	:line's disconnector
STR	:transformer's disconnector	SLd	:line's disconnector
DTR	:transformer's circuit breaker	M1,M2,M3, M4	:kilowatt-hour meters
STT	:voltage transformer's disconnecter	tc	:current transformer
SL	:link disconnector	tt	:voltage transformer
ST	:earthing switch	PF	:surge arrester
TRAUX	: auxiliary transformer		
DGAUX	:auxiliary circuit breaker		
DGGRS	:emergency generator circuit breaker		
TT	:voltage transformer		



current direction when the plant is operational


current direction when the plant is shutdown

During any emergency or maintenance situation, and if back-up electricity is not available from the grid, the quantity of diesel fuel consumed by the diesel generator is measured and recorded in a log book.

The project owner HYDELEC took the responsibility of the monitoring plan implementation; HYDELEC appointed a CDM manager, who is responsible for the supervision of the monitoring process, the data measuring, collection and recording, QA/QC, audit and reporting.

The staff from technical and financial departments undertook the monitoring tasks including control of metering equipments periodically, collecting electricity data and completing records, checking and analyzing the data, archiving relevant records, reporting to the CDM manager.

Figure 3 – Monitoring and management structure

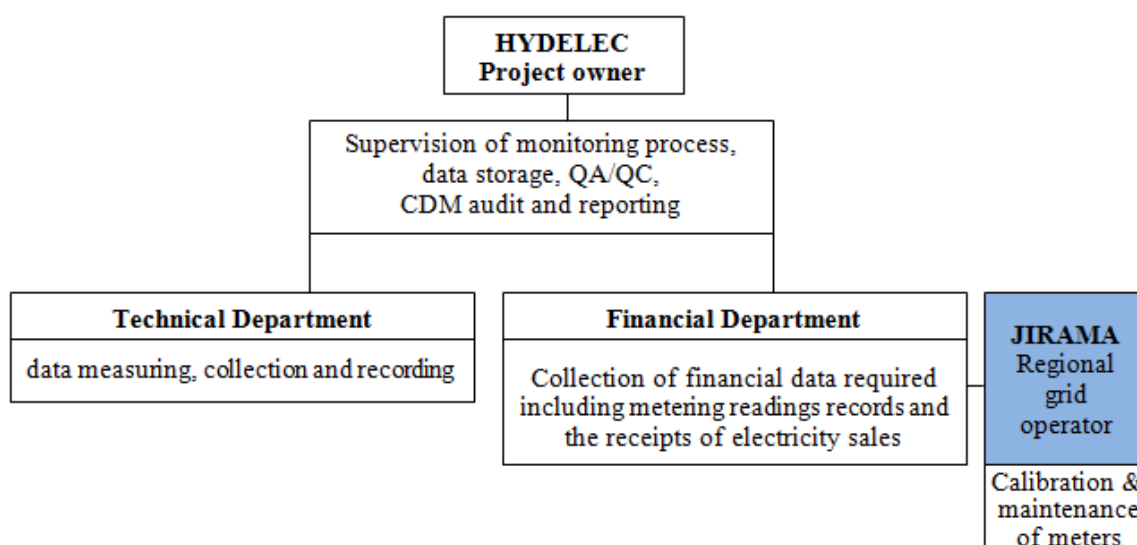

Quality assurance and quality control

The electricity delivered by SHPP to RI TANA is monitored through metering equipment at the project site and invoiced monthly to JIRAMA. The data is cross-checked for quality control against electricity transmission records from JIRAMA dispatching department twice (at Antsirabe and at RI-Tana headquarter) before approval of the billing.

Calibration of meters occurs annually according to the national practice set by JIRAMA. All relevant data records obtained from the monitoring are kept by the project owner during the crediting period and for at least two years after the end of crediting period.

Operational procedures, including emergency response and troubleshooting measures, are described in the implemented manuals (provided to the DOE) based on which the project staff is trained:

- Exploitation procedures manual (*Manuel de Procédures d'Exploitation*)
- CDM monitoring manual
- Quality management manual

SECTION D. Data and parameters

D.1. Data and parameters fixed ex ante

Data/parameter:	$FC_{i,m,y}$
Unit	g/kWh

Description	Amount of fossil fuel type i consumed by power plant / unit m in year y within RI TANA
Source of data	JIRAMA (2007) Ministry of Energy and Mines, Least Cost Generation Master plan (2005)
Value(s) applied)	See Annex 3 of registered PDD
Choice of data or measurement methods and procedures	The data is from the national utility JIRAMA resp. Ministry of Energy and Mines.
Purpose of data/parameter	Calculation of baseline emissions
Additional comments	The uncertainty of the data is low.

Data/parameter:	$EG_{m,y}$ and $EG_{k,y}$
Unit	MWh
Description	Net electricity generated and delivered to the RI TANA by power plant / unit m resp. k in year y
Source of data	JIRAMA (2004, 2005, 2006)
Value(s) applied)	See Annex 3 of registered PDD
Choice of data or measurement methods and procedures	The data is from the national utility JIRAMA resp. Ministry of Energy and Mines.
Purpose of data/parameter	Calculation of baseline emissions
Additional comments	The uncertainty of the data is low.

Data/parameter:	$NCV_{i,y}$
Unit	GJ/ton
Description	Net calorific value (energy content) of fossil fuel type i in year y
Source of data	2006 IPCC Guidelines for National Greenhouse Gas Inventories
Value(s) applied)	Fuel oil: 44.44 Diesel: 40.19
Choice of data or measurement methods and procedures	2006 IPCC Guidelines for National Greenhouse Gas Inventories are considered to be authoritative.
Purpose of data/parameter	Calculation of baseline emissions
Additional comments	-

Data/parameter:	$EF_{CO_2,i,j,y}$
Unit	tCO ₂ /GJ
Description	CO ₂ emission factor of fossil fuel type i in year y
Source of data	2006 IPCC Guidelines for National Greenhouse Gas Inventories. Workbook Vol.2.
Value(s) applied)	Fuel oil: 77.37 Diesel: 74.06
Choice of data or measurement methods and procedures	IPCC Guidelines for National Greenhouse Gas Inventories are considered to be authoritative.
Purpose of data/parameter	Calculation of baseline emissions
Additional comments	-

Data/parameter:	λ_y
Unit	%

Description	Fraction of time when the low-cost must-run resources are on the margin in year y
Source of data	JIRAMA (2007)
Value(s) applied)	74
Choice of data or measurement methods and procedures	The data is from the national utility JIRAMA.
Purpose of data/parameter	Calculation of baseline emissions
Additional comments	The uncertainty of the data is low.

Data/parameter:	EF_{CO2} for the diesel consumed by the emergency back-up diesel generator
Unit	tCO ₂ /kg of diesel
Description	CO ₂ emission factor of diesel used for the emergency back-up diesel generator at SHPP
Source of data	Footnote of Table I.D.1 in AMS I.D. ver.13 mentions this conversion factor following revised 1996 IPCC Guidelines for National Greenhouse Gas Inventories.
Value(s) applied)	3.2 tCO ₂ /kg of diesel
Choice of data or measurement methods and procedures	Default value
Purpose of data/parameter	Calculation of baseline emissions
Additional comments	-

Data/parameter:	CAP_{BL}
Unit	W
Description	Installed capacity of the hydro power plant before the implementation of the project activity.
Source of data	Project site
Value(s) applied)	For new hydro power plants, this value is zero.
Choice of data or measurement methods and procedures	-
Purpose of data/parameter	Calculation of baseline emissions
Additional comments	This parameter is used to calculate the power density. However calculation of power density is not required for this proposed project activity (no reservoir).

Data/parameter:	ABL
Unit	m ²
Description	Area of the reservoir measured in the surface of the water before the implementation of the project activity, when the reservoir is full
Source of data	Project site
Value(s) applied)	For new reservoirs, this value is zero
Choice of data or measurement methods and procedures	-
Purpose of data/parameter	Calculation of baseline emissions
Additional comments	This parameter is used to calculate the power density. However calculation of power density is not required for this proposed project activity (no reservoir).

D.2. Data and parameters monitored

Data/parameter:	EG _{facility,y}															
Unit	MWh/yr															
Description	Quantity of net electricity generation supplied by the project plant to the grid in year y															
Measured/calculated/default	Measured															
Source of data	Electricity meter(s)															
Value(s) of monitored parameter	y	July to December 2019	January to August 28 th 2020	Total												
	EG _{facility,y}															
Monitoring equipment	<p>Two bi-directional energy meters M1 (main) and M2 (back-up) are used to monitor the net electricity generated (ACTARIS SL 7000 Type SL 761 B/C 060; Serial number: 33055428 and 36050447; Manufactured by ACTARIS France with a respective accuracy of 0.5% and 1%).</p> <p>M1 and M2 are installed on the 63 kV substation of the hydro power plant to measure directly and continuously the electricity generation and the net electricity supply to the grid. The metering instruments M1 and M2 satisfy the accuracy class requirements as per Article 05 of original Power Purchase Agreement dated 17/02/2001 and have been calibrated on-site annually by JIRAMA in accordance with the national practice set by JIRAMA PPA and 16/08/2007 amendment about ownership and maintenance:</p> <p>Table 5 - calibration events</p> <table><tr><th>Calibration events</th><th>Validity</th><th>Delayed calibration?</th><th>Comment</th></tr><tr><td>05/07/2018</td><td>04/07/2019</td><td>No</td><td>Calibration of both meters</td></tr><tr><td>10/12/2019</td><td>09/12/2020</td><td>Yes</td><td>Calibration of both meters</td></tr></table> <p>Both meters are always checked & calibrated together. During this monitoring period, M1 & M2 were properly calibrated.</p>				Calibration events	Validity	Delayed calibration?	Comment	05/07/2018	04/07/2019	No	Calibration of both meters	10/12/2019	09/12/2020	Yes	Calibration of both meters
Calibration events	Validity	Delayed calibration?	Comment													
05/07/2018	04/07/2019	No	Calibration of both meters													
10/12/2019	09/12/2020	Yes	Calibration of both meters													
Measuring/reading/recording frequency:	Measured continuously, recorded daily and aggregated monthly															
Calculation method (if applicable):	-															
QA/QC procedures:	<p>The electricity delivered by SHPP to RI TANA is monitored through metering equipment M1 (main) and M2 (back-up) at the project site, with a respective accuracy of 0.5% and 1%, and invoiced monthly to JIRAMA. The data is cross-checked for quality control against electricity transmission records from JIRAMA dispatching department twice (at Antsirabe and at RI-Tana headquarter) before approval of the billing. Billing is then processed under a monthly invoice from Hydelec to JIRAMA based on measurements of electricity supplied.</p> <p>Moreover a third power meter M3 is used by JIRAMA at the substation of Antsirabe, together with a fourth end-user power meter M4 at HOLCIM cement factory of Ibity, to cross check the net electricity generated by the project – in case of failure of both M1 & M2 simultaneously.</p>															
Purpose of data/parameter:	Calculation of baseline emissions															
Additional comments:	In business-as-usual conditions, when both meters are operational, M1 is used for metering, and M2 in case of failure.															

Data/parameter:	FC_{diesel}
Unit	kg

Description	The quantity of diesel fuel consumed by the diesel generator during any emergency situation
Measured/calculated/default	Calculated
Source of data	The emergency records and log book
Value(s) of monitored parameter	641
Monitoring equipment	-
Measuring/reading/recording frequency:	-
Calculation method (if applicable):	The total diesel consumption in volume, recorded from tank gauge readings, was converted into kilogram based on a highly conservative density value of 1 kg/L.
QA/QC procedures:	This is cross checked with the purchase receipts of diesel fuel and measurement conducted in the diesel storage tank.
Purpose of data/parameter:	Calculation of project emissions
Additional comments:	The diesel generator only operates in unplanned emergency situations. The hydropower plant has three turbines; therefore the maintenance is done during the dry season; where only one or two turbines are running. That means the maintenance of SHPP is done without any need of the diesel generator.

Data/parameter:	NCV_{diesel,y}
Unit	GJ per mass or volume unit (e.g. GJ/m ³ , GJ/ton)
Description	Weighted average net calorific value of diesel fuel in year <i>y</i>
Measured/calculated/default	Default
Source of data	IPCC default values at the upper limit of the uncertainty at a 95% confidence interval as provided in Table 1.2 of Chapter 1 of Vol. 2 (Energy) of the 2006 IPCC Guidelines on National GHG inventories, as neither local nor national values available.
Value(s) of monitored parameter	43.3
Monitoring equipment	-
Measuring/reading/recording frequency:	-
Calculation method (if applicable):	-
QA/QC procedures:	-
Purpose of data/parameter:	Calculation of project emissions
Additional comments:	No revision of the IPCC Guidelines have been done thus not taken into account.

Data/parameter:	EF_{CO₂, diesel,y}
Unit	tCO ₂ /GJ
Description	Weighted average CO ₂ emission factor of diesel fuel in year <i>y</i>
Measured/calculated/default	Default
Source of data	IPCC default values at the upper limit of the uncertainty at a 95% confidence interval as provided in Table 1.4 of Chapter 1 of Vol. 2 (Energy) of the 2006 IPCC Guidelines on National GHG Inventories, as neither local nor national values available.
Value(s) of monitored parameter	0.0748

Monitoring equipment	-
Measuring/reading/recording frequency:	-
Calculation method (if applicable):	-
QA/QC procedures:	-
Purpose of data/parameter:	Calculation of project emissions
Additional comments:	Applicable since Option B of the Tool to calculate project or leakage CO ₂ emissions from fossil fuel combustion is used. Any future revision of the IPCC Guidelines should be taken into account however no revision have been done at the time of project verification.

Data/parameter:	CAP_{PJ}
Unit	W
Description	Installed capacity of the hydro power plant after the implementation of the project activity
Measured/calculated/default	-
Source of data	Project site
Value(s) of monitored parameter	16,500,000 (i.e. 16.5 MW)
Monitoring equipment	-
Measuring/reading/recording frequency:	Monitored yearly
Calculation method (if applicable):	Determined based on recognized standards.
QA/QC procedures:	-
Purpose of data/parameter:	Applicability condition of methodology ACM0002
Additional comments:	This parameter is used to calculate the power density. However calculation of power density is not required for this proposed project activity. As mentioned in Applicability conditions of the methodology ACM0002, the project is the installation of a new run-off-river hydro power plant and does not involve any reservoir.

Data/parameter:	AP_J
Unit	m ²
Description	Surface area of the reservoir measured at full supply level after the implementation of the project activity.
Measured/calculated/default	-
Source of data	-
Value(s) of monitored parameter	-
Monitoring equipment	-
Measuring/reading/recording frequency:	-
Calculation method (if applicable):	-
QA/QC procedures:	-
Purpose of data/parameter:	Applicability condition of methodology ACM0002
Additional comments:	This parameter is used to calculate the power density. However calculation of power density is not required for this proposed project activity. As mentioned in Table 4 (Applicability conditions of the methodology ACM0002), the project is the installation of a new run-off-river hydro power plant and does not involve any reservoir.

D.3. Implementation of sampling plan

N/A

SECTION E. Calculation of emission reductions or net anthropogenic removals**E.1. Calculation of baseline emissions or baseline net removals**

Baseline emissions include only CO₂ emissions from electricity generation in fossil fuel fired power plants that are displaced due to the project activity. The methodology assumes that all project electricity generation above baseline levels would have been generated by existing grid-connected power plants and the addition of new grid-connected power plants. The baseline emissions are to be calculated as follows:

$$BE_y = EG_{PJ,y} \times EF_{grid,CM,y}$$

Where:

BE_y = Baseline emissions in year y (tCO₂/yr)

$EG_{PJ,y}$ = Quantity of net electricity generation that is produced and fed into the grid as a result of the implementation of the CDM project activity in year y (MWh/yr)

$EF_{grid,CM,y}$ = Combined margin CO₂ emission factor for grid connected power generation in year y calculated using the latest version of the "Tool to calculate the emission factor for an electricity system" (tCO₂/MWh)

In this 7th monitoring period (01/07/2019 to 27/08/2020), the GHG baseline emissions was **40,803 tCO₂e**.

	EG_y (kWh)	EF_y (tCO₂e/MWh)	BE_y (tCO₂e)
July 2019	4 606 378	0,548	2 524
August 2019	3 229 668	0,548	1 769
September 2019	2 390 121	0,548	1 309
October 2019	2 633 502	0,548	1 443
November 2019	3 163 507	0,548	1 733
December 2019	4 414 310	0,548	2 419
January 2020	8 602 653	0,548	4 714
February 2020	6 727 011	0,548	3 686
March 2020	11 710 577	0,548	6 417
April 2020	8 566 774	0,548	4 694
May 2020	5 512 249	0,548	3 020
June 2020	5 228 529	0,548	2 865
July 2020	4 456 042	0,548	2 441
August 2020	3 229 668	0,548	1 769
TOTAL	74 470 989	-	40 803

E.2. Calculation of project emissions or actual net removals

The only fossil CO₂ emissions from the project activity come from the 60 kVA diesel emergency unit installed at the plant (downsized from former 100 kVA gen-set replaced in December 2015). According to methodology ACM0002 the use of fossil fuels for the back up or emergency purposes (e.g. diesel generators) can be neglected.

Indeed this unit is relied on only for unplanned emergency situations as the hydropower plant operates during 12 months per year. The hydropower plant has three turbines; therefore the maintenance is done during the dry season; where only one or two turbines were running. That means the maintenance is done easily without any need of the diesel generator.

The emergency system was only used to serve the plant when neither the power in the plant nor the grid power was available. Associated emissions have been conservatively calculated as less than 2 tCO₂ for the entire monitoring period, and confirmed as smaller than 1% of the total Emission Reductions and thus neglected:

$$PE_y = FC_{diesel,y} \times NCV_{diesel,y} \times EF_{CO_2, diesel,y}$$

Where

$FC_{diesel,y}$ = diesel consumed by the emergency back-up diesel generator in year y;

$NCV_{diesel,y}$ = weighted average net calorific value of diesel fuel in year y;

$EF_{CO_2, diesel,y}$ = weighted average CO₂ emission factor of diesel fuel in year ;

E.3. Calculation of leakage emissions

As newly built hydropower plant, there is no energy generating equipment transferred from another activity and no existing equipment transferred to another activity. Therefore according to methodology ACM0002 there is no need to consider leakage (L_y) for the proposed project, thus $L_y = 0$.

E.4. Calculation of emission reductions or net anthropogenic removals

	Baseline GHG emissions or baseline net GHG removals (t CO ₂ e)	Project GHG emissions or actual net GHG removals (t CO ₂ e)	Leakage GHG emissions (t CO ₂ e)	GHG emission reductions or net anthropogenic GHG removals (t CO ₂ e)		
				Before 01/01/2013	From 01/01/2013	Total amount
Total		-	-	-	40,803	40,803

E.5. Comparison of emission reductions or net anthropogenic removals achieved with estimates in the registered PDD

Amount achieved during this monitoring period (t CO ₂ e)	Amount estimated ex ante for this monitoring period in the PDD (t CO ₂ e)
40,803	51,562

E.5.1. Explanation of calculation of “amount estimated ex ante for this monitoring period in the PDD”

Registered PDD' ex-ante emission reductions were estimated at 44,196 tCO₂e per year, thus 51,562 tCO₂e after extrapolating to the 14 months duration of current monitoring period.

E.6. Remarks on increase in achieved emission reductions

The actual emission reduction figures have been slightly lower than projected in the PDD. This difference results from lower water levels than expected, as well as interruptions of the power plant for sand removal.

E.7. Remarks on scale of small-scale project activity

N/A

- - - - -

Document information

<i>Version</i>	<i>Date</i>	<i>Description</i>
07.0	31 May 2019	Revision to: <ul style="list-style-type: none"> • Ensure consistency with version 02.0 of the “CDM project standard for project activities” (CDM-EB93-A04-STAN); • Add a section on remarks on the observance of the scale limit of small-scale project activity during the crediting period; • Add "changes specific to afforestation or reforestation project activity" as a possible post-registration changes; • Clarify the reporting of net anthropogenic GHG removals for A/R project activities between two commitment periods; • Make editorial improvements.
06.0	7 June 2017	Revision to: <ul style="list-style-type: none"> • Ensure consistency with version 01.0 of the “CDM project standard for project activities” (CDM-EB93-A04-STAN); • Make editorial improvements.
05.1	4 May 2015	Editorial revision to correct version numbering.
05.0	1 April 2015	Revisions to: <ul style="list-style-type: none"> • Include provisions related to delayed submission of a monitoring plan; • Provisions related to the Host Party; • Remove reference to programme of activities; • Overall editorial improvement.
04.0	25 June 2014	Revisions to: <ul style="list-style-type: none"> • Include the Attachment: Instructions for filling out the monitoring report form (these instructions supersede the "Guideline: Completing the monitoring report form" (Version 04.0)); • Include provisions related to standardized baselines; • Add contact information on a responsible person(s)/ entity(ies) for completing the CDM-MR-FORM in A.6 and Appendix 1; • Change the reference number from <i>F-CDM-MR</i> to <i>CDM-MR-FORM</i>; • Editorial improvement.
03.2	5 November 2013	Editorial revision to correct table in page 1.
03.1	2 January 2013	Editorial revision to correct table in section E.5.
03.0	3 December 2012	Revision required to introduce a provision on reporting actual emission reductions or net GHG removals by sinks for the period up to 31 December 2012 and the period from 1 January 2013 onwards (EB 70, Annex 11).
02.0	13 March 2012	Revision required to ensure consistency with the "Guidelines for completing the monitoring report form" (EB 66, Annex 20).
01.0	28 May 2010	EB 54, Annex 34. Initial adoption.

<i>Version</i>	<i>Date</i>	<i>Description</i>
Decision Class: Regulatory		
Document Type: Form		
Business Function: Issuance		
Keywords: monitoring report		