



**CLEAN DEVELOPMENT MECHANISM
PROJECT DESIGN DOCUMENT FORM (CDM-PDD)
Version 03 - in effect as of: 28 July 2006**

CONTENTS

- A. General description of project activity
- B. Application of a baseline and monitoring methodology
- C. Duration of the project activity / crediting period
- D. Environmental impacts
- E. Stakeholders' comments

Annexes

- Annex 1: Contact information on participants in the project activity
- Annex 2: Information regarding public funding
- Annex 3: Baseline information
- Annex 4: Monitoring plan

**SECTION A. General description of project activity****A.1. Title of the project activity:**

Title of the project activity: *Rio Grande do Norte and Ceará Wind Energy Complex Project Activity.*

Version number of the document: 2a

Date (DD/MM/YYYY): 10/04/2012.

A.2. Description of the project activity:

The primary objective of the Wind Power Plants considered in this CDM Project Activity is to help meet Brazil's rising demand for energy due to economic growth and to improve the supply of electricity, while contributing to environmental, social and economic sustainability by increasing the share of renewable energy consumption for Brazil (and for the region of Latin America and the Caribbean).

The Latin America and the Caribbean region countries have expressed their commitment towards achieving a target of 10% renewable energy for the total energy use in the region. Through an initiative from the Ministers of the Environment in 2002 (UNEP-LAC, 2002)¹, a preliminary meeting of the World Summit for Sustainable Development (WSSD) was held in Johannesburg in 2002. In the WSSD final Plan of Implementation no specific targets or timeframes were stated, however, their importance was recognized to achieve sustainability in accordance with the Millennium Development Goals².

The privatization process initiated in 1995 arrived in conjunction with the expectation of adequate tariffs (fewer subsidies) and more attractive prices for generators. It drew the attention of investors to possible alternatives not available in the centrally planned electricity market. Unfortunately the Brazilian energy market lacked a consistent expansion plan, with the biggest problems being political and regulatory uncertainties. At the end of the 1990's a strong increase in demand in contrast with a less-than-average increase in installed capacity caused the supply crisis/rationing from 2001/2002. One of the solutions the government provided was flexible legislation favoring smaller independent energy producers. In addition to this, the possible eligibility under the Clean Development Mechanism of the Kyoto Protocol also drew the attention of investors regarding renewable energy projects.

¹ UNEP-LAC (2002). Final Report of the 7th Meeting of the Inter-Sessional Committee of the Forum of Ministers of Environment of Latin America and the Caribbean. United Nations Environment Programme, Regional Office for Latin America and the Caribbean. May 15th to 17th, 2002, São Paulo (Brazil).

² WSSD Plan of Implementation, Paragraph 19 (e): "*Diversify energy supply by developing advanced, cleaner, more efficient, affordable and cost-effective energy technologies, including fossil fuel technologies and renewable energy technologies, hydro included, and their transfer to developing countries on concessional terms as mutually agreed. With a sense of urgency, substantially increase the global share of renewable energy sources with the objective of increasing its contribution to total energy supply, recognizing the role of national and voluntary regional targets as well as initiatives, where they exist, and ensuring that energy policies are supportive to developing countries' efforts to eradicate poverty, and regularly evaluate available data to review progress to this end.*"



In this context, the proposed project activity can be seen as an example of a solution by the private sector to the Brazilian electricity crisis of 2001, contributing to the country's sustainable development. This indigenous and cleaner source of electricity will also have an important contribution to environmental sustainability by reducing carbon dioxide emissions that would have occurred otherwise in the absence of the project. The project activity reduces emissions of greenhouse gases (GHG) by avoiding electricity generation from fossil fuel sources, which would be generated (and emitted) in the absence of the project.

The proposed project activity consists of four wind power plants: *Mar e Terra*, *Areia Branca*, *Embuaca* and *Icarai*, with 23.1 MW, 27.3 MW, 27.3 MW and 16.8 MW of installed capacity, respectively. *Mar e Terra* and *Areia Branca* wind power plants are expected to become operation on August, 7th 2012; *Embuaca* wind power plant on December, 5th 2012 and *Icarai* wind power plant on December, 30th 2012. *Mar e Terra* and *Areia Branca* Wind Power Plants are located in *Areia Branca* municipality, *Rio Grande do Norte* state, *Embuaca* Wind Power Plant is located in *Trairi* municipality and *Icarai* is located in *Amontada*, both located in *Ceará* state. All the plants are located in the northeast region of Brazil.

The owner of the wind power plants *Mar e Terra*, *Areia Branca*, *Embuaca* e *Icarai* are the Specific Societies of Purpose (in a free translation from the Portuguese *Sociedades de Propósito Específico - SPEs*) *Eólica Mar e Terra Geração e Comercialização de Energia S.A.*, *Eólica Bela Vista Geração e Comercialização de Energia S.A.*, *Embuaca Geração e Comercialização de Energia S.A.* e *Eólica Icarai Geração e Comercialização de Energia Ltda.*, respectively. The *SPEs* are controlled by *MS Participações Societárias S.A.* which belongs to *Martifer* and *Santander* Groups.

The four wind power plants presented in this project activity, will provide electricity to the grid through the installation of four transmission lines that will be located at the region where the plants are located. The description of each transmission line is detailed as follow:

- *Mar e Terra* wind power plant:

- o *Mar e Terra* wind power plant will be interconnected to the grid through a transmission line of 230 kV which will connect *Areia Branca* substation to *Mossoró II* substation from the local power utility (*CHESF - Companhia Hidroelétrica do São Francisco*). The mentioned transmission line presents an extension of approximately 52 km and will pass by two municipalities, *Areia Branca* and *Mossoró*.

- *Areia Branca* wind power plant:

- o *Areia Branca* wind power plant will be interconnected to the grid through a transmission line of 230 kV which will connect *Areia Branca* substation of 230 kV to *Mossoró II* substation from the local power utility (*CHESF - Companhia Hidroelétrica do São Francisco*). The mentioned transmission line presents an extension of approximately 52 km and will pass by two municipalities (*Areia Branca* and *Mossoró*).

- o In addition, *Areia Branca* wind power plant will present a transmission line of 34.5 kV to connect *Areia Branca* wind power plant to *Areia Branca* substation 34.5/230kV. This transmission line will present an extension of approximately 1.2 km.

- *Embuaca* wind power plant:



○ *Embuaca* wind power plant will be interconnected to the grid through a transmission line of 34.5 kV which will be directly connected to *Faísá* substation also with 34.5 kV, located at the municipality of *Trairi*, state of *Ceará*. *Faísá* substation will be interconnected to *Pecém II* substation (controlled by the local power utility (*Companhia Hidro Elétrica do São Francisco – CHESF*)). The transmission line will present an extension of approximately 12 km.

- *Icarai* wind power plant:

Icarai wind power plant will be interconnected to the grid through a transmission line of 69 kV which will connect *Icarai* substation of 69 kV located at *Amontada* municipality, state of *Ceará* to *Marco* substation from the local power utility (*COELCE – Companhia Energética do Ceará*) located at the municipality of *Marco*, also at *Ceará* state. The transmission line will present an extension of approximately 60 km.

The project contributes to sustainable development since it meets present needs without compromising the ability of future generations to meet their own needs, as defined by the Brundtland Commission (1987)³. In other words, the implementation of wind power plants ensures renewable energy generation, reduces the demand on the national electric system, avoids negative social and environmental impacts caused by fossil fuel fired thermo power plants, and drives regional economies, increasing the quality of life in local communities.

In summary, the proposed project activity will contribute to the sustainable development in the following aspects:

- Reducing air pollutants that are emitted from fossil fuel electricity generation from power plants connected to the Brazilian grid;
- Creating job opportunities during the project construction, operation and maintenance, improving capacities related to wind farms in Brazil through advanced technology transferred from developed countries;
- Efficiently generating electricity, for which there is a growing demand in the country;
- Contributing towards national economic development, adding an Independent Power Producer, leading to energy diversification and creation of additional renewable energy sources;

From the above, it can be concluded that the project has reduced environmental impacts and will develop the regional economy, resulting in better quality of life. In other words, environmental sustainability combined with social and economic justice, undeniably contributing to the host country's sustainable development.

A.3. Project participants:

³ **WCED (1987)**. Our Common Future. The World Commission on Environment and Development. Oxford University Press.

**Table 1:** Party (ies) and private/public entities involved in the project activity.

Name of Party involved (*) ((host) indicates a host Party)	Private and/or public entity(ies) Project participants (*) (as applicable)	Kindly indicate if the Party involved wishes to be considered as project participant (Yes/No)
Brazil (host)	Eólica Mar e Terra Geração e Comercialização de Energia S.A.	No
	Eólica Bela Vista Geração e Comercialização de Energia S.A.	
	Embuaca Geração e Comercialização de Energia S.A.	
	Eólica Icarai Geração e Comercialização de Energia Ltda.	
	Ecopart Assessoria em Negócios Empresariais Ltda. (private entity)	
(*) In accordance with the CDM modalities and procedures, at the time of making the CDM-PDD public at the stage of validation, a Party involved may or may not have provided its approval. At the time of requesting registration, the approval by the Party(ies) involved is required.		

Detailed contact information on party(ies) and private/public entities involved in the project activity listed in Annex 1.

A.4. Technical description of the project activity:

A.4.1. Location of the project activity:

A.4.1.1. Host Party(ies):

Brazil.

A.4.1.2. Region/State/Province etc.:

Mar e Terra and *Areia Branca* Wind Power Plants are located in *Rio Grande do Norte* state.
Embuaca and *Icarai* Wind Power Plants are located in *Ceará* state.

A.4.1.3. City/Town/Community etc.:



Mar e Terra and *Areia Branca* Wind Power Plants are located in *Areia Branca* municipality.
Embuaca Wind Power Plant is located in *Tairi* municipality.
Icarai Wind Power Plant is located in *Amontada* municipality.

A.4.1.4. Details of physical location, including information allowing the unique identification of this project activity (maximum one page):

The geographic coordinates of each site, according to ANEEL Ordinances, are presented in the table below.

Table 2: Wind Power Plants geographic coordinates.

<i>Geographic Coordinates</i>	<i>Mar e Terra⁴</i>	<i>Areia Branca⁵</i>	<i>Embuaca⁶</i>	<i>Icaraí⁷</i>
<i>Longitude (West)</i>	-36.9177	-36.9034	-39.3294	-39.6292
<i>Latitude (South)</i>	-4.9736	-4.9772	-3.2182	-3.0179

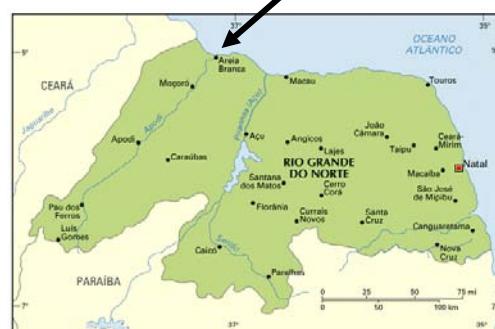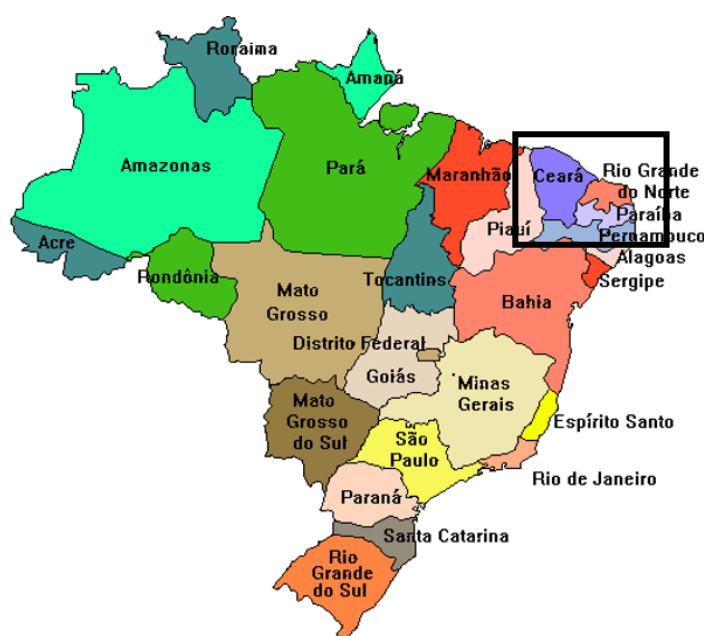

⁴ *Mar e Terra* geographic coordinates are described in ANEEL Ordinance #867, dated October, 25th 2010. The document is publicly available at: < <http://www.aneel.gov.br/cedoc/prt2010867mme.pdf> >. Accessed on August, 18th 2011.

⁵ *Areia Branca* geographic coordinates are described in ANEEL Ordinance #867, dated October, 25th 2010. The document is publicly available at: < <http://www.aneel.gov.br/cedoc/prt2010741mme.pdf> >. Accessed on August, 18th 2011.

⁶ *Embuaca* geographic coordinates are described in ANEEL Ordinance #732, dated August, 17th 2010. The document is publicly available at: < <http://www.aneel.gov.br/cedoc/prt2010732mme.pdf> >. Accessed on August, 18th 2011.

⁷ *Icaraí* geographic coordinates are described in ANEEL Ordinance #601, dated June, 30th 2010. The document is publicly available at: < <http://www.aneel.gov.br/cedoc/prt2010601mme.pdf> >. Accessed on August, 18th 2011.



Figure 1: Ceará and Rio Grande do Norte states location (on the left)⁸ and Trairi (CE)⁹, Amontada (CE)⁹ and Areia Branca (RN)¹⁰ municipalities (on the right)

Furthermore, find below the geographic coordinates of each aerogenerator as described in the wind certification.

Table 3: Geographic coordinates of the aerogenerator's location of the wind power plants.

<i>Aerogenerator</i>	<i>Geographic Coordinates</i>	<i>Mar e Terra WPP</i>	<i>Areia Branca WPP</i>	<i>Embuaca WPP</i>	<i>Icarai WPP</i>
1	Longitude	-36.9164	-36.9024	-39.3280	-39.6231
	Latitude	-4.9629	-4.9626	-3.2054	-3.0329
2	Longitude	-36.9169	-36.9028	-39.3287	-39.6228
	Latitude	-4.9652	-4.9651	-3.2076	-3.0312
3	Longitude	-36.9174	-36.9030	-39.3289	-39.6232
	Latitude	-4.9676	-4.9672	-3.2095	-3.0297
4	Longitude	-36.9179	-36.9042	-39.3292	-39.6231
	Latitude	-4.9699	-4.9703	-3.2119	-3.0278
5	Longitude	-36.9187	-36.9042	-39.3299	-39.6289
	Latitude	-4.9722	-4.9726	-3.2175	-3.0269
6	Longitude	-36.9187	-36.9042	-39.3301	-39.6286
	Latitude	-4.9746	-4.9748	-3.2195	-3.0248
7	Longitude	-36.9197	-36.9036	-39.3302	-39.6347
	Latitude	-4.9769	-4.9773	-3.2216	-3.0244
8	Longitude	-36.9199	-36.9038	-39.3307	-39.6348
	Latitude	-4.9792	-4.9797	-3.2244	-3.0228
9	Longitude	-36.9206	-36.9040	-39.3310	-
	Latitude	-4.9816	-4.9822	-3.2269	-
10	Longitude	-36.9212	-36.9041	-39.3313	-
	Latitude	-4.9842	-4.9846	-3.2290	-
11	Longitude	-36.9215	-36.9043	-39.3318	-
	Latitude	-4.9866	-4.9870	-3.2326	-
12	Longitude	-	-36.9046	-39.3320	-
	Latitude	-	-4.9919	-3.2348	-
13	Longitude	-	-	-39.3325	-
	Latitude	-	-	-3.2372	-

A.4.2. Category(ies) of project activity:

Sectoral Scope: 1 - Energy industries (renewable - / non-renewable sources).

⁸ Available at: < <http://www.portalsaofrancisco.com.br/alfa/brasil-mapas/>>.

⁹ Ceará Mapas. Available at: < http://www.ceara.com.br/cepg/mapa_ceara.htm>.

¹⁰ Portal São Francisco. Rio Grande do Norte. Available at: < <http://www.portalsaofrancisco.com.br/alfa/brasil-mapas/mapa-do-rio-grande-do-norte.php>>.



Category: Renewable electricity generation for a grid.

A.4.3. Technology to be employed by the <u>project activity</u>:

The project activity is the construction of four wind power plants summing 94.5 MW of installed capacity. The technology to be employed by each of the sites considered in this project activity is described in Table 4.

Table 4: Project technical description according to the Wind Certification and Suzlon's brochure¹¹.

Wind Power Plant		Mar e Terra		Areia Branca		Embuaca		Icarai
Turbines								
General	Model	S88	S95	S88	S95	S88	S95	S88
	Quantity	10	1	4	9	8	5	8
	Nominal Power (MW)	2.1	2.1	2.1	2.1	2.1	2.1	2.1
	Installed capacity (MW)	23.1		27.3		27.3		16.8
	Manufacturer	Suzlon Energy Limited		Suzlon Energy Limited		Suzlon Energy Limited		Suzlon Energy Limited
Rotor	Diameter (m)	88	95	88	95	88	95	88
	Hight (m)	100	90	80	90	100	90	80
	Area swept (m²)	6,082	7,085	6,082	7,085	6,082	7,085	6,082
	Nominal revolutions (rpm)	15 to 17.6	12 to 18	15 to 17.6	12 to 18	15 to 17.6	12 to 18	15 to 17.6
	Number of blades	3	3	3	3	3	3	3
Operational data	Cut-in wind speed (m/s)	4	3.5	4	3.5	4	3.5	4
	Cut-out wind speed (m/s)	25	25	25	25	25	25	25
	Rated wind speed (m/s)	14	11	14	11	14	11	14
Generators								
General	Nominal output (kW)	2,100	2,100	2,100	2,100	2,100	2,100	2,100
	Quantity	10	1	4	9	8	5	8
	Frequency (Hz)	60	60	60	60	60	60	60

¹¹ Turbine's specifications. Available at: <http://www.suzlon.com/>. Accessed on December, 22nd 2011.



	Tension (V)	600	600	600	600	600	600	600
--	-------------	-----	-----	-----	-----	-----	-----	-----

The equipment and technology utilized in the proposed project activity has been applied to similar projects all over the world.



Figure 2: Suzlon's turbine (Source: Suzlon website, 2010¹²)

A.4.4. Estimated amount of emission reductions over the chosen crediting period:

The full implementation of proposed project activity, considering the wind power plants new configuration, will generate the estimated annual reductions as related in Table 5 below.

Table 5: Project Emissions Reductions Estimation

Years*	Annual estimation of emission reductions in tonnes of CO₂e
2013	75,707
2014	75,707
2015	75,707
2016	75,707
2017	75,707
2018	75,707
2019	75,707
2020	75,707
2021	75,707
2022	75,707
Total estimated reductions (tonnes of CO₂e)	757,070

¹² Available at: < <http://www.suzlon.com/products/12.aspx?11=2&12=9>>.



Total number of crediting years	10
Annual average over the crediting period of estimated reductions (tonnes of CO ₂ e)	75,707

**From January, 1st 2013 until December, 31st 2022*

A.4.5. Public funding of the project activity:

This project does not receive any public funding and it is not a diversion of ODA.

SECTION B. Application of a baseline and monitoring methodology

B.1. Title and reference of the approved baseline and monitoring methodology applied to the project activity:

ACM0002 - “Consolidated baseline methodology for grid-connected electricity generation from renewable sources” (Version 12.3.0).

- Tool to calculate the emission factor for an electricity system (version 2.2.1);
- Tool for the demonstration and assessment of additionality (version 6.0.0);
- Tool to calculate project or leakage CO₂ emissions from fossil fuel combustion (version 2);
- Combined tool to identify the baseline scenario and demonstrate additionality (version 4.0.0).

The *Combined tool to identify the baseline scenario and demonstrate additionality* and the *Tool to calculate project or leakage CO₂ emissions from fossil fuel combustion* are not applicable to the project activity, and therefore are not used.

B.2. Justification of the choice of the methodology and why it is applicable to the project activity:

The applicability conditions of ACM0002 are all fulfilled by the proposed project activity as further detailed below.

According to this methodology, it is applicable to grid-connected renewable power generation project activities that (a) install a new power plant at a site where no renewable power plant was operated prior to the implementation of the project activity (greenfield plant); (b) involve a capacity addition; (c) involve a retrofit of (an) existing plant(s); or (d) involve a replacement of (an) existing plant(s).

The proposed project activity comprises four greenfield plants corresponding to option a).

The methodology also provides the following conditions:

- The project activity is the installation, capacity addition, retrofit or replacement of a power plant/unit of one of the following types: hydro power plant/unit (either with a run-of-river reservoir or an



accumulation reservoir), wind power plant/unit, geothermal power plant/unit, solar power plant/unit, wave power plant/unit or tidal power plant/unit;

The proposed project activity is the installation of four new wind power plants.

- *In the case of capacity additions, retrofits or replacements (except for capacity addition projects for which the electricity generation of the existing power plant(s) or unit(s) is not affected): the existing plant started commercial operation prior to the start of a minimum historical reference period of five years, used for the calculation of baseline emissions and defined in the baseline emission section, and no capacity addition or retrofit of the plant has been undertaken between the start of this minimum historical reference period and the implementation of the project activity;*

Not applicable. The proposed project activity does not correspond to a capacity addition, retrofit or replacement.

- *In case of hydro power plants, at least one of the following conditions must apply:*
 - *The project activity is implemented in an existing single or multiple reservoirs, with no change in the volume of any of the reservoirs; or*
 - *The project activity is implemented in an existing single or multiple reservoirs, where the volume of any of reservoirs is increased and the power density of each reservoir, as per definitions given in the Project Emissions section, is greater than 4 W/m² after the implementation of the project activity; or*
 - *The project activity results in new single or multiple reservoirs and the power density of each reservoir, as per definitions given in the Project Emissions section, is greater than 4 W/m² after the implementation of the project activity.*

Not applicable. The proposed project activity does not correspond to a hydropower plant.

- *In case of hydro power plants using multiple reservoirs where the power density of any of the reservoirs is lower than 4 W/m² after the implementation of the project activity all of the following conditions must apply:*
 - *The power density calculated for the entire project activity using equation 5 is greater than 4 W/m²;*
 - *All reservoirs and hydropower plants are located at the same river and where are designed together to function as an integrated project that collectively constitutes the generation capacity of the combined power plant;*
 - *The water flow between the multiple reservoirs is not used any other hydropower unit which is not a part of the project activity*
 - *The total installed capacity of the power units, which are driven using water from the reservoirs with a power density lower than 4 W/m², is lower than 15 MW;*



- *The total installed capacity of the power units, which are driven using water from reservoirs with a power density lower than 4 W/m², is less than 10% of the total installed capacity of the project activity from multiple reservoirs.*

Not applicable. The proposed project activity does not correspond to a hydropower plant.

Finally, the methodology has the following restrictions – *i.e.* project activities may not be applicable in the following cases:

- *Project activities that involve switching from fossil fuels to renewable energy sources at the site of the project activity, since in this case the baseline may be the continued use of fossil fuels at the site;*
- *Biomass fired power plants;*
- *A hydro power plant that result in the creation of a new single reservoir or in the increase in an existing single reservoir where the power density of the reservoir is less than 4 W/m².*

The project is still applicable for the use of ACM0002 since it does not correspond to any of the restrictions listed above. In addition to the applicability conditions of the ACM0002 methodology, the applicability conditions of the tools used must also be assessed.

In order to estimate the baseline emissions occurring after the implementation of the proposed project activity the “*Tool to calculate the emission factor for an electricity system*” is used. This tool provides the steps required to estimate the CO₂ emission factor, which consists of a “*combined margin*”, for the displacement of electricity generated by plants connected to an electric grid.

As further described below in section B.6.1, off-grid power plants are not considered. Hence, the requirements of Annex 2 of the tool, referring to the applicability conditions that shall be met when this kind of plants are considered, is not applicable. Besides, the Brazilian Electric System is neither partially nor totally located in any Annex-I country.

In this sense, it can be concluded that there are no applicability conditions preventing the use of this tool to estimate the CO₂ emission factor of the Brazilian Electricity System in the context of the proposed project activity.

B.3. Description of the sources and gases included in the project boundary:

According to ACM0002, *the spatial extent of the project boundary includes the project power plant and all power plants connected physically to the electricity system that the CDM project power plant is connected to.*

On May 26th, 2008, the Brazilian Designated Authority published Resolution #8¹³ defining the Brazilian Interconnected Grid as a single system covering all five geographical regions of the country (North, Northeast, South, Southeast and Midwest).

¹³ Comissão Interministerial de Mudança Global do Clima (CIMGC). Available at: http://www.mct.gov.br/upd_blob/0024/24719.pdf.

The figure below is a representation of the project boundary.

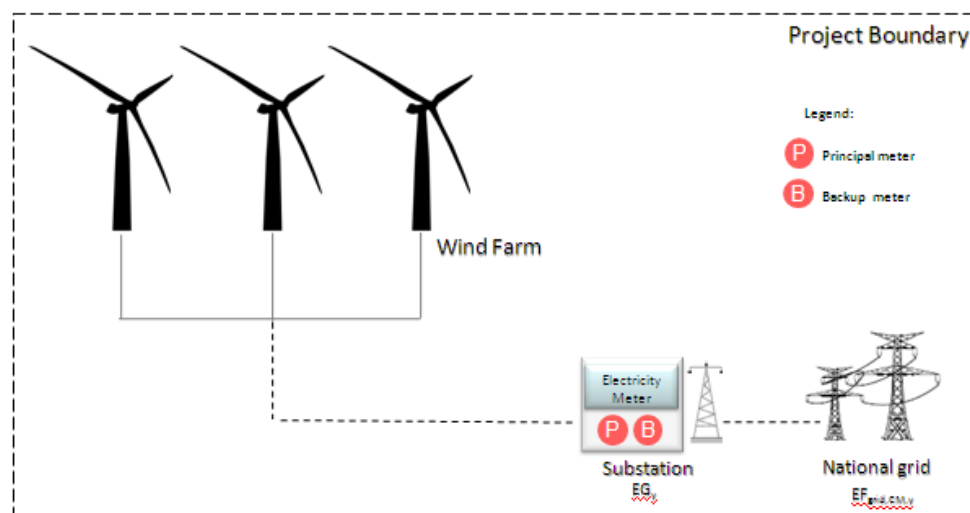


Figure 3: Project boundary

The greenhouse gases and emission sources included in or excluded from the project boundary are shown in the table below.

Table 6: Emissions sources included or excluded in the project boundary

	Source	Gas	Included?	Justification/Explanation
Baseline	CO ₂ emissions from electricity generation in fossil fuel fired power plants that are displaced due to the project activity.	CO ₂	Yes	Main emission source.
		CH ₄	No	Minor emission source.
		N ₂ O	No	Minor emission source.
Project Activity	For geothermal power plants, fugitive emissions of CH ₄ and CO ₂ from non-condensable gases contained in geothermal steam.	Not applicable.		
	CO ₂ emissions from combustion of fossil fuels for electricity generation in solar thermal power plants and geothermal power plants	Not applicable.		
	For hydro power plants, emissions of CH ₄ from the reservoir.	Not applicable.		

B.4. Description of how the baseline scenario is identified and description of the identified baseline scenario:

The project activity is the installation of a new grid-connected renewable power plant/unit. Therefore, according to ACM0002, the baseline scenario is the following:



“Electricity delivered to the grid by the project activity would have otherwise been generated by the operation of grid-connected power plants and by the addition of new generation sources, as reflected in the combined margin (CM) calculations as described in the “Tool to calculate the emission factor for an electricity system”.

B.5. Description of how the anthropogenic emissions of GHG by sources are reduced below those that would have occurred in the absence of the registered CDM project activity (assessment and demonstration of additionality):

The identified starting date of the proposed project activity is 20/08/2010, which represents the date when the Power Purchase Agreement (PPA) of *Icarai* wind power plant was signed. For details on how the project starting date was identified please refer to Section C.1.1.

In accordance with the “*Guidelines in the demonstration and assessment of prior consideration of the CDM*” (Annex 22, EB49), for projects activities with a starting date on or after 02 August 2008, Project Participants must notify the host country DNA the UNFCCC secretariat of their intention to seek CDM status within six months of the project activity start date. Considering that the PDD was published for Global Stakeholder Process (GSP) after this date, Project Participants have forwarded the Prior Consideration of the CDM Form (F-CDM-Prior consideration) both for the Brazilian Designated National Authority and to UNFCCC secretariat on March 16th 2010. The forms as well as the confirmation are available under request and will be presented to the DOE validating the project.

Besides, Project Participants held a timeline for the wind power plants with the main dates of actions for the project implementation (Table 7).

Table 7: Actions related to Mar e Terra, Areia Branca, Embuaca and Icarai wind power plants.

Actions	Mar e Terra	Areia Branca	Embuaca	Icarai
Power Purchase Agreement (PPA)	03/11/2010	13/10/2010	13/10/2010	20/08/2010
Major Equipment Orders – EPC Contract signature	30/11/2010	30/11/2010	30/11/2010	30/11/2010
Construction License Issuance	12/05/2011	12/05/2011	11/10/2011	26/12/2011
Starting Date of Construction	16/11/2011	16/11/2011	30/04/2012*	30/04/2012*
Financing Agreement	21/11/2011	21/11/2011	21/11/2011	21/11/2011



Starting date of operation*	07/08/2012	07/08/2012	05/12/2012	30/12/2012
-----------------------------	------------	------------	------------	------------

* Estimated

The additionality of the proposed project activity will be assessed and demonstrated through the application of the “*Tool for the demonstration and assessment of additionality*”. This tool provides 4 steps to determine whether the project activity is additional or not, which are further detailed below.

Step 1. Identification of alternatives to the project activity consistent with current laws and regulation

Sub-step 1a. Define alternatives to the project activity:

Scenario 1: continuation of the current (previous) situation of electricity supplied by the Brazilian Interconnected Grid.

Scenario 2: The proposed project activity undertaken without being registered as a CDM project activity.

Sub-step 1b. Consistency with mandatory laws and regulations:

Both alternative scenarios identified above are in compliance with all regulations according the following entities: National Electric System Operator (ONS from the Portuguese *Operador Nacional do Sistema Elétrico*), Electricity Regulatory Agency (ANEEL from the Portuguese *Agência Nacional de Energia Elétrica*), Rio Grande do Norte Environmental Agency (IDEMA – from the Portuguese *Instituto de Desenvolvimento Sustentável e Meio Ambiente do Rio Grande do Norte*), Ceará State Environmental Agency (SEMACE - from the Portuguese *Superintendência Estadual do Meio Ambiente*) and the CDM Executive Board.

In order to obtained detailed information about the regulations that the project activity and the proposed scenarios are in compliance with Brazilian Regulations in electrical and environmental sectors, refer to Section B.7.2 – *Description of the monitoring plan* – and Section D.1 – *Documentation on the analysis of the environment impacts, including transboundary impact* – above which describe the procedures established by ONS applied by the project activity and the environmental norms and laws that the project activity complies to, respectively.

SATISFIED/PASS – Proceed to Step 2

Step 2. Investment analysis

Sub-step 2a. Determine appropriate analysis method:

Additionality is demonstrated through an investment benchmark analysis (option III). Options I and II are not applicable to the proposed project activity considering the following:



Option I – both the CDM project activity and the alternatives identified in Step 1 generate financial and economic benefits other than CDM related income.

Option II – the implementation of other project types of renewable energy generation - *i.e.* cogeneration or small hydro power plant projects - are not potential alternatives in the site where the project is planned.

In addition, in accordance with paragraph 19, Annex 5, EB62, the benchmark analysis was identified as the most appropriate method to demonstrate the additionality of the proposed CDM Project Activity since the alternative to the implementation of the wind power plant is the supply of electricity from the grid.

Sub-step 2b - Option III - benchmark analysis

The financial indicator identified for the project activity is the Internal Rate of Return (IRR) calculated in the project cash-flow. The IRR here presented is compared to the appropriate benchmark of the electric sector, which is the Weighted Average Cost of Capital (WACC).

Sub-step 2c: Calculation and comparison of financial indicators

Weighted Average Cost of Capital (WACC)

The weighted-average cost of capital (WACC) is a rate used to discount business cash flows and takes into consideration the cost of debt and the cost of equity of a typical investor in the sector of the project activity. The benchmark can be applied to the cash flow of the project as a discount rate when calculating the net present value (NPV) of the same, or simply by comparing its value to the internal rate of return (IRR) of the project (in accordance with paragraph 12, Annex 5, EB 62). The WACC considers that shareholders expect compensation towards the projected risk of investing resources in a specific sector or industry in a particular country.

The WACC calculation is based on parameters that are standard in the market, considers the specific characteristics of the project type, and is not linked to the subjective profitability expectation or risk profile of this particular project developer. Once a wind power potential is discovered, any corporate entity is able to obtain the authorization from the government to build a wind power plant. In addition to that, even after the project proponent obtains such authorization, it can be negotiated afterwards. Therefore, the use a sectoral benchmark is applicable as per the guidance provided in paragraph 13, Annex 5, EB62.

The WACC of the sector considered is the one calculated for 2010 – *i.e.* commencement of CDM Project Activity development – and is equal to 11.65%. This value was calculated through the formula below:

$$WACC = Wd \times Kd + We \times Ke$$

We and **Wd** are, respectively, the weights of equity and debt typically observed at the sector. **We** is of 32.32%, and **Wd** of 67.68%. These numbers derive from the typical leverage of similar projects in the sector



in Brazil, based on the rules for available long term loans from Brazilian Development Bank (BNDES - from the Portuguese Banco Nacional de Desenvolvimento Econômico e Social)¹⁴. BNDES is the major provider of long-term loans in the country; it supplies the financing for small to large scale projects. Long-term loans are scarcely provided by commercial banks, and in general, these entities do not have competitive rates compared to the BNDES.

Kd is the cost of debt, which is observed in the market related to the project activity, and which already accounts for the tax benefits of contracting debts. In the **Kd** calculation, the marginal tax rate (**t**) is multiplied by the Cost of debt and then by the debt to total cost of capital ratio to ascertain the debt portion of the WACC formula. In the case of Brazil, and specifically to energy projects, this tax factor could either be 34% or 0%. This is decided by the specific type of project and tax regime under which it sits. In the case of the proposed project activity, the 0% tax factor applies. This method for calculating the corporate income tax and social contribution is called Presumed Profit (detailed explanations are provided while calculating financial indicator below).

The Wind Power Plants of this project activity are considered a post-tax cash flow. Thus, it must be compared against a sectorial post-tax benchmark (Weighted Average Cost of Capital - WACC). The companies opting for the Presumed Profit System do not benefit from the cash and non-cash items deductions (as further detailed in the financial indicator calculation section below). Therefore, in the calculation for the cost of debt the marginal tax is zero. This results in a pre-tax WACC percentage equal to a post-tax WACC percentage, as follows:

$$\text{Post-tax Rate} = (\text{Pre-tax Rate} \times (1 - \text{Marginal Tax}))$$

Therefore, if marginal tax is 0 (zero) (Presumed Profit scheme), Post-tax rate is equal to Pre-tax rate. Thus, the post-tax Cost of Debt is added in the WACC calculation reaching a post tax WACC in accordance with the post-tax cash flow as recommended in paragraph 11 of Annex 5, EB62.

The nominal rate achieved for debt is used to calculate nominal WACC, which is used to discount nominal cash flow projections. In order to achieve the real cash flow rate, the inflation targeting figure (**d**) for Brazil is reduced from the nominal figure achieved. The (**d**) is obtained from the Brazilian Central Bank (www.bcb.gov.br) and has experienced very little variance in the past 5 years.

Kd is calculated through the following equation:

$$Kd = [1 + (a+b+c) \times (1-t)] / [(1+d) - 1]$$

Values used in the cost of debt calculation are presented in Table 8.

Table 8: Cost of debt (Kd) calculation

Cost of Debt (Kd)

¹⁴ http://www.canalenergia.com.br/zpublisher/secoes/Especial_Biblioteca.asp?IDE=14.



(a) Financial cost ¹⁵	6.44%
(b) BNDES fee ¹⁶	0.90%
(c) Credit risk rate ¹⁷	3.57%
(a+b+c) Pre-Cost of Debt	10.91%
(t) Marginal tax rate ¹⁸	0.00
(d) Inflation forecast ¹⁹	4.50%
After tax Cost of Debt	6.14%p.a.

According to the table above, **Kd** is of 6.14%.

Ke is the cost of equity. As per option b) provided in the paragraph 15 of Annex 15, EB 62, it was estimated using the best financial practices through the Capital Asset Pricing Model (CAPM) with the following equation:

$$K_e = [(1 + R_f) / (1 + I) - 1] + \beta \times (R_m - R_f) + R_c$$

Rf stands for the risk free rate. The risk-free rate used for **Ke** calculation was a long term bond rate. This bond was issued by the Brazilian government, denominated in US dollars. Therefore the rate includes the Brazilian country risk. There is a higher risk associated to investing in Brazil, or in Brazilian bonds, compared to investing in a mature market such as the United States. This risk is reflected in higher returns expected on Brazilian government bonds compared to the mature markets government bonds. In considering the Brazilian government bond, this premium for a higher risk is captured in our calculations.

In order to adjust the risk-free rate (**Rf**) to the inflation adjusted rate, the expected inflation rate (for the United States) (π') is reduced. The inflation is calculated based on the treasury through spot TIPS (Treasury Inflation Protected Securities) which are readily quoted in the market. There is no need to adjust for Brazil's expected inflation when dealing with a hurdle rate in real terms.

Beta, or β , stands for the average sensitivity of comparable companies in that industry to movements in the underlying market. β derives from the correlation between returns of US companies from the sector and the performance of the returns of the US market. β has been adjusted to the leverage of Brazilian companies in the sector, reflecting both structural and financial risks. β adjusts the market premium to the sector.

¹⁵

http://www.bndes.gov.br/SiteBNDES/bndes/bndes_pt/Institucional/Apoio_Financeiro/Custos_Financeiros/Taxa_de_Juros_de_Longo_Prazo_TJLP/index.html

¹⁶ http://www.bndes.gov.br/SiteBNDES/export/sites/default/bndes_pt/Galerias/Arquivos/conhecimento/bnset/Set2901.pdf

¹⁷ http://www.bndes.gov.br/SiteBNDES/export/sites/default/bndes_pt/Galerias/Arquivos/conhecimento/bnset/Set2901.pdf

¹⁸ <http://www.receita.fazenda.gov.br/Aliquotas/ContribCsl/Aliquotas.htm>

¹⁹ <http://www.bcb.gov.br/pec/metad/InflationTargetingTable.pdf>

R_m represents the market premium, or higher return, expected by market participants in light of historical spreads attained from investing in equities versus risk free assets such as government bond rates, investors require a higher return when investing in private companies. The market premium is estimated based on the historical difference between the S&P 500 returns and the long term US bonds returns. The spread over the risk-free rate is the average of the difference between those returns.

Note that in the formula above there is the factor EMBI+ (Emerging Markets Bond Index Plus), considers as the country risk premium, **R_c**. This factor accounts for the country or sovereign risk embedded in the debt of a country. Assuming that relative to the US risk-free debt market EMBI+ is 0, then Brazil's EMBI+ would calculate for the added or reduced risk relative of Brazil's debt markets to the US.

Justification for the EMBI+ addition to the risk-free rate lies in the vast differences between the United States in such factors as credit risk, inflation history, politics, debt markets, and more. Ignoring these differences would result in the incorrect application of relevant environmental factors in the decision-making process of an investor in Brazil.

Values used in the cost of equity calculation are presented in Table 9 below:

Table 9: Cost of equity (K_e) calculation

Cost of Equity (K_e) – CAPM	
(R _f) Risk-free rate ²⁰	3.45%
(R _m) Equity risk premium ²¹	6.58%
(R _c) Estimated country risk premium ²²	2.58%
(β) Adjusted industry beta ²³	2.91%
(I) US expected inflation ²⁴	1.96%
Cost of Equity with Brazilian Country Risk (p.a.)	23.20%p.a.

According to the table above, K_e is of 23.20%.

Plugging these numbers into WACC formulae, we obtain:

$$\text{WACC} = 67.68\% \times 6.14\% + 32.32\% \times 23.20\% = 11.65\%$$

Each assumption made and all data used to estimate the benchmark has been presented to the DOE. The spreadsheet used for calculation of the WACC is available with the Project Participants and has also been

²⁰ <http://pages.stern.nyu.edu/~adamodar/>

²¹ <http://pages.stern.nyu.edu/~adamodar/>

²² http://www.cbonds.info/all/eng/index/index_detail/group_id/1/

²³ <http://pages.stern.nyu.edu/~adamodar/>



provided to the DOE. For complete reference of the data used to estimate the benchmark please refer to this spreadsheet, which is also attached to this PDD.

Financial Indicator, Internal rate of return (IRR)

As mentioned above, the financial indicator identified for the Project Activity is the project Internal Rate of Return (IRR). According to the Guidance 3 of the “*Guidelines on the Assessment of Investment Analysis*” (EB 62, Annex 5), the period of assessment should not be limited to the proposed crediting period of the CDM project activity. The calculation shall as a preference reflects the period of the wind power plants expected operational lifetime determined by the aerogenerators, which is estimated in 20 years. Furthermore, the auction public notice states that the electric power negotiated at the 2nd Reserve Energy Auction (from the Portuguese 2^o *Leilão de Energia de Reserva - LER*) present a PPA which lasts 20 years. Therefore, considering the expected operational lifetime of the aerogenerators and also the period estimated in the PPA, *Mar e Terra*, *Areia Branca*, *Embuaca* and *Icarai* wind power plants cash flows, present the investment analysis considering 20 years.. The IRR of the projects are 3.79%, 6.13%, 8.81% 5.16%, respectively. Sources of all input values used to estimate the IRR of the project are detailed in the IRR calculation spreadsheet, which is also attached to this PDD.

The paragraph 6 from the “*Guidelines on the Assessment of Investment Analysis*” (EB 62, Annex 5) states that: “*Input values used in all investment analysis should be valid and applicable at the time of the investment decision taken by the project participant*”. Considering that the Power Purchase Agreement (PPA) signature of *Icarai* wind power plant is the time that project participants compromise themselves in implement the project activity, the input values applied in the investment analysis refer to that time, *i.e.*, the year of 2010.

In Brazil, there are two income taxes: (a) the corporate income tax (IRPJ) and (b) the social contribution tax on profits (CSLL) (see KPMG report “*Investment in Brazil*”²⁵). There are also three methods provided by legislation to calculate corporate income tax and social contribution tax due on profits: Actual Profit, Presumed Profit and Arbitrated Profit.

For the Presumed Profit eligibility, corporate entities revenues must be under R\$ 48 million per year (Article #13, Law #9.718/1998)²⁶. Since *Mar e Terra*, *Areia Branca*, *Embuaca* and *Icarai* revenues are under R\$ 48 million per year, they were able to choose for the Presumed Profit system. For the Presumed Profit system, 8% of gross sales in addition to financial revenues/earnings are used as basis for the income tax calculation. To this figure a 25% rate is applied resulting in the final income tax value. For the social contribution calculation 12% of gross sales in addition to financial revenues/earnings are used as a basis for the calculation. To this figure a 9% rate is applied resulting in the final social contribution value as per Article #518 of the Federal Decree #3000, dated 26 March 1999. Please, see as an example.

²⁴ <http://www.federalreserve.gov/econresdata/researchdata.htm>

²⁵ KPMG. *Investment in Brazil: tax*. São Paulo: Escrituras Editora, 2008. Publicly available in English at: http://www.kpmg.com.br/publicacoes/livros_tecnicos/Investment_in_Brazil10_out08.pdf.

²⁶ Publicly available in Portuguese at: <http://www.receita.fazenda.gov.br/legislacao/leis/Ant2001/lei971898.htm>.

Table 10: Income Tax and Social Contribution (illustrative calculation)

Income Tax	\$
Gross Sales	1.000
Presumed Profit for income tax (8%)	80
Financial revenue	500
Total Presumed for income tax	580
Income tax due (app. 25%)	145
Social contribution	
Gross Sales	1.000
Presumed Profit for social contribution (12%)	120
Financial revenue	500
Total Presumed Profit for social contribution	620
Social contribution due (9%)	55.80

Source: KPMG. "Investment in Brazil: tax." (2008)²³.

Therefore, a corporate entity that opts for the presumed profit scheme pays the same rate of income tax and social contribution regardless of its costs, expenses, other cash items such as payable interest and non-cash items such as depreciation, because these elements are not deductible under this system.

The relevant assumptions made are in accordance with paragraph 6 of the *Guidelines on the Assessment of Investment Analysis* (version 05). The table presented below provides a summary of the main input values as well as a brief justification for their use, considering the time of the investment decision. Documents evidencing all input values mentioned below which were used to estimate the IRR, were supplied to the DOE. Besides, the IRR calculation spreadsheet presenting all values and assumptions considered is also attached to this PDD.

**Table 11:** Data and justification of the data used in the investment analysis and comparison c between Project's IRR and WACC of the sector

Parameter	Mar e Terra	Areia Branca	Embuaca	Icaraí	Justification/source of information used
<i>Installed Capacity (MW)</i>	23.10	27.30	25.20	14.40	Based on the available data from the 2 nd Energy Reserve Auction (from the Portuguese <i>2º Leilão de Energia de Reserva – LER</i>). Also, the ANEEL Ordinances of the wind power plants states the installed capacity of the wind power plants. Please, refer to the documents “ <i>Mar e Terra_PIE.pdf</i> ” “ <i>Areia Branca_PIE.pdf</i> ” “ <i>Embuaca_PIE.pdf</i> ” “ <i>Icaraí_PIE.pdf</i> ”.
<i>Guaranteed power output (MW)</i>	8.00	11.00	11.00	7.00	The guaranteed power output applied in the investment analysis is based on the negotiated electricity defined at the Power Purchase Agreement of each wind power plant.
<i>Plant Load Factor (%)</i>	35.93	42.86	44.05	54.17	Determined dividing the assured energy determined in the PPA, by the total installed capacity. This parameter is used to estimate the electricity generated by the plant.
<i>PPA price (R\$/MWh)</i>	157.37	157.36	155.75	155.76	This value represents the price of the PPA, as submitted and obtained by the project owner in the 2 nd Reserve Energy Auction (from the Portuguese <i>2º Leilão de Energia de Reserva - LER</i>), which occurred on December, 14 th 2009. The electricity tariff will be adjusted by the <i>IPCA</i> index from the first month after the auction until the project investment decision, which is August, 2010. Please refer to the cash flow spreadsheet of the wind power plants for the exact value used. The tariff obtained by the project sponsor is publicly available at www.ccee.org.br .
<i>TUST (BRL/kW.month)</i>	100% of 7.84	100% of 7.84	100% of 5.913	100% of 5.913	In Brazil, electricity producers using renewable sources receive a 50% discount in the Tariff for the Use of the



					<p>Transmission System - TUST fee (from the Portuguese <i>Tarifa de Uso do Sistema de Transmissão</i>). This discount aims at boost investments in renewable energy projects and shall be considered as a Type E- policy as defined by Annex 3, EB 22. Additionally, according to this clarification, type E- policies²⁷ do not need to be considered in the development of the baseline scenario if implemented after 11 November 2001. The reduction in the TUST fee was regulated by the Law 10 438, dated 26/04/2002²⁸. Therefore, the discount is not going to be taken into account.</p> <p>The TUST value applied for the wind power plants are established at ANEEL Resolution nr. 907, dated November, 10th 2009. Available at: http://www.aneel.gov.br/cedoc/reh2009907.pdf</p>
<i>Insurance(% of investment)</i>	0.66%	0.61%	0.64%	0.71%	The value applied was proposed according to the project participant experience and studies developed at the sector. Please, refer to the attached spreadsheet “ <i>Premissas_MS</i> ” to accesses the information.
<i>Property lease (% of gross revenue)</i>	1.7%	1.7%	1.5%	1.5%	The land rent was determined by a contract signed between the land owner and the energy producer company (from the Portuguese <i>Contrato de Concessão de Uso</i>).
<i>CCEE fee (BRL/MWh)</i>	0.11	0.11	0.10	0.07	The CCEE fee is based on paragraph 4 of article 4 of Law nr. 10,848, dated March 15 th 2004 and regulated by the Decree nr. 5,177 dated August, 12 th 2004. The fee varies year to year and is estimated dividing the CCEE costs (operational and

²⁷ From paragraph 6.b) of Annex 3, EB 22 Type E- policies are *National and/or sectoral policies or regulations that give comparative advantages to less emissions-intensive technologies over more emissions-intensive technologies (e.g. public subsidies to promote the diffusion of renewable energy or to finance energy efficiency programs)*.

²⁸ Available in Portuguese at <http://www.aneel.gov.br/cedoc/lei200210438.pdf>. Accessed on 28/04/2011.



					investment) by the electricity produced and dispatched in the Interconnected Electricity System (from the Portuguese <i>Sistema Interligado Nacional – SIN</i>) [MWh] dividing proportionally by each energy producer. Please, refer to the attached spreadsheet “ <i>Premissas_MS</i> ” to access the information.
<i>ONS fee (BRL/kW)</i>	0.69	0.59	0.59	0.91	The <i>ONS</i> fee is based in the Article 13 of the law nr. 9,648, dated May 27 th 1998. Please, refer to the attached spreadsheet “ <i>Premissas_MS</i> ” to access the <i>ONS</i> fee calculation.
<i>ANEEL fee – TFSEE (BRL/kW)</i>	363.60	363.60	363.60	363.60	It corresponds to the value fixed by ANEEL regarding the Supervision Tax on Electricity Power Services (from the Portuguese <i>Taxa de Ficalização de Serviços de Energia Elétrica – TFSEE</i>) implemented by the Law nr. 9,427, dated December, 12 th 1996 and regulated by the Decree nr. 2,410 issued on November, 28 th 1997. The TFSEE aims to compose the ANEEL revenue in order to cover its administrative and operational costs. The Dispatch nr. 4,774, dated December, 22 nd 2009 defined the available data for <i>TFSEE</i> at the time of the investment decision, <i>i.e.</i> , for 2010.
<i>Taxes (PIS/COFINS) (BRL/year)</i>	390,441	536,821	531,334	338,144	The revenue deductions concerns to the Integration Social Program (from the Portuguese <i>Programa de Integração Social – PIS</i>) given by Law nr. 10,637 ²⁹ , dated December, 30 th 2002 and the Contribution to the Social Security Financing (from the Portuguese <i>Contribuição para o Financiamento da Seguridade Social - COFINS</i>) given by Law nr. 10,833 ³⁰ , dated, December, 29 th 2003.

²⁹ Available at: http://www.planalto.gov.br/ccivil_03/leis/2002/L10637.htm

³⁰ Available at: http://www.planalto.gov.br/ccivil_03/leis/2003/L10.833.htm



<i>Deduction (Income Tax and Social Contribution) (BRL/year)</i>	305,468	428,989	424,359	261,338	The Income Tax percentage is determined by the Decree nr. 3,000 ³¹ , dated March, 26 th 1999, in its Article #518. The Social Contribution percentage is given by the Law 11,727 ³² , dated June, 23 rd 2008 in its Article #17.
<i>O&M Costs(BRL/year)</i>	522,590	616,473	864,915	507,130	The O&M is determined by he Annex 16 of the EPC Contract signed on November, 30 th 2010. Considering that the value informed is related to the October, 2010, the <i>IPCA</i> index was applied to deflate the investment to the date of the investment decision, which is August, 2010.
<i>Investment (1,000BRLBRL)</i>	96,327	114,610	101,383	84,052	The investment value applied is defined by the SUDENE letter. It represents the total costs related to the wind power plans including the EPC Contract, the project development costs, environmental studies, the transmission line installation costs and administrative expenses. Considering that the value informed is related to the year of 2011, the <i>IPCA</i> was applied to deflate the investment to the date of the investment decision, which is August, 2010 ³³ .
<i>IRR (%)</i>	3.79	6.13	8.81	5.16	See the IRR's spreadsheets attached.

³¹ Available at: http://www.planalto.gov.br/ccivil_03/decreto/d3000.htm

³² Available at: <http://www.receita.fazenda.gov.br/Legislacao/Leis/2008/lei11727.htm#Art. 17>.

³³ Total investment costs are based on the funding request letter from July 2011 and deflated to the investment decision date. This was done due to the fact that only internal information was available at the time of investment decision date. To demonstrate the suitability of the procedure the PPs call the attention to the following: a) decrease of total investment costs in the period (HSBC, 2010. Becalmed? – page 2), and b) available wind power generator proposal with prices for the wind turbines (1.8MW) of R\$ 5,767,500, i.e., total investment cost of BRL 4,570/kW in April 2010 (taking into account that turbines average share of total costs of 70% from EWEA, 2009. The Economics of wind power – page 201). Considering that the average total investment cost used in the project activity is smaller and more conservative - BRL 4,400/kW - it can be confirmed that the values used in the investment analysis are not only aligned with figures available at the time of investment decision but, being more conservative, fully in accordance with the VVM guidelines.



WACC (%)	11.65		See the WACC's spreadsheet attached.
----------	-------	--	--------------------------------------

The project IRR, as presented to the DOE, ranges from 3.79 to 8.81%, i.e., lower than the WACC of the sector. Therefore, this number shows that the project activity is not financially attractive to the investor. The results are summarized in the table below:

Table 12: Comparison between Project IRR and the Weighted Average Cost of Capital

Wind Power Plant	IRR (%)	WACC (%)
<i>Mar e Terra</i>	3.79	11.65
<i>Areia Branca</i>	6.13	
<i>Embuaca</i>	8.81	
<i>Icarai</i>	5.16	

Sub-step 2d: Sensitivity analysis

A sensitivity analysis was conducted by altering the following parameters:

- Increase in electricity generation, which may increase the project revenues;
- Increase in electricity tariff, which may also influence project revenues;
- Reduction in expected investments;
- Reduction in O&M costs.

Those parameters were selected as being the most likely to fluctuate over time. In addition, these variables constitute more than 20% of either total project costs or total project revenues (paragraph 20 of Annex 5, EB62). As verified at the wind power plant cash flows the revenue is obtained exclusively from the energy generation. Therefore the sensitivity analysis carried out considering the variation in the electricity generation and the electricity tariff corresponds to more than 20% of the total revenues.

The investment, also considered in the sensitivity analysis corresponds to the total investment of the wind power plants including the EPC Contract costs and project developments costs as explained at Table 11 above.

The O&M costs of *Mar e Terra*, *Areia Branca*, *Embuaca* and *Icarai* wind power plants corresponds to approximately 15%, 15%, 25% and 22%, respectively of the total operating expenses. Even that *Mar e Terra* and *Areia Branca* O&M costs do not represent more than 20% of the total operating costs of the wind power plants, project participants included the information in the sensitivity analysis.

Financial analyses were performed altering each of these parameters by 10%, and assessing what was the impact on project's IRR (paragraph 21 of Annex 5, EB62). The results of the sensitivity analysis, considering a variation of the selected parameters by 10%, are presented below in Table 13.

**Table 13:** Sensitivity analysis

Scenario	IRR %			
	Mar e Terra	Areia Branca	Embuaca	Icaraí
<i>Original</i>	3.79	6.13	8.81	5.16
<i>Increase in electricity generation</i>	5.36	7.75	10.63	6.67
<i>Increase in the tariff</i>	5.36	7.75	10.63	6.67
<i>Reduction in project investment</i>	5.11	7.54	10.48	6.58
<i>Reduction in O&M Costs</i>	3.87	6.21	8.93	5.25

As it can be seen from the results presented above, the IRR of the projects do not surpass the benchmark considering the variation of the selected parameters by 10%. Yet, a simulation was conducted in order to verify possible scenarios where the IRR of each plant would equal the benchmark. The results for each plant are presented and discussed below (from Table 14 up to Table 17).

Table 14: Scenarios when IRR of the project equals the benchmark (11.65%) – *Mar e Terra*

	IRR %	PRICE (BRL/MWh)	COST (1,000BRL/MWh)	ELECTRICITY (MWh/yr)	Variation (%)
<i>Original</i>	3.79	157.37	96,327	70,080	N/A
<i>Price</i>	11.65	245,34	96,327	70,080	55.90
<i>Investment</i>	11.65	157.37	55,195	70,080	42.70
<i>Electricity</i>	11.65	157.37	96,327	109,920	55.95

Table 15: Scenarios when IRR of the project equals the benchmark (11.65%) – *Areia Branca*

	IRR %	PRICE (BRL/MWh)	COST (1,000BRL/MWh)	ELECTRICITY (MWh/yr)	Variation (%)
<i>Original</i>	6.13	157.36	103,149	96,360	N/A
<i>Price</i>	11.65	214.24	103,149	96,360	36.15
<i>Investment</i>	11.65	152.63	78,336	96,360	31.65
<i>Electricity</i>	11.65	152.63	103,149	131,194	36.15

**Table 16:** Scenarios when IRR of the project equals the benchmark (11.65%) – *Embuaca*

	<i>IRR %</i>	<i>PRICE (BRL/MWh)</i>	<i>COST (1,000BRL/MWh)</i>	<i>ELECTRICITY (MWh/yr)</i>	<i>Variation (%)</i>
<i>Original</i>	8.81	155.75	101,383	96,360	N/A
<i>Price</i>	11.65	180.36	101,383	96,360	15.80
<i>Investment</i>	11.65	155.75	85,061	96,360	16.10
<i>Electricity</i>	11.65	155.75	101,383	111,585	15.80

Table 17: Scenarios when IRR of the project equals the benchmark (11.65%) – *Icarai*

	<i>IRR %</i>	<i>PRICE (BRL/MWh)</i>	<i>COST (1,000BRL/MWh)</i>	<i>ELECTRICITY (MWh/yr)</i>	<i>Variation (%)</i>
<i>Original</i>	5.16	155.76	84,052	61,320	N/A
<i>Price</i>	11.65	227,72	84,052	61,320	46.20
<i>Investment</i>	11.65	155.76	54,214	61,320	35.50
<i>Electricity</i>	11.65	155.76	84,052	89,850	46.20

The electricity generated by the plants is not expected to rise because the estimative is based on the guaranteed power established by ANEEL. Furthermore, project developers contracted an engineering company (Garrad Hassen) to perform a new study assessment of the wind potential at the site where the wind power plants are located.

The study performed by Garrad Hassen shows that the electricity generated is lower than the one established by ANEEL. The electricity production determined in the Wind Certification is measured at 50% of probability (P50). This range means that there is a 50:50 chance of a higher or lower generation of electricity generation by the plant. At this range, more wind is captured indicating an optimistic estimative. As verified in the Wind Certification, the P50 estimative is the highest value when comparing the estimative at 75% and at 90% of probability, P75 and P90, respectively. For a reference, financing institutions consider wind measurements at 90% of probability (P90) as a conservative approach.

The table below shows the comparison between the electricity generation considering the assured energy negotiated at the auction and the electricity generation considered in the study conducted by Garrad Hassen (GH).

**Table 18:** Assured energy according to the electricity negotiated at the auction and the GH engineering study.

Wind Power Plant	<i>Mar e Terra</i>	<i>Areia Branca</i>	<i>Embuaca</i>	<i>Icaraí</i>	TOTAL
<i>Negotiated Electricity at the Auction (MW_{med})</i>	8.00	11.0	11.0	7.00	37.00
<i>Electricity delivered to the grid as per the auction (MWh)</i>	70,080	96,360	96,360	61,320	324,120
<i>Assured Energy as per the engineering study conducted by GH (MW_{med})</i>	8.09	11.90	10.65	7.81	38.45
<i>Electricity delivered to the grid as per the engineering study conducted by GH (MWh)</i>	70,868	104,244	93,294	68,416	336,822

Considering the table above, the electricity generated specified in the engineering study conducted by Garrad Hassen, is slightly higher than the one negotiated in the auction and applied in the investment analysis. However, the Power Purchase Agreement (PPA) states that, if the generated electricity by the wind power plants is higher than the electricity negotiated at the auction, the project sponsor is not able to sell the electricity surplus. The CCEE shall count all the generated electricity and acts according to the established in the PPA. Therefore, an increase in projects revenues due to an increase in the electricity generation is not probable.

Nevertheless, a sensitivity analysis considering the new configuration of the wind power plants was conducted in order to demonstrate that the project remains additional. It is important to mention that the wind power plants presented a new configuration aim to deliver the negotiated electricity in the auction which would not happen if the wind power plants configuration were kept the same defined in the auction. The electricity tariff, the wind power plants investment and the O&M costs were also updated considering the IPCA index for the year of 2011, when the new configuration of the wind power plants was considered. The IPCA - Amplified Consumers Price Index (from the Portuguese *Índice de Preços ao Consumidor Ampliado*) is the official data in the country to account the inflation, is the index applied in the PPA and EPC contract of the wind power plants and for this reason was applied in the sensitivity analysis.

Table 19 shows the IRR variation of the wind power plants altering by $\pm 10\%$ the selected parameters.

Table 19: Sensitivity analysis considering the new wind power plants configuration ($\pm 10\%$).

Scenario	IRR %			
	Mar e Terra	Areia Branca	Embuaca	Icaraí
<i>Original IRR*</i>	3.79	6.13	8.81	5.16
<i>IRR**</i>	4.18	7.64	8.34	7.06
<i>Increase in electricity generation</i>	5.74	9.30	10.11	8.65
<i>Increase in the tariff</i>	5.74	9.30	10.11	8.50
<i>Reduction in project investment</i>	5.52	9.14	9.97	8.59



* IRR project considering the configuration defined at the auction

** IRR project considering the optimization of the wind power plants, the electricity tariff, the investment and the O&M costs adjusted by the *IPCA* index.

Also, a simulation a simulation was conducted in order to verify possible scenarios where the IRR of each plant would equal the benchmark considering the new configuration of the wind power plants. The results are below (from Table 20 up to Table 23).

Table 20: Scenarios when IRR of the project equals the benchmark (11.65%) – *Mar e Terra*

	<i>IRR %</i>	<i>PRICE (BRL/MWh)</i>	<i>COST (1,000BRL/MWh)</i>	<i>ELECTRICITY (MWh/yr)</i>	<i>Variation (%)</i>
<i>IRR**</i>	4.18	170.43	104,626	70,868	N/A
<i>Price</i>	11.65	260.84	104,626	70,868	53.05
<i>Investment</i>	11.65	170.43	61,886	70,868	40.85
<i>Electricity</i>	11.65	170.43	104,626	108,500	53.10

** IRR project considering the optimization of the wind power plants, the electricity tariff, the investment and the O&M costs adjusted by the *IPCA* index.

Table 21: Scenarios when IRR of the project equals the benchmark (11.65%) – *Areia Branca*

	<i>IRR %</i>	<i>PRICE (BRL/MWh)</i>	<i>COST (1,000BRL/MWh)</i>	<i>ELECTRICITY (MWh/yr)</i>	<i>Variation (%)</i>
<i>IRR**</i>	7.64	170.42	124,484	104,244	N/A
<i>Price</i>	11.65	212.85	124,484	104,244	24.90
<i>Investment</i>	11.65	170.42	95,168	104,244	23.55
<i>Electricity</i>	11.65	170.42	124,484	130,201	24.90

** IRR project considering the optimization of the wind power plants, the electricity tariff, the investment and the O&M costs adjusted by the *IPCA* index.

Table 22: Scenarios when IRR of the project equals the benchmark (11.65%) – *Embuaca*

	<i>IRR %</i>	<i>PRICE (BRL/MWh)</i>	<i>COST (1,000BRL/MWh)</i>	<i>ELECTRICITY (MWh/yr)</i>	<i>Variation (%)</i>
<i>IRR**</i>	8.34	168.68	110,118	93,294	N/A
<i>Price</i>	11.65	200.64	110,118	93,294	18.95



<i>Investment</i>	11.65	168.68	89,526	93,294	18.70
<i>Electricity</i>	11.65	168.68	110,118	111,020	19.00

** IRR project considering the optimization of the wind power plants, the electricity tariff, the investment and the O&M costs adjusted by the *IPCA* index.

Table 23: Scenarios when IRR of the project equals the benchmark (11.65%) – *Icarai*

	<i>IRR %</i>	<i>PRICE (BRL/MWh)</i>	<i>COST (1,000BRL/MWh)</i>	<i>ELECTRICITY (MWh/yr)</i>	<i>Variation (%)</i>
<i>IRR**</i>	7.06	168.08	90,423	68,416	N/A
<i>Price</i>	11.65	218.49	90,423	68,416	33.15
<i>Investment</i>	11.65	168.08	67,094	68,416	25.80
<i>Electricity</i>	11.65	168.08	90,423	88,940	30.00

** IRR project considering the optimization of the wind power plants, the electricity tariff, the investment and the O&M costs adjusted by the *IPCA* index.

From the above, it is concluded that the optimization of the wind power plants does not compromise the project additionality, since the IRR project remains lower than the benchmark. Furthermore, an increase in the assured energy aim to reach the benchmark would generate a variation of 53.10%, 24.90%, 19.00% and 30.00% in the assured energy of *Mar e Terra*, *Areia Branca*, *Embuaca* and *Icarai* wind power plants, respectively. This increase in the assured energy is very unlikely considering that the measurements were conducted at 50% of probability (P50), that is the highest estimative of wind production when comparing to the estimative at 75% and at 90% of probability. The prices used in the analyses were taken from the results of the public auction conducted by the Chamber of Electrical Energy Commercialization (CCEE – *Câmara de Comercialização de Energia Elétrica*) in which the electricity to be dispatched by each plant was negotiated. According to CCEE *the criterion of the least tariff is used to define the winners of a given auction, that is, the winners of the auction shall be those bidders which offer electric power for the least price per Mega-Watt Hour to supply the demand envisaged by the Distributors*

The result of a successful participation in this kind of public auction is the signature of a Power Purchase Agreement called CCEAR – Contract on Energy Commercialization in Regulated Market³⁴. CCEAR's will have a duration of 20 years, will remain fixed throughout the years, and will be adjusted accordingly to the

³⁴ According to CCEE *the new model for the electric sector states that the commercialization of electric power is accomplished in two market ambiances: the Regulated Contracting Ambiance – ACR (Ambiente de Contratação Regulada) and the Free Contracting Ambiance – ACL (Ambiente de Contratação Livre). Contracting in the ACR is formalized by means of regulated, bilateral agreements, called Electric Power Commercialization Agreements within the Regulated Ambiance (CCEAR – Contratos de Comercialização de Energia Elétrica no Ambiente Regulado) entered into between Selling Agents (sellers, generators, independent producers or self-producers) and Purchasing Agents (distributors) which participate of electric power purchase and sale auctions.*

Amplified Consumers Price Index (from the Portuguese *Índice de Preços ao Consumidor Ampliado*), which is the official index that measures the inflation in Brazil. The electricity tariff of the wind power plants were adjusted by the *IPCA* index according to the investment analysis conducted and kept fixed through the years of the investment analysis. The first analysis was conducted considering the time of the project investment decision which is August, 2010, when the PPA of *Icarai* wind power plant was signed. The second analysis considered the time when the new configuration of the wind power plants were determined, represented by the engineering study performed by Garrad Hassen in November, 2011 for *Mar e Terra*, *Areia Branca* and *Embuaca* wind power plants and in August, 2011 for *Icarai* wind power plant. Even considering the adjusted electricity tariffs, the IRR of the wind power plants did not surpass the benchmark. Hence, no variation in the projects IRR that may compromise the project additionality can be expected to be associated to a possible increase in the price of electricity.

The total investment necessary to build the plants as it is presented in the cash flows is based on the SUDENE letter. It corresponds to the total costs related to the implementation of the wind power plants as stated at Table 10 above, including the EPC Contract. Considering the analysis performed at the time of the investment decision and considering that the letter was issued in July, 2011, the *IPCA* index was applied in order to deflate the investment until the date of the investment decision, *i.e.*, August, 2010. In the second analysis, considering the new configuration of the wind power plants, the *IPCA* index was applied to inflate the investment until November, 2011 for *Mar e Terra*, *Areia Branca* and *Embuaca* wind power plants and until August, 2011 for *Icarai* wind power plant. Furthermore, this type of contract fixes the price to build a plant and any variation either in favor or against the project is in charge of the construction company which means that no variation in project IRR can be attributed to a variation in the investment costs.

Taking into account the sensitivity analysis conducted above and the discussion related to the variation of the IRR projects until reach the benchmark, the O&M costs were not included in the tables above since it was observed that, even considering the O&M costs related to the wind power plants equal to zero, the projects' IRR would not reach the benchmark. The analysis was conducted considering the previous and the new configuration of the wind power plants and the results are presented below:

Table 24: Sensitivity analysis considering no O&M costs of the wind power plants.

<i>Wind Power Plant</i>	<i>IRR project considering the previous configuration (%)</i>	<i>IRR Project considering the new configuration (%)</i>
<i>Mar e Terra</i>	4.62	4.99
<i>Areia Branca</i>	6.86	8.33
<i>Embuaca</i>	9.96	9.50
<i>Icarai</i>	6.04	7.89

Therefore, a decrease in the O&M costs until the IRR projects reach the benchmark is not expected to occur.

**Outcome**

The IRR of the project activity without being registered as a CDM project is significantly below the sector benchmark, evidencing that project activity is not financially attractive to investor. Then, scenario 1 would be the most plausible alternative to the project activity, *i.e.* the continuation of the current situation with additional electricity supplied by the Brazilian Interconnected Grid.

SATISFIED/PASS – Proceed to Step 3

Step 3. Barrier analysis

Sub-step 3a. Identify barriers that would prevent the implementation of type of the proposed project activity

Not applicable. Step 2 was applied in order to determine project's additionality.

Sub-step 3b. Show that the identified barriers would not prevent the implementation of at least one of the alternatives:

Not applicable. Step 2 was used to determine project's additionality.

SATISFIED/PASS – Proceed to Step 4

Step 4. Common practice analysis

Sub-step 4a. Analyze other activities similar to the proposed project activity:

Amongst the operational plants in the country, wind power project represent only 11.19% (Figure 4).

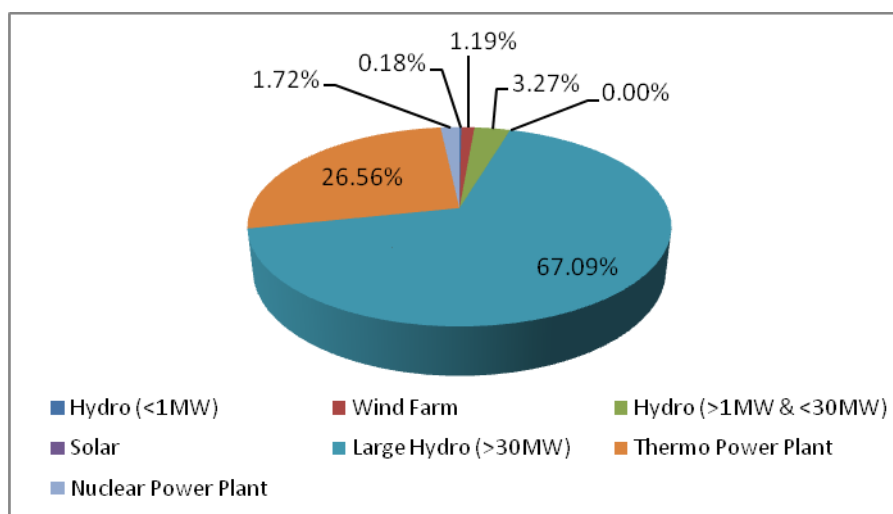


Figure 4: Brazil's generation capacity per type of energy source. Source: (ANEEL 2011³⁵)

According to the additionality tool (version 66.0.0), “*projects are considered similar if they are in the same country/region and/or rely on a broadly similar technology, are of a similar scale, and take place in a comparable environment with respect to regulatory framework, investment climate, access to technology, access to financing, etc*”. Thus, the steps proposed in the new version of the tool approved by the board in its 65th Meeting, will be considered in order to identify the projects that are similar to proposed project activity under consideration:

Considering the definitions provided by the tool as well as the project specific characteristics, the following criteria is considered at the assessment of the common practice:

- (i). **Applicable geographical area:** Brazil has an extension of 8,514,876.599 square kilometres³⁶ (with over 4,000 km distance in the north-south as well as in the east-west axis) and 6 distinct climate regions: sub-tropical, semi-arid, equatorial, tropical, highland-tropical and Atlantic-tropical (humid tropical). These climatic variations obviously have a strong influence in the technical aspects related to the implementation of wind farms.

According to the Brazilian Electricity Regulatory Agency all regions of the country have some potential to generate electricity using wind, however the highest wind power potential is located in the northeast region of the country, where the majority of operational projects are located (Figure 5). However, in line with the recommendation of the additionality tool, the assessment will be conducted considering projects located in Brazil.

³⁵ ANEEL (2011). Banco de Informações de Geração - BIG. Capacidade de Geração. Available at: <<http://www.aneel.gov.br/aplicacoes/capacidadebrasil/capacidadebrasil.asp>>. Accessed in August, 2011.

³⁶ Available at: <http://www.ibge.gov.br/home/geociencias/areateritorial/principal.shtm>.

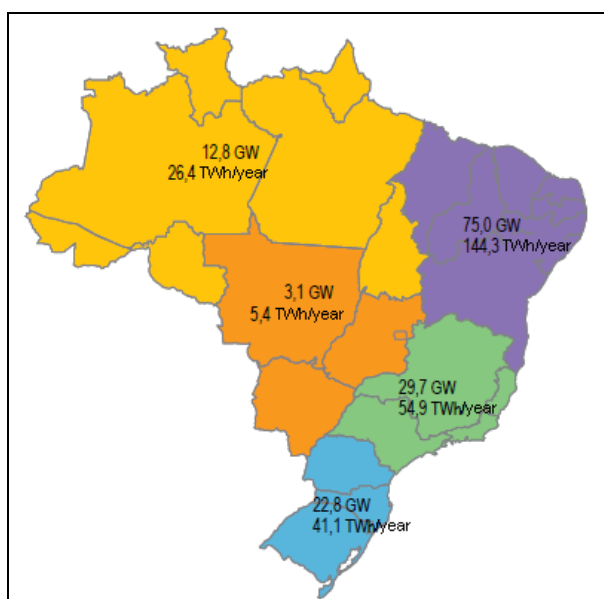


Figure 5: Brazilian wind resource potential³⁷.

- (ii). **Measure:** The assessment will be done consistently with the purpose of the proposed project activity and its alternative baseline scenario, corresponding to item b) switch of technology with change of energy source. In other words, the electricity generation by wind power plants will displace electricity generated by other sources connected to the grid.
- (iii). **Output:** Only the grid connected power plants producing are going to be considered.
- (iv). **Different technologies:** Within this criteria, the following aspects are going to be taken into consideration while conducting the common practice analysis:
 - (a) **Energy source:** given the particularities of wind power generation, only wind power plants are going to be considered;
 - (b) **Legal regulations:** Until the beginning of the 1990's, the energy sector was composed almost exclusively of state-owned companies. From 1995 onwards, due to the increase in international interest rates and the lack of state investment capacity, the government started the privatization process. However, by the end of 2000 results were still modest. Further initiatives, aiming to improve electric generation in the country, were taken from the late 1990's to 2003; however they did not attract new investment to the sector. In 2003 the recently elected government decided to fully review the electricity market institutional framework in order to boost investments in the electric energy sector. The market rules were changed and new institutions were created such as Energetic Research Company (in a free translation from the Portuguese Empresa de Pesquisa Energética – EPE) – an institution that would become responsible for the long term planning of the electricity sector with the role of evaluating, on a perennial basis, the safety of the supply of electric power – and Chamber for

³⁷ ANEEL - Agência Nacional de Energia Elétrica. **Atlas de energia elétrica do Brasil**. 3ed. – Brasília: Aneel, 2008. Available at <<http://www.aneel.gov.br/biblioteca/EdicaoLivros2009atlas.cfm>>.

the Commercialization of Electric Power (CCEE) – an institution to manage the commercialization of electric power within the interconnected system. This new structure was approved by the House of Representatives and published in March of 2004³⁸. Given the new regulatory framework and investment climate only projects starting after March of 2004 will be considered similar to the proposed project activity;

- (c) *Promotional Policies:* The Brazilian Federal Government has provided important incentives for wind electricity generation. One of the most recognized ones is the Alternative Electricity Sources Incentive Program (in a free translation from the Portuguese Programa de Incentivo às Fontes Alternativas de Energia Elétrica – PROINFA). The PROINFA was created through the Law # 10,438 dated April 26th, 2002. Among others, one of the initiative's goals was to increase the renewable energy sources share in the Brazilian electricity market, thus contributing to a greater environmental sustainability. In order to achieve such goals, the Brazilian government has designated the federal state-owned power utility Eletrobrás (Centrais Elétricas Brasileiras S/A) to act as the primary off-taker of electric energy generated by alternative energy facilities in Brazil, by entering into long-term Power Purchase Agreements with alternative energy power producers, at a guaranteed price of at least 80% of the average energy supply tariff charged to ultimate consumers. Also, the Brazilian Decree # 5,025 dated March 30th, 2004¹, which regulates the Law # 10,438, states that PROINFA aims for the reduction of greenhouse gases as established by the United Nations Framework Convention on Climate Change (UNFCCC) under Kyoto Protocol, contributing to the sustainable development. Therefore, the program is clearly a "Type E-" policy.

Sub-step 4b. Discuss any similar options that are occurring:

Considering information above, Project Participants applied the steps provided by the additionality tool to perform the common practice analysis, as further detailed below.

Step 1: Calculate applicable output range as +/-50% of the design output or capacity of the proposed project activity.

Only plants with installed capacity from 50% lower to 50% higher³⁹ than the wind power plants installed capacity considered in this CDM Project Activity will be analyzed. The project encompasses four wind power plants: *Mar e Terra*, *Areia Branca*, *Embuaca* and *Icaraí*, which present 23.1, 27.3, 27.3 and 16.8 MW of installed capacity. Therefore, projects between 8.4 and 40.95 MW of installed capacity are going to be taken into consideration. Finally, the four plants together sum 94.5 MW of installed capacity. For conservative reasons, the analysis comprising projects between 47.25 and 141.75 MW of installed capacity will also be conducted.

³⁸ <http://www.planalto.gov.br/CCIVIL/ Ato2004-2006/2004/Lei/L10.848.htm>.



Step 2: In the applicable geographical area, identify all plants that deliver the same output or capacity, within the applicable output range calculated in Step 1, as the proposed project activity and have started commercial operation before the start date of the project. Note their number N_{all} . Registered CDM project activities and project activities undergoing validation shall not be included in this step;

The ANEEL database was checked⁴⁰. The result is that 10 wind power plants considering the range between 8.4 and 40.95 MW and 5 wind power plants considering the range between 40.25 and 141.75 MW identified in Step 1, have started commercial operations before the start date of the project i.e., before November, 30th 2010. Also, registered CDM project activities and CDM project activities at validation shall not be included, thus, *Água Doce, Osório, Icaraizinho, RN 15 – Rio do Fogo, Canoa Quebrada e Paracuru* Wind Power Plants will not be considered in this analysis. Hence, $N_{all} = 15$.

Step 3: Within plants identified in Step 2, identify those that apply technologies different that the technology applied in the proposed project activity. Note their number N_{diff} .

Within the plants identified in the Step 2, considering the range between 8.4 and 40.95 MW of installed capacity, i.e., from 10 wind power plants, 9 received incentives from PROINFA (identified as a promotional policy, as explained above). Taking into account the range between 47.25 and 141.75 MW of installed capacity, from the 5 wind power plants identified above, all of them received incentives from PROINFA.

Therefore, $N_{diff} = 14$.

Step 4: Calculate factor $F = 1 - N_{diff}/N_{all}$ representing the share of plants using technology similar to the technology used in the proposed project activity in all plants that deliver the same output or capacity as the proposed project activity.

The factor is $F = 1 - 14/15 = 0.067$. This factor represents the share of plants using a similar technology to 'the one used by the proposed project activity.

The proposed project activity is a "common practice" within a sector in the applicable geographical area if the factor F is greater than 0.2 and $N_{all} - N_{diff}$ is greater than 3.

The factor determined above in Step 4 is not greater than 0.2. Also $N_{all} - N_{diff}$ is not greater than 3. Hence, the proposed project activity cannot be considered a common practice in the applicable geographical area.

⁴⁰ ANEEL (2011b). Fiscalização dos serviços de geração. Acompanhamento da expansão da oferta de geração de energia elétrica. Resumo geral do acompanhamento das usinas de geração elétrica – Version dated December 2011. Available at: <http://www.aneel.gov.br/area.cfm?idArea=37&idPerfil=2>. Accessed on December, 23rd 2011

**SATISFIED/PASS – Project is ADDITIONAL****B.6. Emission reductions:****B.6.1. Explanation of methodological choices:****Emission Reductions (ER_y)**

According to ACM0002 emission reductions by the proposed project activity are calculated as follows.

$$ER_y = BE_y - PE_y \quad \text{Equation 1}$$

Where,

ER_y = Emission reductions in year y (t CO₂e);

BE_y = Baseline emissions in year y (t CO₂);

PE_y = Project emissions in year y (t CO₂e).

Baseline emissions (BE_y)

Baseline emissions are calculated as follows:

$$BE_y = EG_{PJ,y} \times EF_{grid,CM,y} \quad \text{Equation 2}$$

Where,

BE_y = Baseline emissions in year y (tCO₂);

$EG_{PJ,y}$ = Quantity of net electricity generation that is produced and fed into the grid as a result of the implementation of the CDM project activity in year y (MWh);

$EF_{grid,CM,y}$ = Combined margin CO₂ emission factor for grid connected power generation in year y calculated using the latest version of the “Tool to calculate the emission factor for an electricity system” (tCO₂/MWh).

For greenfield projects as it is the case of the proposed project activity $EG_{PJ,y}$ is determined as follows.

$$EG_{PJ,y} = EG_{facility,y} \quad \text{Equation 3}$$

Where,

$EG_{PJ,y}$ = Quantity of net electricity generation that is produced and fed into the grid as a result of the implementation of the CDM project activity in year y (MWh);

$EG_{facility,y}$ = Quantity of net electricity generation supplied by the project plant/unit to the grid in year y



(MWh).

Explanations as to how the quantity of net electricity generation supplied by the project plant/unit to the grid ($EG_{facility,y}$) was estimated, is presented below in section B.6.3. The calculation of the combined margin CO₂ emission factor for grid connected power generation ($EF_{grid,CM,y}$) follows, as recommended by ACM0002, the procedures established in the methodological tool “*Tool to calculate the emission factor for an electricity system*”.

According to this tool Project Participants shall apply six steps to the baseline calculation as further detailed below.

- **STEP 1** - Identify the relevant electric power system

According to the tool, “*If the DNA of the host country has published a delineation of the project electricity system and connected electricity systems, these delineations should be used. If such delineations are not available, project participants should define the project electricity system and any connected electricity system and justify and document their assumptions in the CDM-PDD*”.

Brazilian DNA published Resolution #8, issued on May, 26th 2008, defining the Brazilian Interconnected Grid as a single system that covers all the five macro-geographical regions of the country (North, Northeast, South, Southeast and Midwest). Hence this figure will be used to calculate the baseline emission factor of the grid.

- **STEP 2** – Choose whether to include off-grid power plants in the project electricity system (optional).

Option I of the tool is chosen, which is to include in the calculation only grid power plants.

- **STEP 3** - Select a method to determine the operating margin (OM).

The operating margin emission factor ($EF_{grid,OM,y}$) chosen was the *ex-ante* vintage. The calculation of the operating margin emission factor ($EF_{grid,OM,y}$) is based on one of the following methods:

- (a) Simple OM, or
- (b) Simple adjusted OM, or
- (c) Dispatch data analysis OM, or
- (d) Average OM.

Considering that project participants have opted to use the *ex-ante* vintage, dispatch data analysis is not an available option for the calculation of the operating margin since it is only applicable for the *ex-post* vintage, which is not the vintage chosen by project participants. The simple operating margin can only be used where low-cost/must-run resources⁴¹ constitute less than 50% of total grid generation in: 1) average of 5 most recent

⁴¹ Low operating cost and must run resources typically include hydro, geothermal, wind, low-cost biomass, nuclear and solar generation.

years, or 2) based on long-term normals for hydroelectricity production. Table 25 shows the share of hydroelectricity in the total electricity production for the Brazilian interconnected system. However, the results show the non-applicability of the simple operating margin to the proposed CDM Project Activity.

Table 25: Share of hydroelectricity generation in the Brazilian interconnected system, 2006 to 2010

Year	Share of hydroelectricity (%)
2006	91.81%
2007	92.79%
2008	88.62%
2009	93.27%
2010	88.77%

Source: ONS / Operador Nacional do Sistema: Histórico de Geração, 2011. Available at http://www.ons.org.br/historico/geracao_energia.aspx.

The fourth alternative, an average operating margin, is an oversimplification and does not reflect at all the impact of the project activity in the operating margin. Therefore, the simple adjusted operating margin will be used in the project.

- **STEP 4** - Calculate the operating margin emission factor according to the selected method

According to the tool “the simple adjusted OM emission factor ($EF_{grid,OM-DD,y}$) is a variation of the simple OM, where the power plants/units (including imports) are separated in low-cost/must-run power sources (k) and other power sources (m)”.

The simple adjusted OM was calculated based on the net electricity generation and a CO₂ emission factor for each power unit – i.e. similarly to **Option A** of the simple OM method – as follows:

$$EF_{grid,OM-adj,y} = (1 - \lambda_y) \cdot \frac{\sum_m EG_{m,y} \cdot EF_{EL,m,y}}{\sum_m EG_{m,y}} + \lambda_y \cdot \frac{\sum_k EG_{k,y} \cdot EF_{EL,k,y}}{\sum_k EG_{k,y}} \quad \text{Equation 4}$$

Where,

$EF_{grid,OM-adj,y}$ = Simple adjusted operating margin CO₂ emission factor in year y (tCO₂/MWh)

λ_y = Factor expressing the percentage of time when low-cost/must run power units are on the margin in year y

$EG_{m,y}$	=	Net quantity of electricity generated and delivered to the grid by power units m in year y (MWh)
$EG_{k,y}$	=	Net quantity of electricity generated and delivered to the grid by power units k in year y (MWh)
$EF_{EL,m,y}$	=	CO ₂ emission factor of power unit m in year y (tCO ₂ /MWh)
$EF_{EL,k,y}$	=	CO ₂ emission factor of power unit k in year y (tCO ₂ /MWh)
$EG_{PJ,y}$	=	Total electricity displaced by the project activity in year y (MWh)
m		All grid power units serving the grid in year y except low-cost/must-run power units
k	=	All low-cost/must-run grid power units serving the grid in year y
y	=	The relevant year as per the data vintage chosen in step 3

Determination of $EF_{EL,m,y}$

Considering that only data on electricity generation and the fuel types used in each of the power units was available, the emission factor was determined based on the CO₂ emission factor of the fuel type used and the efficiency of the power unit, as per **Option A2** of the tool. The following formula was used:

$$EF_{EL,m,y} = \frac{EF_{CO2,m,i,y} \cdot 3.6}{\eta_{m,y}} \quad \text{Equation 5}$$

Where,

$EF_{EL,m,y}$	=	CO ₂ emission factor of power unit m in year y (tCO ₂ /MWh)
$EF_{CO2,m,i,y}$	=	Average CO ₂ emission factor of fuel type i used in power unit m in year y (tCO ₂ /GJ)
$\eta_{m,y}$	=	Average net energy conversion efficiency of power unit m in year y (ratio)
m	=	All power units serving the grid in year y except low-cost/must-run power units
y	=	The relevant year as per the data vintage chosen in Step 3

Determination of $EG_{m,y}$

Information used to determine this parameter was supplied by The Electric System National Operator (from the Portuguese *Operador Nacional do Sistema* – ONS), which is an official source, as recommended by the tool. ONS is an entity of private right, non-profitable, created on August 26th 1998, responsible for coordinating and controlling the operation of generation and transmission facilities in the National

interconnected Power System (NIPS) under supervision and regulation of the Electric Energy National Agency (ANEEL)⁴².

- **STEP 5** – Calculate the build margin (BM) emission factor

In terms of vintage, **option 1** was chosen, *i.e.*, the build margin emission factor ($EF_{grid,BM,y}$) *ex-ante* vintage. In this sense, the build margin was calculated using the most recent information available on units already built for sample group m at the time of CDM-PDD submission to the DOE, *i.e.* 2010.

The sample group of power units m used to calculate the build margin emission factor ($EF_{grid,BM,y}$) was determined following the guidance provided by the tool as further discussed in section B.6.3 below.

The build margin was calculated following the same approach described above in step 4.

- **STEP 6** – Calculate the combined margin (CM) emissions factor EF_y .

The combined margin calculation is based on method *a* provided by the tool, as follows:

$$EF_{grid,CM,y} = EF_{grid,OM,y} \cdot w_{OM} + EF_{grid,BM,y} \cdot w_{BM} \quad \text{Equation 6}$$

Where,

$EF_{grid,BM,y}$ = Build margin CO₂ emission factor in year y (tCO₂/MWh);

$EF_{grid,OM,y}$ = Operating margin CO₂ emission factor in year y (tCO₂/MWh);

w_{OM} = Weighting of operating margin emissions factor (%);

w_{BM} = Weighting of build margin emissions factor (%).

As mentioned above, the *ex-ante* vintage was chosen in order to calculate the operating and build margin emission factors. Therefore, the combined margin emission factor ($EF_{grid,CM,y}$) applied to calculate the baseline emissions of the grid is the *ex-ante* vintage.

According to the tool, for wind power generation project activities, as is the case of the proposed project activity, weights are $w_{OM} = 0.75$ and $w_{BM} = 0.25$.

Project emissions (PE_y)

According to ACM0002, for most renewable power generation project activities, $PE_y = 0$. However, some project activities may involve project emissions that can be significant. These emissions shall be accounted for as project emissions by using the following equation:

⁴² http://www.ons.org.br/institucional/modelo_setorial.aspx?lang=en



$$PE_y = PE_{FF,y} + PE_{GP,y} + PE_{HP,y} \quad \text{Equation 7}$$

Where,

PE_y = Project emissions in year y (tCO₂e);

$PE_{FF,y}$ = Project emissions from fossil fuel consumption in year y (tCO₂);

$PE_{GP,y}$ = Project emissions from the operation of geothermal power plants due to the release of non-condensable gases in year y (tCO₂e);

$PE_{HP,y}$ = Project emissions from water reservoirs of hydro power plants in year y (tCO₂e).

Emissions from fossil fuel combustion ($PE_{FF,y}$)

According to the methodology, only geothermal and solar thermal projects have to account for emissions from the consumption of fossil fuels. Therefore, in the case of the proposed project activity, $PE_{FF,y} = 0$ tCO₂.

Emissions from the operation of geothermal power plants due to the release of non-condensable gases ($PE_{GP,y}$)

Considering that the proposed project activity consists of the construction of a wind power plant, there are no emissions related to non-condensable gases from the operation of geothermal power plants. Therefore, $PE_{GP,y} = 0$ tCO₂.

Emissions from water reservoirs of hydro power plants ($PE_{HP,y}$)

New hydro electric power projects resulting in new reservoirs, shall account for CH₄ and CO₂ emissions from reservoirs. Considering that the proposed project activity consists of the construction of a wind power plant, there are no emissions from water reservoirs. Therefore, $PE_{HP,y} = 0$ tCO₂.

Leakage calculation (LE_y)

According to the methodology, “no leakage emissions are considered. The main emissions potentially giving rise to leakage in the context of electric sector projects are emissions arising due to activities such as power plant construction and upstream emissions from fossil fuel use (e.g. extraction, processing, and transport). These emissions sources are neglected”. Therefore, leakage of the proposed project activity is 0 tCO₂.

B.6.2. Data and parameters that are available at validation:

Data / Parameter:	$EF_{CO2,m,i,y}$
--------------------------	------------------



Data unit:	tCO ₂ /GJ
Description:	CO ₂ emission factor of fossil fuel type <i>i</i> used in power unit <i>m</i> in year <i>y</i>
Source of data used:	IPCC default values at the lower limit of the uncertainty at a 95% confidence interval as provided in table 1.4 of Chapter 1 of Vol. 2 (Energy) of the 2006 IPCC Guidelines on National GHG Inventories
Value applied:	Large amount of data. Please refer to the emission factor calculation spreadsheet which is attached to the PDD.
Justification of the choice of data or description of measurement methods and procedures actually applied :	As per the recommendation of the “ <i>Tool to calculate the emission factor for an electricity system</i> ”. IPCC default values are being used since this information is neither provided by fuel suppliers nor regional and/or local default values are publicly available.
Any comment:	

Data / Parameter:	$EG_{m,y}$ and $EG_{k,y}$
Data unit:	MWh
Description:	Net electricity generated by power plant/unit <i>m</i> or <i>k</i> in year <i>y</i>
Source of data used:	Official publications. Data from the Electric System National Operator was used.
Value applied:	Large amount of data. Please refer to the emission factor calculation spreadsheet which is attached to the PDD.
Justification of the choice of data or description of measurement methods and procedures actually applied :	Once for each crediting period using the most recent three historical years for which data is available at the time of submission of the CDM-PDD to the DOE for validation (<i>ex-ante</i> option).
Any comment:	For methodological choices details, please refer to section B.6.1.

Data / Parameter:	$\eta_{m,y}$
Data unit:	-
Description:	Average net energy conversion efficiency of power unit <i>m</i> in year <i>y</i>
Source of data used:	Default values provided in Annex 1 of the “ <i>Tool to calculate the emission factor for an electricity system</i> ”
Value applied:	Large amount of data. Please refer to the emission factor calculation spreadsheet which is attached to the PDD.
Justification of the choice of data or description of measurement methods and procedures actually applied :	As per the recommendation of the “ <i>Tool to calculate the emission factor for an electricity system</i> ”.
Any comment:	For methodological choices details, please refer to section B.6.1.

Data / Parameter:	$EF_{grid,OM-adj,y}$
Data unit:	tCO ₂ /MWh



Description:	Simple adjusted operating margin CO ₂ emission factor in year y
Source of data used:	Official publications (data from ONS), IPCC default values and default values provided by the “ <i>Tool to calculate the emission factor for an electricity system</i> ”
Value applied:	0.2609
Justification of the choice of data or description of measurement methods and procedures actually applied :	The <i>ex-ante</i> calculation vintage of this parameter was chosen as per the procedures of the “ <i>Tool to calculate the emission factor for an electricity system</i> ”.
Any comment:	For methodological choices details, please refer to section B.6.1.

Data / Parameter:	$EF_{grid,BM,2010}$
Data unit:	tCO ₂ /MWh
Description:	Build Margin CO ₂ emission factor in year y
Source of data used:	Official publications (data from ONS), IPCC default values and default values provided by the “ <i>Tool to calculate the emission factor for an electricity system</i> ”
Value applied:	0.1166
Justification of the choice of data or description of measurement methods and procedures actually applied :	The <i>ex-ante</i> calculation vintage of this parameter was chosen as per the procedures of the “ <i>Tool to calculate the emission factor for an electricity system</i> ”.
Any comment:	For methodological choices details, please refer to section B.6.1.

Data / Parameter:	$EF_{grid,CM,y}$
Data unit:	tCO ₂ /MWh
Description:	Combined Margin CO ₂ emission factor in year y
Source of data used:	Calculated according to the “ <i>Tool to calculate the emission factor for an electricity system</i> ” (version 2.2.1)
Value applied:	0.2248
Justification of the choice of data or description of measurement methods and procedures actually applied :	The <i>ex-ante</i> calculation vintage of this parameter was chosen as per the procedures of the “ <i>Tool to calculate the emission factor for an electricity system</i> ” and the base year chosen is 2010.
Any comment:	For methodological choices details, please refer to section B.6.1.

B.6.3. Ex-ante calculation of emission reductions:

Baseline emissions (BE_y)

The quantity of net electricity generation supplied by the project plant/unit to the grid in year y ($EG_{facility,y}$, in MWh) was determined, for the purpose of ex-ante estimative, as being equal to the installed capacity of each plant multiplied by the capacity factor (as determined by the Assessment Study of the Wind Potential – from the Portuguese *Estudo de Avaliação da Produção de Energia do Parque Eólico Mar e Terra, Areia*



Branca, Embuaca e Icarai/Icarai– performed by Garrad Hassan/Hassan) and by the numbers of hours the plants was operational in the year y –. The capacity factor was defined in accordance with the “*Guidelines for the reporting and validation of plant load factor*” (EB 48, Annex 11), paragraph 3(b), i.e, by a third party contracted by the project participants. The result for each of the plants is presented below in Table 26. In total, the four plants considered in this CDM Project Activity will generate 336,794 MWh.

Table 26: Net electricity generation by the wind plants of the CDM Project Activity

<i>Wind Power Plant</i>	<i>Assured Energy (MW_{ave})</i>	<i>Net electricity generation (MWh)</i>
<i>Mar e Terra</i>	8.09	70,825
<i>Areia Branca</i>	11,90	104,269
<i>Embuaca</i>	10.65	93,268
<i>Icarai</i>	7.81	68,433
<i>TOTAL</i>	38.45	336,794

Additionally, the calculation of the combined margin CO₂ emission factor for grid connected power generation ($EF_{grid,CM,y}$) follows the steps established in the “*Tool to calculate the emission factor for an electricity system*”. The results are presented below.

- **STEP 1** - Identify the relevant electric power system

Following Resolution #8, issued by the Brazilian DNA on 26th May, 2008, the Brazilian Interconnected Grid corresponds to the system to be considered. It covers all the five macro-geographical regions of the country (North, Northeast, South, Southeast and Midwest) as presented in the figure below.

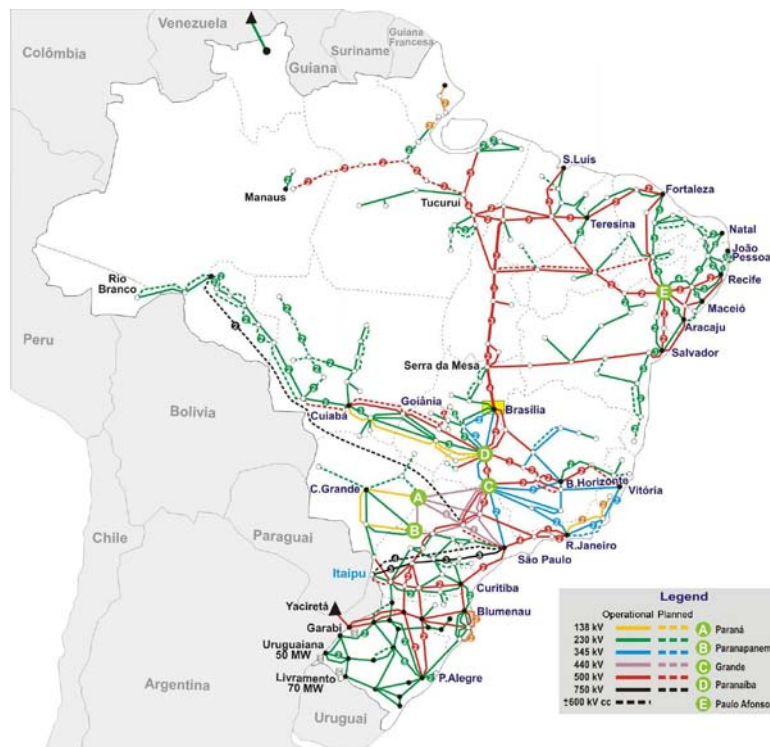


Figure 6: Brazilian Interconnected System. (Source: Electric System National Operator)

- **STEP 2** – Choose whether to include off-grid power plants in the project electricity system (optional)

Option I was chosen and only grid connected power plants are considered.

- **STEP 3** - Select a method to determine the operating margin (OM)

The simple adjusted operating margin was chosen method for the calculation of this parameter. Please refer to section B.6.1. for the proper justification.

- **STEP 4** - Calculate the operating margin emission factor according to the selected method

As discussed above, for estimative purposes in the initiation of the validation of the most updated data from the DNA was used. The result is presented below.

$$EF_{grid,OM-DD,y} = 0.2609 \text{ tCO}_2\text{e/MWh}$$

- **STEP 5** – Calculate the build margin (BM) emission factor

As described above in section B.6.1., the *ex-ante* vintage was the option chosen to determine the build margin (option 1).

The sample group of power units *m* used to calculate the build margin was identified following the



procedure provided by the tool. The result is discussed below and is detailed presented in the spreadsheet supplied to the DOE which is also attached to the PDD.

- (a) *Identify the set of five power units, excluding power units registered as CDM project activities, that started to supply electricity to the grid most recently ($SET_{5-units}$) and determine their annual electricity generation ($AEG_{SET-5-units}$, in MWh);*

From the most recent consolidated information the $SET_{5-units}$ are: UTE Linhares, UHE Salto Pilão, UTE Camaçari, UTE Tocantinópolis and UTE Viana. The electricity generated by these set of plants ($AED_{SET-5-units}$) in 2010 was 662,143 MWh.

- (b) *Determine the annual electricity generation of the project electricity system, excluding power units registered as CDM project activities (AEG_{total} , in MWh). Identify the set of power units, excluding power units registered as CDM project activities, that started to supply electricity to the grid most recently and that comprise 20% of AEG_{total} (if 20% falls on part of the generation of a unit, the generation of that unit is fully included in the calculation) ($SET_{\geq 20\%}$) and determine their annual electricity generation ($AEG_{SET-\geq 20\%}$, in MWh);*

Not considering the CDM project activities, in 2010, the Brazilian electricity System generated (AEG_{total}) 465,919,678 MWh. A large amount of plants comprise 20% of AEG_{total} . This information ($SET_{\geq 20\%}$) can be checked in the calculation spreadsheet attached to this PDD. The annual electricity generation of $SET_{\geq 20\%}$, corresponding to the parameter $AEG_{SET-\geq 20\%}$, is 93,183,936 MWh.

- (c) *From $SET_{5-units}$ and $SET_{\geq 20\%}$ select the set of power units that comprises the larger annual electricity generation (SET_{sample}); Identify the date when the power units in SET_{sample} started to supply electricity to the grid. If none of the power units in SET_{sample} started to supply electricity to the grid more than 10 years ago, then use SET_{sample} to calculate the build margin. Ignore steps (d), (e) and (f).*

From data presented in items (a) and (b), it can be observed that $SET_{\geq 20\%}$ is greater than $SET_{5-units}$. Therefore, SET_{sample} corresponds to $SET_{\geq 20\%}$. The oldest plant comprised in SET_{sample} started to supply electricity to the grid in January 1998. Hence, steps (d), (e) and (f) of the tool are applicable.

- (d) *Exclude from SET_{sample} the power units which started to supply electricity to the grid more than 10 years ago. Include in that set the power units registered as CDM project activity, starting with power units that started to supply electricity to the grid most recently, until the electricity generation of the new set comprises 20% of the annual electricity generation of the project electricity system (if 20% falls on part of the generation of a unit, the generation of that unit is fully included in the calculation) to the extent is possible. Determine for the resulting set ($SET_{sample-CDM}$) the annual electricity generation ($AEG_{SET-sample-CDM}$, in MWh);*

Plants which have started to supply electricity to the grid more than 10 years ago were excluded. Four registered CDM Projects were included in the SET_{sample} . The electricity generation by resultant set of plants, corresponding to the parameter $AEG_{SET-sample-CDM}$, is 74,902,471 MWh.

If the annual electricity generation of that set is comprises at least 20% of the annual electricity



generation of the project electricity system (i.e. $AE_{SET-sample-CDM} \geq 0.2 \times AE_{total}$), then use the sample group $SET_{sample-CDM}$ to calculate the build margin. Ignore steps (e) and (f).

From the results presented above, $AE_{SET-sample-CDM}$ is lower than AE_{total} . Then, steps (e) and (f) were applied.

- (e) Include in the sample group $SET_{sample-CDM}$ the power units that started to supply electricity to the grid more than 10 years ago until the electricity generation of the new set comprises 20% of the annual electricity generation of the project electricity system (if 20% falls on part of the generation of a unit, the generation of that unit is fully included in the calculation);
- (f) The sample group of power units m used to calculate the build margin is the resulting set ($SET_{sample-CDM->10yrs}$).

Five power plants that have started to supply electricity to the grid more than 10 years ago were included: UHE Salto Caxias, UHE Canoas I, UHE Canoas II, UHE Igarapava and UHE Porto Primavera. The resultant set is $SET_{sample-CDM->10yrs}$ is identified in the grid emission factor calculation spreadsheet and the electricity supplied to the grid is 94,545,640 MWh.

The build margin was calculated following the same approach described above in Step 4 and considered the set of plants identified above. As mentioned previously this parameter will be validated since the *ex-ante* option was chosen. The result is presented below.

$$EF_{grid,BM,y} = 0.1166 \text{ tCO}_2\text{e/MWh}$$

- **STEP 6** – Calculate the combined margin (CM) emissions factor EF_y .

Applying the results presented above in STEPS 4 and 6 above to the Equation 6 presented in section B.6.1. and considering the weights $w_{OM} = 0.75$ and $w_{BM} = 0.25$ we obtain,

$$EF_y = w_{OM} \cdot EF_{OM,y} + w_{BM} \cdot EF_{BM,y}$$

$$EF_y = 0.75 \times 0.2609 + 0.25 \times 0.1166$$

$$EF_{grid,CM,y} = 0.2248 \text{ tCO}_2\text{e/MWh}$$

Finally, baseline emissions can be determined applying the results of $EG_{facility,y}$ and $EF_{grid,CM,y}$ to Equation 2 as follows,

$$BE_y = EG_{PJ,y} \times EF_{grid,CM,y}$$

$$EG_{PJ,y} = EG_{facility,y} = 336,794 \text{ MWh}$$

$$BE_y = 336,794 \text{ MWh} \times 0.2248 \text{ tCO}_2\text{/MWh}$$

$$BE_y = 75,707 \text{ tCO}_2$$

Project Emissions (PE_y)



As explained above in section B.6.1. project emissions by the proposed project activity are **zero**.

$$PE_y = 0 \text{ tCO}_2\text{e}$$

Leakage emissions (LE_y)

The calculation of leakage emissions is not required by the methodology.

$$LE_y = 0 \text{ tCO}_2$$

Emission reductions (ER_y)

Applying the results discussed above to Equation 1 we obtain,

$$ER_y = BE_y - PE_y$$

$$ER_y = 75,707 \text{ tCO}_2\text{e}$$

B.6.4 Summary of the ex-ante estimation of emission reductions:

Table 27: Summary of the ex-ante estimation of emission reductions

Years*	Estimation of baseline emissions (tonnes of CO₂e)	Estimation of project activity emissions (tonnes of CO₂e)	Estimation of leakage (tonnes of CO₂e)	Estimation of overall emission reductions (tonnes of CO₂e)
2013	75,707	0	0	75,707
2014	75,707	0	0	75,707
2015	75,707	0	0	75,707
2016	75,707	0	0	75,707
2017	75,707	0	0	75,707
2018	75,707	0	0	75,707
2019	75,707	0	0	75,707
2020	75,707	0	0	75,707
2021	75,707	0	0	75,707
2022	75,707	0	0	75,707
Total (tonnes of CO₂e)	757,070	0	0	757,070

*From January, 1st 2013 until December, 31st 2022

B.7. Application of the monitoring methodology and description of the monitoring plan:

B.7.1 Data and parameters monitored:

Data / Parameter:	$EG_{Mar e Terra,y}$
Data unit:	MWh
Description:	Quantity of net electricity generation supplied by the project plant/unit to the grid



	in year y .
Source of data to be used:	Documented evidence from the meters located at the local power utility substation, project sponsor internal control or evidences from CCEE – Câmara de Comercialização de Energia Elétrica, a Brazilian governmental entity which monitors the quantity of electricity in the national interconnected grid
Value of data applied for the purpose of calculating expected emission reductions in section B.5	70,825
Description of measurement methods and procedures to be applied:	The quantity of electricity delivered to the grid by the project will be quantified through the energy meter located at the substation.
QA/QC procedures to be applied:	Energy metering QA/QC procedures are explained in section B.7.2 (the equipment used have, by legal requirements, an extremely low level of uncertainty). In addition, there will be another meter at the substation (backup) to ensure that electricity will be properly measured. The electricity measured at the substation is continuously, aggregated each 15 minutes and will be monthly consolidated. The electricity generated by the plant in the local power utility substation is given by the Electric Power Commercialization Chamber (from the Portuguese <i>Câmara de Comercialização de Energia Elétrica</i> – CCEE) reports and is used to cross check project participant's information.
Any comment:	Since the proposed project activity is a greenfield project, as explained above in section B.6.1. this parameter corresponds to $EG_{Pl,y}$ used to determine baseline emissions.

Data / Parameter:	$EG_{Areia\ Branca,y}$
Data unit:	MWh
Description:	Quantity of net electricity generation supplied by the project plant/unit to the grid in year y .
Source of data to be used:	Documented evidence from the meters located at the local power utility substation, project sponsor internal control or evidences from CCEE – Câmara de Comercialização de Energia Elétrica, a Brazilian governmental entity which monitors the quantity of electricity in the national interconnected grid
Value of data applied for the purpose of calculating expected emission reductions in section B.5	104,269
Description of measurement methods and procedures to be applied:	The quantity of electricity delivered to the grid by the project will be quantified through the energy meter located at the substation.
QA/QC procedures to be applied:	Energy metering QA/QC procedures are explained in section B.7.2 (the equipment used have, by legal requirements, an extremely low level of uncertainty). In addition, there will be another meter at the substation (backup) to ensure that electricity will be properly measured. The electricity measured at the substation is



	continuously, aggregated each 15 minutes and will be monthly consolidated. The electricity generated by the plant in the local power utility substation is given by the Electric Power Commercialization Chamber (from the Portuguese <i>Câmara de Comercialização de Energia Elétrica</i> – CCEE) reports and is used to cross check project participant's information.
Any comment:	Since the proposed project activity is a greenfield project, as explained above in section B.6.1. this parameter corresponds to $EG_{PJ,y}$ used to determine baseline emissions.

Data / Parameter:	$EG_{Embuaca,y}$
Data unit:	MWh
Description:	Quantity of net electricity generation supplied by the project plant/unit to the grid in year y.
Source of data to be used:	Documented evidence from the meters located at the local power utility substation, project sponsor internal control or evidences from CCEE – Câmara de Comercialização de Energia Elétrica, a Brazilian governmental entity which monitors the quantity of electricity in the national interconnected grid
Value of data applied for the purpose of calculating expected emission reductions in section B.5	93,268
Description of measurement methods and procedures to be applied:	The quantity of electricity delivered to the grid by the project will be quantified through the energy meter located at the substation.
QA/QC procedures to be applied:	Energy metering QA/QC procedures are explained in section B.7.2 (the equipment used have, by legal requirements, an extremely low level of uncertainty). In addition, there will be another meter at the substation (backup) to ensure that electricity will be properly measured. The electricity measured at the substation is continuously, aggregated each 15 minutes and will be monthly consolidated. The electricity generated by the plant in the local power utility substation is given by the Electric Power Commercialization Chamber (from the Portuguese <i>Câmara de Comercialização de Energia Elétrica</i> – CCEE) reports and is used to cross check project participant's information.
Any comment:	Since the proposed project activity is a greenfield project, as explained above in section B.6.1. this parameter corresponds to $EG_{PJ,y}$ used to determine baseline emissions.

Data / Parameter:	$EG_{Icarai,y}$
Data unit:	MWh
Description:	Quantity of net electricity generation supplied by the project plant/unit to the grid in year y.
Source of data to be used:	Documented evidence from the meters located at the local power utility substation, project sponsor internal control or evidences from CCEE – Câmara de Comercialização de Energia Elétrica, a Brazilian governmental entity which monitors the quantity of electricity in the national interconnected grid
Value of data applied	68,433



for the purpose of calculating expected emission reductions in section B.5	
Description of measurement methods and procedures to be applied:	The quantity of electricity delivered to the grid by the project will be quantified through the energy meter located at the substation.
QA/QC procedures to be applied:	Energy metering QA/QC procedures are explained in section B.7.2 (the equipment used have, by legal requirements, an extremely low level of uncertainty). In addition, there will be another meter at the substation (backup) to ensure that electricity will be properly measured. The electricity measured at the substation is continuously, aggregated each 15 minutes and will be monthly consolidated. The electricity generated by the plant in the local power utility substation is given by the Electric Power Commercialization Chamber (from the Portuguese <i>Câmara de Comercialização de Energia Elétrica</i> – CCEE) reports and is used to cross check project participant's information.
Any comment:	Since the proposed project activity is a greenfield project, as explained above in section B.6.1. this parameter corresponds to $EG_{PJ,y}$ used to determine baseline emissions.

B.7.2. Description of the monitoring plan:

The Project owner will proceed with the necessary monitoring measures as established in the procedures from the Electric System National Operator (ONS – from the Portuguese *Operador Nacional do Sistema*), Brazilian Electricity Regulatory Agency (ANEEL from the Portuguese *Agência Nacional de Energia Elétrica*) and the Electric Power Commercialization Chamber (CCEE from the Portuguese *Câmara de Comercialização de Energia Elétrica*).

The ONS is the entity responsible for coordinating and controlling the operation of generation and transmission facilities in the National interconnected Power System (NIPS) under supervision and regulation of ANEEL⁴³ which is the regulatory agency providing favourable conditions for the electric power market to develop a balance between the agents and the benefit of society⁴⁴. CCEE is a not-for-profit, private, civil organization company that is in charge of carrying out the wholesale transactions and commercialization of electric power within the NIPS, for both Regulated and Free Contracting Environments and for the spot market⁴⁵.

The total electricity exported to the grid will be monitored following the procedures and requirements established by ONS which defines the technical characteristics and precision class (0.2% of maximum

⁴³ Information available at <http://www.ons.org.br/institucional/modelo_setorial.aspx?lang=en>.

⁴⁴ Information available at <<http://www.aneel.gov.br/>>.

⁴⁵ Information available at <<http://www.ccee.org.br/cceeinterdsm/v/index.jsp?vgnextoid=25afa5c1de88a010VgnVCM100000aa01a8c0RCRD>>.



permissible error) of the electricity meters to be used⁴⁶. In addition, ONS also rules about the electricity meter calibration requirements (every two years)⁴⁷.

As mentioned above at Section A.2, *Mar e Terra* and *Areia Branca* wind power plants will be connected to *Areia Branca* substation. There will be two energy meters, a principal and a backup meter to measure the electricity generated by *Mar e Terra* and other two meters (a principal and a backup) to measure the electricity generated by *Areia Branca* wind power plant. *Areia Branca* substation will be interconnected to *Mossoró II* substation which belongs to the local power utility (*CHESF – Companhia Hidroelétrica do São Francisco*), through a transmission line of 230 kV with approximately 52 km of extension. At *Mossoró II* substation, there will be other two electricity meters (a principal and a backup) which will be accessed by *CCEE*. *CCEE* will be responsible to count the electricity generated by the two wind power plants and share proportionally the total electricity generated.

Embuaca wind power plant will be interconnected to *Faísá* substation which presents a principal and a backup meter to count the electricity generated by *Embuaca* wind power plant. Other five wind power plants will also be connected to *Faísá* substation: *Faísá I*, *Faísá II*, *Faísá III*, *Faísá IV* and *Faísá V* wind power plants and they will present individually meters for the gross electricity's measurement. *Faísá* substation will be connected to *Pecém II* substation from *CHESF*. *Pecém II* substation will measure the total electricity generated by *Embuaca* wind power plants and from the other five plants interconnected through the same transmission line. The meters (a principal and a backup) located at the substation will be accessed by *CCEE* and *CCEE* will responsible to share proportionally the electricity generated by the six wind power plants.

Icarai wind power plant will be connected to its own substation (*Icarai* substation) located at *Amontada* municipality. *Icarai* substation will also present a principal and a backup meter to measure the electricity generated by the plant and will be interconnected to *Marco* substation from *COELCE*, the local power utility. *Marco* substation electricity meters will also be accessed by *CCEE* in order to count the electricity generated by *Icarai* wind power plant.

The mentioned meters applied in the electricity measurement are of Type QUANTUM Q1000 manufactured by ITRON. The QUANTUM Q1000 a solid-state electronic multimeasurement, transformer-rated, polyphase meter of unsurpassed accuracy was designed to be used at bulk power flow points, including power plants, substations, intertie points, and large commercial and industrial sites. The QUANTUM Q1000 meter measures and displays the per phase real and reactive power in all four quadrants along with thousands of other values. The meters class accuracy is 0.1%, higher than the accuracy established by the *ONS*. The meters will be located at the substation, as specified by *CCEE*. Before the operation starts, *CCEE* demands that these meters are individually registered within their system and calibrated by an entity with *Rede Brasileira de Calibração (RBC)* credential. A diagram presenting the monitored points of the wind power plants is presented in the Annex 4 below.

⁴⁶ ONS – Operador Nacional do Sistema. **Procedimentos de Rede – Módulo 12: medição para faturamento / Submódulo 12.2: Instalação do sistema de medição para faturamento.** Available at http://www.ons.org.br/procedimentos/modulo_12.aspx.

⁴⁷ ONS – Operador Nacional do Sistema. **Procedimentos de Rede – Módulo 12: medição para faturamento / Submódulo 12.3: Manutenção do sistema de medição para faturamento.** Available at http://www.ons.org.br/procedimentos/modulo_12.aspx.



Beyond that, energy information will be controlled in real time by *CCEE*. Once the measurement points are physically defined and the invoice measurement system and the communication infrastructure are installed, the measurement points will be registered in the SCDE (System of Energy Data collection) managed by *CCEE*.

As mentioned before, *CCEE* makes feasible and regulates the electricity energy commercialization in Brazil. In a process called Accounting Commensuration Aggregation (from the Portuguese, *Agregação Contábil da Medição*) *CCEE* compares the energy generation reported by every seller connected to the national grid with the consumption registered during the month under consideration. After the adjustments due to energy losses occurring in the transmission system are made, *CCEE* issues several official reports certifying the amount of energy generated by each seller.

Moreover, to confirm *CCEE*'s information, every month the company auditing *CCEE*'s reports randomly selects a sample of sellers that have to provide detailed information of their Power Purchase Agreement(s) and energy generation during the month being analyzed. Then the auditors analyse the information, check whether *CCEE*'s calculation is correct and issue an opinion. The independent auditors' statements confirming *CCEE*'s information are available at *CCEE*'s website.

The final results of electricity generation are published at *CCEE*'s website and are publicly available. Hence, *CCEE*'s information - which is an official and publicly available source – is going to be used to cross-check information monitored by the project participant.

The company that owns the wind farms will be the responsible for data collection and archiving as well as the calibration and maintenance of the monitoring equipment, for dealing with possible monitoring data adjustments and uncertainties, review of reported results/data, internal audits of GHG project compliance with operational requirements and corrective actions. Also, it is responsible for project management, as well as for the organising and training of the staff in the appropriate monitoring, measurement and reporting techniques.

It is important to mention that *ANEEL* can visit the plants to inspect the operation and maintenance of the facilities at any time.

B.8. Date of completion of the application of the baseline study and monitoring methodology and the name of the responsible person(s)/entity(ies):

Date of completing the final draft of this baseline section and the monitoring methodology (DD/MM/YYYY):
27/07/2011

Name of person/entity determining the baseline:

Company:	Ecopart Assessoria em Negócios Empresariais Ltda.
Contact person:	Bruna Luíza Marigheto
Email:	bruna.marigheto@eqao.com.br
Address:	Rua Padre João Manoel, 222
Zip code + city:	01411-000 São Paulo
Country:	Brazil
Telephone number:	+55 (11) 3063-9068
Fax number:	+55 (11) 3063-9069



Ecopart Asserssoria em Negócios Empresariais Ltda. is the Project Advisor and also a Project Participant.

SECTION C. Duration of the project activity / crediting period

C.1. Duration of the project activity:

C.1.1. Starting date of the project activity:

According to the CDM Glossary of Terms the starting date of a CDM project activity is “*the earliest date at which either the implementation or construction or real action of a project activity begins*”. Furthermore the guidance also clarifies that “*the start date shall be considered to be the date on which the project participant has committed to expenditures related to the implementation or related to the construction of the project activity (...), for example, the date on which contracts have been signed for equipment or construction/operation services required for the project activity*”.

Considering the above information, in order to determine project activity's starting date the forecasted date for the following events were considered: **financing agreement, Power Purchase Agreement, major equipment orders and start of construction**. None of these events have yet taken place. However they are forecasted to happen as follows:

Table 28: Actions related to Mar e Terra, Areia Branca, Embuaca and Icarai wind power plants.

Actions	<i>Mar e Terra</i>	<i>Areia Branca</i>	<i>Embuaca</i>	<i>Icarai</i>
<i>Power Purchase Agreement (PPA)</i>	03/11/2010	13/10/2010	13/10/2010	20/08/2010
<i>Major Equipment Orders – EPC Contract signature</i>	30/811/2010	30/811/2010	30/811/2010	30/811/2010
<i>Construction License Issuance</i>	12/05/2011	12/05/2011	11/10/2011	26/12/2011
<i>Starting Date of Construction</i>	1616/11/2011	1616/11/2011	30/04/2012*	30/04/2012*
<i>Financing Agreement</i>	21/11/2011	21/11/2011	21/11/2011	21/11/2011
<i>Starting date of operation*</i>	07/08/2012	07/08/2012	05/12/2012	30/12/2012

* Scheduled

From the above, the identified project starting date of this project activity is 20/08/2010.

**C.1.2. Expected operational lifetime of the project activity:**

20 years, 0 months.

C.2. Choice of the crediting period and related information:**C.2.1. Renewable crediting period:****C.2.1.1. Starting date of the first crediting period:**

Not applicable

C.2.1.2. Length of the first crediting period:

Not applicable.

C.2.2. Fixed crediting period:**C.2.2.1. Starting date:**

(DD/MM/YYYY) 01/01/2013 or on the date of registration whichever occurs later.

C.2.2.2. Length:

10y, 0m.

SECTION D. Environmental impacts**D.1. Documentation on the analysis of the environmental impacts, including transboundary impacts:**

In Brazil, the sponsor of any project that involves construction, installation, expansion or operation of any polluting or potentially polluting activity or any other activity capable of causing environmental degradation is obliged to secure several permits from the relevant environmental agency (federal and/or local, depending on the project).

The environmental permit process and the environmental impact assessment was implemented by the Law nr. 6,938 dated August, 31st 1981 - the National Environmental Policy (from the Portuguese *Política Nacional do Meio Ambiente – PNMA*⁴⁸). Additionally, other norms and laws were issued in order to regulate the permitting process and the environmental impact assessment according to the activity characteristics. Additionally, other norms and laws were issued by the (National Environmental Council Resolution (from the Portuguese *Conselho Nacional do Meio Ambiente - CONAMA*) and local state agencies created to regulate the process.

⁴⁸ Available at: http://www.planalto.gov.br/ccivil_03/leis/L6938.htm



CONAMA nr. 001⁴⁹, issued on January, 23rd 1986, states that power plants with installed capacity greater than 10 MW of installed capacity must apply the permitting process, do the Environmental Impact Assessment (from the Portuguese *Estudo de Impacto Ambiental*) and submit it to the respective environmental state agency in order to obtain the necessary permits for the project.

Also, CONAMA nr. 237⁵⁰, issued on December, 19th 1997, requires the following permits as part of the permitting process:

- The Preliminary Permit (*Licença Prévia* or LP);
- The Construction Permit Permit (*Licença de Instalação* or LI); and
- The Operation Permit (*Licença de Operação* or LO).

The process starts with a previous analysis (preliminary studies) by the local environmental department. In turn, if the project is considered environmentally feasible, the sponsors have to prepare the Environmental Assessment.

The result of those assessments is the Preliminary Permit (LP), which reflects the local environmental agency positive understanding regarding the environmental project concepts.

In order to obtain the Construction Permit (LI) it is necessary to present (a) additional information related to the previous assessment; (b) a new simplified assessment; or (c) the Environmental Basic Project, according to the environmental agency decision informed at the LP.

The Operation Permit (LO) is a result of pre-operational tests during the construction phase to verify if all demands made by environmental local agency were completed.

Besides, CONAMA nr. 279⁵¹, issued on June, 27th 2001, establishes procedures concerning the simplified permitting process. The simplified permitting process is applied for activities which the environment impact is considered small. According to this resolution, wind power plants presents low environment impact and therefore can apply the simplified permitting process and present the environmental impact assessment through the Simplified Environmental Report (from the Portuguese *Relatório Ambiental Simplificado* - RAS). However, if the Environmental Sate Agency understands that further studies are necessary, it may request the sponsor to present the Environmental Impact Assessment (from the Portuguese *Estudo de Impacto Ambiental* – EIA) and the Environmental Impact Report (from the Portuguese *Relatório de Impacto Ambiental* – RIMA)

In this sense, aa *Rio Grande do Norte* Environmental Agency (IDEMA – *Instituto de Desenvolvimento Sustentável e Meio Ambiente do Rio Grande do Norte*) requested to *Mar e Terra* and *Areia Branca* wind power plants sponsors to present the Simplified Environmental report in order to obtain the Preliminary Permit (LP), also issued by IDEMA. IDEMA. On the other hand, *Ceará* Environmental Agency (SEMACE – *Superintendência Estadual do Meio Ambiente*) requested to *Embuaca* and *Icarai* wind power plants sponsors to present the Environmental Impact Assessment (EIA) and the Environmental Impact Report (RIMA) aim to

⁴⁹ Available at: <http://www.mma.gov.br/port/conama/res/res86/res0186.html>

⁵⁰ Available at: <http://www.mma.gov.br/port/conama/res/res97/res23797.html>

⁵¹ Available at: <http://www.mma.gov.br/port/conama/res/res01/res27901.html>



obtain the Preliminary Permit (LP), also issued by SEMACE. . Also, the wind power plants possess the Construction Permit. The LP and LI number of each power plant as well as the issuance date and the expiry dates are described below:

Table 29: Wind Power Plants Preliminary Licenses data.

Wind Power Plant	LP Number	Issuance Date	Expiry Date	Environmental Agency
<i>Mar e Terra</i>	2008-024722/TEC/LP-0174	28/09/2009	29/09/2011	IDEMA
<i>Areia Branca</i>	2008-024720/TEC/LP-0173	28/09/2009	29/09/2011	IDEMA
<i>Embuaca</i>	230/2009	08/10/2009	08/10/2010	SEMACE
	61/2010	15/12/2010	15/12/2011	
<i>Icarai</i>	243/2009	08/10/2009	08/10/2010	SEMACE
	License Renewal	July, 13 th 2010		

Table 30: Wind Power Plants Construction Licenses data.

Wind Power Plant	LI Number	Issuance Date	Expiry Date	Environmental Agency
<i>Mar e Terra</i>	2011-042389/TEC/LI-0008	12/05/2011	12/05/2015	IDEMA
<i>Areia Branca</i>	2011-042391/TEC/LI-0009	12/05/2011	12/05/2015	IDEMA
<i>Embuaca</i>	404/2011	11/10/2011	10/10/2013	SEMACE
<i>Icarai</i>	514/2011	26/12/2011	25/12/2013	SEMACE

D.2. If environmental impacts are considered significant by the project participants or the host Party, please provide conclusions and all references to support documentation of an environmental impact assessment undertaken in accordance with the procedures as required by the host Party:

The growing global concern regarding the sustainable use of resources is driving a requirement for more sensitive environmental management practices. Increasingly this is being reflected in countries' policies and legislation. In Brazil the situation is no different; environmental rules and licensing process policies are very strict in line with the best international practices.

As mentioned in section D.1, power plants with installed capacity greater than 10 MW have to do an environmental impact assessment and a respective environmental impact report in order to obtain the necessary licenses to the project. Given the project already possesses the preliminary environmental license, it can be



concluded that it does not indicate in significant negative transboundary environmental impacts; otherwise the license would not have been issued by the environmental agency.

SECTION E. Stakeholders' comments

E.1. Brief description how comments by local stakeholders have been invited and compiled:

According to Resolution nr. 7, issued on March 5th 2008⁵², Brazilian Designated National Authority (*Comissão Interministerial de Mudanças Globais do Clima – CIMGC*), requests, among other documents, comments from local stakeholders in order to provide the Letter of Approval for a project.

The Resolution determines that the project proponent has to invite for comments, at least, the following agents involved in and affected by project activity:

- Municipal governments and City Councils;
- State and Municipal Environmental Agencies;
- Brazilian Forum of NGOs and Social Movements for Environment and Development;
- Community associations;
- State Attorney for the Public Interest (state and federal);

The same resolution also requires that at the time these letters are sent, a version of the PDD in the local language and a declaration stating how the project contributes to the sustainable development of the country must be made available to these stakeholders at least 15 days previous to the starting of the Global Stakeholder Process (GSP). The Portuguese version of the PDD was published at the internet website <<http://sites.google.com/site/consultadcp/>> on 15/09/2011 which is also the date when the invitation letters were sent to the following agents:

- *Prefeitura de Areia Branca* (Areia Branca City Hall)
- *Prefeitura de Trairi* (Trairi City Hall)
- *Prefeitura de Amontada* (Amontada City Hall)
- *Câmara Municipal de Areia Branca* (Municipal Assembly of Areia Branca)
- *Câmara Municipal de Trairi* (Municipal Assembly of Trairi)
- *Câmara Municipal de Amontada* (Municipal Assembly of Amontada)
- *Secretaria Municipal de Agricultura, Abastecimento e Recursos Hídricos* (Environmental Agency of Areia Branca)
- *Secretaria Municipal do Turismo e Meio Ambiente de Trairi* (Environmental Agency of Trairi)

⁵² Available at: <<http://www.mct.gov.br/>>.



- *Secretaria de Cultura, Turismo e Meio Ambiente de Amontada* (Environmental Agency of Amontada)
- *Sindicato dos Trabalhadores Rurais de Areia Branca* (Communitarian Association of Areia Branca)
- *Sindicato dos Trabalhadores Rurais de Trairi* (Comunitarian Association of Trairi)
- *Sindicato dos Trabalhadores Rurais de Amontada* (Communitarian Association of Amontada)
- *Instituto de Desenvolvimento Sustentável e Meio Ambiente do Rio Grande do Norte – IDEMA* (Rio Grande do Norte Environmental Agency)
- *Superintendência Estadual do Meio Ambiente – SEMACE* (Ceará Environmental Agency)
- *Ministério Público Federal* (State Attorneys for the Public Interest of Brazil)
- *Ministério Público do Rio Grande do Norte* (State Attorney for the Public Interest of Rio Grande do Norte State)
- *Ministério Público do Estado do Ceará* (State Attorney for the Public Interest of Ceará state)
- *Fórum Brasileiro de ONGs e Movimentos Sociais para o Desenvolvimento e Meio Ambiente* (Brazilian Forum of NGOs and Social Movements for the Development and Environment)

Up to date no concerns have been raised in the public invitations regarding the project.

E.2. Summary of the comments received:

No comments have been received yet.

E.3. Report on how due account was taken of any comments received:

No comments have been received yet.

**Annex 1****CONTACT INFORMATION ON PARTICIPANTS IN THE PROJECT ACTIVITY**

Organization:	Eólica Mar e Terra Geração e Comercialização de Energia S.A.
Street/P.O.Box:	Av. Senador Virgílio Távora, 1701 – Sala 1305
Building:	
City:	Fortaleza
State/Region:	Ceará
Postcode/ZIP:	60170-251
Country:	Brazil
Telephone:	+ 55 (85) 3452-7331/7332/7333
FAX:	+ 55 (85) 3021-5336533
E-Mail:	miguel.lobo@martifer.com
URL:	
Represented by:	Miguel Lobo
Title:	
Salutation:	Mr.
Last name:	Lobo
Middle name:	
First name:	Miguel
Department:	
Mobile:	
Direct FAX:	+ 55 (85) 3021-5336
Direct tel:	+ 55 (85) 3452-7331/7332/7333
Personal e-mail:	miguel.lobo@martifer.com

Organization:	Eólica Bela Vista Geração e Comercialização de Energia S.A.
Street/P.O.Box:	Av. Senador Virgílio Távora, 1701 – Sala 1305
Building:	
City:	Fortaleza
State/Region:	Ceará
Postcode/ZIP:	60170-251
Country:	Brazil
Telephone:	+ 55 (85) 3452-7331/7332/7333
FAX:	+ 55 (85) 3021-5336533
E-Mail:	miguel.lobo@martifer.com
URL:	
Represented by:	Miguel Lobo
Title:	
Salutation:	Mr.
Last name:	Lobo
Middle name:	
First name:	Miguel
Department:	
Mobile:	



Direct FAX:	+ 55 (85) 3021-5336
Direct tel:	+ 55 (85) 3452-7331/7332/7333
Personal e-mail:	miguel.lobo@martifer.com

Organization:	Embuaca Geração e Comercialização de Energia S.A.
Street/P.O.Box:	Av. Senador Virgílio Távora, 1701 – Sala 1305
Building:	
City:	Fortaleza
State/Region:	Ceará
Postcode/ZIP:	60170-251
Country:	Brazil
Telephone:	+ 55 (85) 3452-7331/7332/7333
FAX:	+ 55 (85) 3021-5336533
E-Mail:	miguel.lobo@martifer.com
URL:	
Represented by:	Miguel Lobo
Title:	
Salutation:	Mr.
Last name:	Lobo
Middle name:	
First name:	Miguel
Department:	
Mobile:	
Direct FAX:	+ 55 (85) 3021-5336
Direct tel:	+ 55 (85) 3452-7331/7332/7333
Personal e-mail:	miguel.lobo@martifer.com

Organization:	Eólica Icarai Geração e Comercialização de Energia Ltda.
Street/P.O.Box:	Av. Senador Virgílio Távora, 1701 – Sala 13051305
Building:	
City:	FortalezaFortaleza
State/Region:	CearáCeará
Postcode/ZIP:	6017060170-251
Country:	Brazil
Telephone:	+ 55 (8585) 3452-7331/7332/73337333
FAX:	+ 55 (8585) 3021-53365336
E-Mail:	miguel.lobo@martifer.com
URL:	
Represented by:	MiguelMiguel Lobo
Title:	
Salutation:	Mr.
Last name:	LoboLobo
Middle name:	
First name:	MiguelMiguel
Department:	



Mobile:	
Direct FAX:	+ 55 (85) 3021-5336
Direct tel:	+ 55 (85) 3452-7331/7332/7333
Personal e-mail:	miguel.lobo@martifer.com

Organization:	Ecopart Assessoria em Negócios Empresariais Ltda.
Street/P.O.Box:	Rua Padre João Manuel, 222
Building:	
City:	São Paulo
State/Region:	São Paulo
Postfix/ZIP:	01411-000
Country:	Brazil
Telephone:	+55 (11) 3063-9068
FAX:	+55 (11) 3063-9069
E-Mail:	info@eqao.com.br
URL:	www.eqao.com.br
Represented by:	Mrs. Melissa Sawaya Hirschheimer
Title:	
Salutation:	Mrs.
Last Name:	Hirschheimer
Middle Name:	Sawaya
First Name:	Melissa
Department:	
Mobile:	
Direct FAX:	+55 (11) 3063-9069
Direct tel:	+55 (11) 3063-9068
Personal E-Mail:	focalpoint@eqao.com.br



Annex 2

INFORMATION REGARDING PUBLIC FUNDING

No public funding is involved in the present project.

This project is not a diverted ODA from an Annex 1 country.

- - - - -



Annex 3

BASELINE INFORMATION

This section is intentionally left blank. For details please refer to section B.6.1. and B.6.3. above.

- - - - -

Annex 4

MONITORING INFORMATION

A diagram presenting the monitored points is presented below. For further details refer to section B.7.2. above.

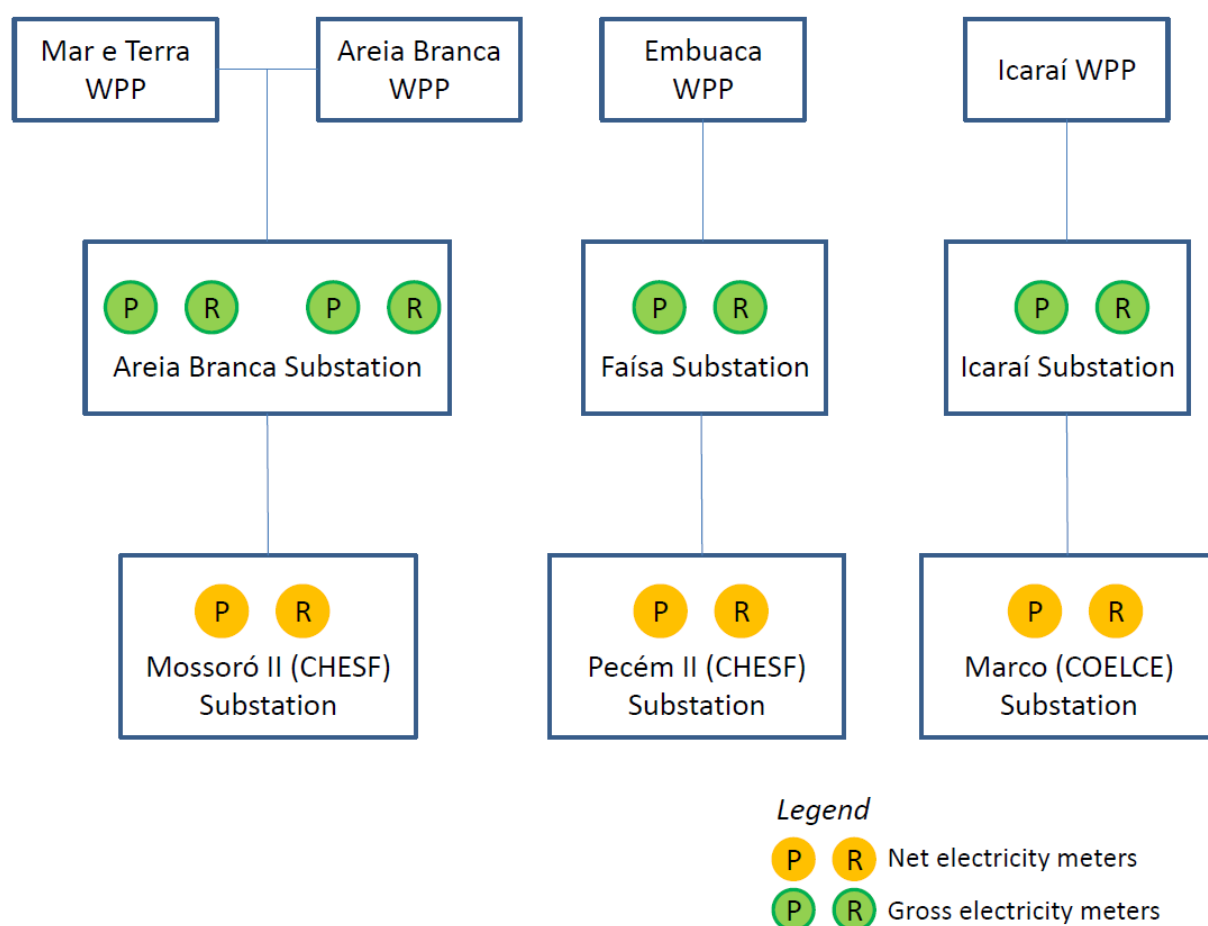


Figure 7: Monitored points of the wind power plants.



- - - - -