



**Monitoring report form
(Version 04.0)**

Complete this form in accordance with the Attachment "Instructions for filling out the monitoring report form" at the end of this form.

MONITORING REPORT

Title of the project activity	Inner Mongolia China Water Group Huade Sandaogou Wind Farm 49.5MW Project
Reference number of the project activity	5781
Version number of the monitoring report	2.0
Completion date of the monitoring report	28/07/2014
Registration date of the project activity	15/02/2012
Monitoring period number and duration of this monitoring period	1 st monitoring period: 01/03/2012 - 28/02/2014 (first and last days included, 730 days in all)
Project participant(s)	China Water Group Huade Wind Power Co., Ltd. (Project owner) Eco-Tec Asia (UK) Ltd. (Buyer)
Host Party(ies)	China
Sectoral scope and selected methodology(ies), and where applicable, applied standardized baseline(s)	01: Energy Industries (renewable resources) Wind Power Generation ACM0002: Consolidated baseline methodology for grid-connected electricity generation from renewable sources (Version 12.2.0, EB 65)
Estimated amount of GHG emission reductions or net anthropogenic GHG removals by sinks for this monitoring period in the registered PDD	92,403 tCO ₂ e / 365days × 730days = 184,806 tCO ₂ e
Actual GHG emission reductions or net anthropogenic GHG removals by sinks achieved in this monitoring period	106,518 tCO ₂ e
Actual GHG emission reductions or net anthropogenic GHG removals by sinks achieved during the period up to 31 December 2012(if applicable)	0 tCO ₂ e
Actual GHG emission reductions or net anthropogenic GHG removals by sinks achieved during the period from 1 January 2013 onwards (if applicable).	106,518 tCO ₂ e

SECTION A. Description of project activity

A.1. Purpose and general description of project activity

>>

The purpose of Inner Mongolia China Water Group Huade Sandaogou Wind Farm 49.5MW Project (hereafter "the Project") is to utilize wind resources for electricity generation. The Project involves the installation of 33 sets of wind turbines with unit capacity of 1500kW, reaching a total capacity of 49.5MW. The electricity supplied by the Project is sold to the North China Power Grid ("NCPG"). The Project will reduce greenhouse gas ("GHG") emissions by avoiding carbon dioxide emissions from the generation of electricity by fossil fuel power plants.

The Project delivers estimated 99,263 MWh of electricity per year to the NCPG with an average load factor of 23%. The Project will reduce greenhouse gas ("GHG") emissions by avoiding carbon dioxide emissions from the generation of electricity by fossil fuel power plants that presently supply the NCPG. The Project's annual expected emissions reduction is 92,403 tCO₂e.

Relevant dates for the Project activity are as below:

Table 1 Project Timeline

Construction start date	13/05/2010
Date of grid connection agreement signed and started operation	01/03/2013
Date of CDM registration	15/02/2012
Fixed crediting period	01/03/2012-28/02/2022
The 1 st monitoring period (this monitoring period)	01/03/2012-28/02/2014

In this monitoring period, 106,518tCO₂e emission reductions were achieved.

A.2. Location of project activity

>>

The Project is located at Sandaogou Wind Farm 10 km away from the southwest of Changshun Town, Huade County, Ulanqab City in the Inner Mongolia Autonomous Region of the People's Republic of China. Huade County is located in the north of Ulanqub City, and centre of Inner Mongolia Autonomous Region. The centre geographic coordinates of the wind farm is 113.8917°E and 41.8666°N. The Project site covers an area of 113.8712°E ~ 113.9154°E and 41.8354°N ~ 41.8975°N.

A.3. Parties and project participant(s)

Party involved ((host) indicates a host Party)	Private and/or public entity(ies) project participants (as applicable)	Indicate if the Party involved wishes to be considered as project participant (Yes/No)
China (host)	China Water Group Huade Wind Power Co., Ltd.	No
United Kingdom of Great Britain and Northern Ireland	Eco-Tec Asia (UK) Ltd	No

A.4. Reference of applied methodology and standardized baseline

>>

The applied approved methodology to the Project is ACM0002: "Consolidated baseline methodology for grid-connected electricity generation from renewable sources" (Version 12.2.0, EB 65)

The methodology refers to the following tools:

"Tool for the demonstration and assessment of additionality" (Version 05.2.1 EB 39)

"Tool to calculate the emission factor for an electricity system" (Version 02.2.1, EB63)

For more information please refer to:

<http://cdm.unfccc.int/methodologies/PAmethodologies/approved.html>

A.5. Crediting period of project activity

>>

Table 2 Crediting Period of the Project

Crediting period	Fixed crediting period
Starting date of crediting period	01/03/2012
End date of crediting period	28/02/2022

A.6. Contact information of responsible persons/ entities

>>

Responsible Person: Wu Xin
 Responsible Entity: Eco-Tec Asia (UK) Ltd
 Address: 18A Zhong Guan Cun South Street, B1505, New Logo International Building,
 Haidian District, Beijing.
 Postcode: 100081
 Telephone: (86)-10-6215 6001 ext 811
 Facsimile: (86)-10-6215 6006
 E-mail: colin.wu@ecotec-asia.com

SECTION B. Implementation of project activity**B.1. Description of implemented registered project activity**

>>

The Project activity was started construction on 13/05/2010. All the wind turbines have been put into full commercial operation since 01/03/2013, and well operated during this monitoring period.

During this monitoring period, the Project was in normal and smooth operation as per the registered PDD without any emergencies or special events. There have been no overhaul times, downtimes of equipment, exchange of equipment that occurred during the monitoring period; and no events or situations that occurred during the monitoring period, which may impact the applicability of the applied methodology.

All 33 sets of wind turbines are produced by Xinjiang Goldwind Technology Co., Ltd. with a rated capacity of 1.5MW, accumulating a total capacity of 49.5MW. Key technical parameters of the wind turbines are listed in table 3.

Table 3 Key Technical Specifications of Wind Turbines

Parameters		Value
Manufacturer / Type		Xinjiang Goldwind Technology Co., Ltd. GW77/1500kW
Life Time (Year)		20
Annual Operation Hours (Hours)		2005
Plant Load Factor (PLF)		0.23
Wind Wheel	Diameter (m)	77
	Rated Capacity (kW)	1500
	Cut-in Wind Speed (m/s)	3
	Rated Wind Speed (m/s)	12
	Cut-out Wind Speed (m/s)	22
	Operation Temperature(°C)	-30°C~+40°C
	Type	Variable blade
Swept Area (m ²)		4656

Generator	Type	Direct-drive permanent magnet synchronous generator
	Capacity (kW)	1580
	Rated Voltage (V)	690
	Rated Current (A)	660
Braking System	Main Braking System	Pneumatic brake
	Second Braking System	Mechanical brake
Tower	Type	cone
	Hub Height (m)	62.8
Power factor		0.95 (inductor) ~ 0.95 (capacitor)

These turbines are expected to deliver 99,263 MWh of electricity to the NCPG annually.

The project will share the same gateway electrical meters at the Xingguang 220kV Substation with other seven projects developed by the same project owner. The list of the eight projects that share the same gateway electrical meters at the Xingguang 220kV Substation is as below:

- Huade Phase I project: *Huade Changshun 49.5MW Wind Power Project* (ref. No. 2093);
- **the Project:**
Huade Phase II project: *Inner Mongolia China Water Group Huade Sandaogou Wind Farm 49.5MW Project* (ref. No. 5781);
- Huade Phase III project: *Inner Mongolia China Water Group Huade Heping Wind Farm 49.5MW Project* (ref. No. 5900);
- Huade Phase IV project: *Inner Mongolia China Water Group Huade Niujiacun Wind Farm 49.5MW Project* (ref. No. 5883);
- Huade Phase V project: *Inner Mongolia China Water Group Huade Niujiatangzi Wind Farm 49.5MW Project* (ref. No. 5992);
- Huade Phase VI project: *Inner Mongolia China Water Group Huade Sitaifangzi Wind Farm 49.5MW Project* (ref. No. 5990);
- Huade Phase VII project: *Inner Mongolia China Water Group Huade Erligetu Wind Farm 49.5MW Project* (ref. No. 5904);
- Huade Phase VIII project: *Inner Mongolia China Water Group Huade Cheliwusu Wind Farm 49.5MW Project* (ref. No. 5909);

The two bi-directional gateway meters (one is the main meter and the other is the back-up meter) are installed at the 220kV side of the Xingguang 220kV Substation to monitor the total amount of electricity delivered to and purchased from the NCPG by the eight projects simultaneously and the net total amount of electricity supplied to the NCPG by the eight projects activity would be calculated based on the readings of those meters. In order to calculate the exact amount of electricity delivered to and purchased from the NCPG by the eight projects respectively, there have installed an bi-directional electrical meter at each of the 35kV transmission lines for each of the eight projects.

The line diagram showing all relevant monitoring points is as following:

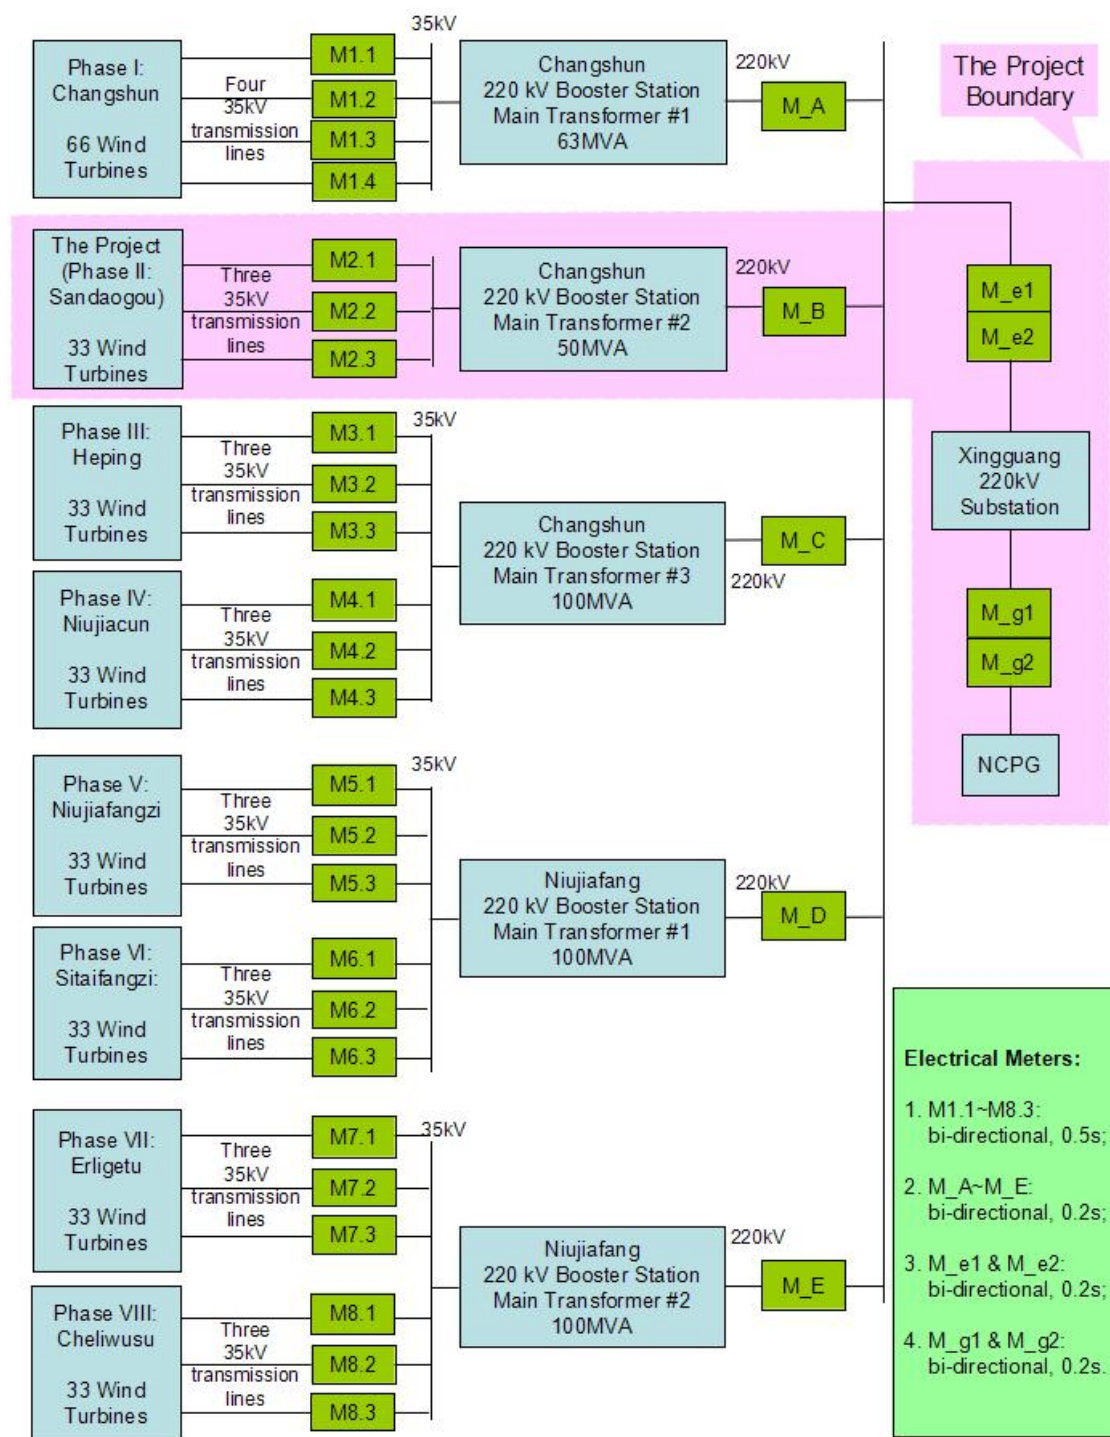


Figure 1 Electricity Generation Process by Wind Energy

B.2. Post registration changes

B.2.1. Temporary deviations from registered monitoring plan, applied methodology or applied standardized baseline

>>

During the monitoring period 1 March 2012 to 28 February 2014, all parameters in Formula <1> stated in Section C of MR and Section B.7.1 of the registered monitoring plan have been monitored and recorded except for $ES_{j,i,import,y}$. The meters monitoring the electricity imported from the grid to the Phase j project were managed and recorded by the 8 projects' owner. The incompleteness and loss of monitoring data for 8 projects from these meters in some months during this monitoring period were reported by the project participants. To be conservative, the total amount of electricity imported from the grid to all 8 projects was

applied as the electricity imported from the grid for the proposed project in this monitoring period, and the Formula <1> is revised to Formula <1*> as stated in Section C of MR. The temporary deviation was applied for the duration of 1 March 2012 to 28 February 2014.

B.2.2. Corrections

>>

The Project is implemented as in the registered monitoring plan, Except for below changes, which are due to the change of grid company regulation. Relative corrections have been made to registered monitoring plan.

In the registered monitoring plan, it stated that the meters M_D and M_E are location at Niujiatangzi 220 kV Booster Station. By the time the registered monitoring plan was submitted, the referred booster station for phase V~VIII projects (i.e. Niujiatangzi, Sitaifangzi, Erligetu and Cheliwusu) was still under construction, the registered monitoring plan stated the booster station's name as "Niujiatangzi" based on the Project owner's estimation because the booster station was located at Niujiatangzi village. And the former MR took this name from the registered monitoring plan. However, this name has been set as "Niujiatang" in the power dispatching management system by the grid company when signing the Grid Connection Agreement with Inner Mongolia Power Dispatching and Communicating Center. The registered monitoring plan should and has been revised accordingly.

B.2.3. Permanent changes from registered monitoring plan, applied methodology or applied standardized baseline

>>

The Project is implemented as in the registered monitoring plan and applied methodology, Except for below change, which is due to the change of grid company regulation.

- In the registered monitoring plan, it stated that the grid company and the Project owner will record the amount of the net electricity delivered to the NCPG from the meters on the last day of every month. However, according to the PPA, "on the last day of every month" should be revised into "on the 20th of every month". This is because by the time the registered monitoring plan was submitted, the PPA of the Project has not been signed yet. The registered monitoring plan stated the last day of every month as the day to record electricity amount as estimation based on the former practice. However, this date has been set as 20th of every month when the PPA was signed. The registered monitoring plan should and has been revised accordingly.
- In the registered PDD, it stated that the meter M_A is the uni-directional meter, and the accuracy is 0.5S. However, the meter M_A has been updated to a bi-directional 0.2S meter before this monitoring period. The reason is that the Phase 1 project and Changshun Booster station where M_A installed started construction in September 2008, when the Phase 2~Phase 8 projects had not been planned yet. A 0.5S uni-directional M_A was installed then by the project owner for their on-site measurement for Phase 1 project only. However, when the Phase 2~Phase 8 projects started construction, their respective M_B ~ M_E were planned to use 0.2S bi-directional meters to meet higher measurement requirements. And so there has been a replacement of meter M_A, changing from a 0.5S uni-directional meter to the current 0.2S bi-directional meter to be consistent with the Phase 2~Phase 8 projects since 27/11/2010, before the registration date and crediting period of the Project. The registered PDD took the old meter information; it should and has been revised to the current information.

B.2.4. Changes to project design of registered project activity

>>

None.

B.2.5. Changes to start date of crediting period

>>

None.

B.2.6. Types of changes specific to afforestation or reforestation project activity

>>

Not applicable.

SECTION C. Description of monitoring system

>>

- **Data collection procedures**
 - **Data generation and aggregation**

As described in the registered PDD, the net electricity supplied to the grid from the Project ($EG_{facility,y}$) is monitored parameters. Its monitoring system is achieved by the following monitored parameters:

Table 4 The Data Collection and Handling

Monitoring Data	$ES_{j,i, export,y}$ ($j=I, II, III, IV, V, VI, VII, VIII$; $i=1, 2, 3, 4$ for Phase I project, $i=1, 2, 3$ for the other 7 projects) $ES_{j,i, import,y}$ have not been monitored as per PDD due to the fact that the electricity company has taken the monthly imported electricity amount as pre-set amount instead of monitored amount.	$ES_{p, export,y}$ ($p=A, B, C, D, E$) $ES_{p, import,y}$ ($p=A, B, C, D, E$)	$ES_{total, export,y}$ & $ES_{total, import,y}$		$EG_{facility,y}$
Monitoring Equipments	25 meters: $M_{j,i}$ ($j=1, 2, \dots, 8$; $i=1, 2, 3, 4$ for Phase I project, $i=1, 2, 3$ for the other 7 projects)	5 meters: M_p ($p=A, B, C, D, E$; bi-directional)	2 evaluation meters (M_{e1} as main and M_{e2} as its back-up meter)	2 gateway meters (M_{g1} as main and M_{g2} as its back-up meter)	Measured based on the meters: $M_{g1}, M_{j,i}$ ($j=1, 2, \dots, 8$; $i=1, 2, 3, 4$ for Phase I project where $j=1, i=1, 2, 3$ for the other 7 projects where $j=2 \sim 7$).
Data Collection	The Project owner will record these data on the 20 th of every month, and store the relevant documents.			The grid company and the Project owner will record these data on the 20 th of every month The grid company will issue the invoice of imported electricity and the project owner will issue the invoice of	The Project owner will perform calculation based on Formula <1*> and the monitored results every month, and store the relevant documents.

		exported electricity.	
Data Handling	Monthly monitoring results will be signed off and approved by CDM Project Manager before it is accepted and stored. This internal audit will check compliance with operational procedures in the monitoring plan, and will also identify potential improvements to procedures to improve monitoring and reporting in future.		
	The Project owner will provide meter readings and invoice photocopies to DOE for verification.		

• **Data calculation**

Based on the registered PDD, $EG_{\text{facility},y}$ can be calculated as follows:

Formula <1>:

$$EG_{\text{facility},y} = ES_{\text{total},\text{export},y} \times \frac{\sum_{i=1}^3 ES_{II,i,\text{export},y}}{\sum_{i=1}^4 ES_{I,i,\text{export},y} + \sum_{j=II}^{VIII} \sum_{i=1}^3 ES_{j,i,\text{export},y}} - ES_{\text{total},\text{import},y} \times \frac{\sum_{i=1}^3 ES_{II,i,\text{import},y}}{\sum_{i=1}^4 ES_{I,i,\text{import},y} + \sum_{j=II}^{VIII} \sum_{i=1}^3 ES_{j,i,\text{import},y}}$$

Where:

$EG_{\text{facility},y}$: is quantity of net electricity generation supplied by the Project to the NCPG in year y.

$ES_{\text{total},\text{export},y}$: is the total amount of electricity exported to the grid from all the eight projects developed by the same project owner as listed above measured by the same gateway meter(s) M_g1 (and M_g2 as its back-up);

$ES_{\text{total},\text{import},y}$: is the total amount of electricity imported from the grid to all the eight projects developed by the same project owner as listed above measured by the gateway meter(s) M_g1 (and M_g2 as its back-up);

$ES_{j,i,\text{export},y}$: is the electricity exported to the grid by the Phase j project part i (j=I, II, III, ..., VIII; i=1, 2, 3, 4 for Phase I project, i=1, 2, 3 for the other 7 projects) measured by the meter Mj.i (j=1, 2, 3, ..., 8; i=1, 2, 3, 4 for Phase I project, i=1, 2, 3 for the other 7 projects) at the project site;

$ES_{j,i,\text{import},y}$: is the electricity imported from the grid to the Phase j project part i (j=I, II, III, ..., VIII; i=1, 2, 3, 4 for Phase I project, i=1, 2, 3 for the other 7 projects) measured by the meter Mj.i (j=1, 2, 3, ..., 8; i=1, 2, 3, 4 for Phase I project, i=1, 2, 3 for the other 7 projects) at the project site;

During this monitoring period, all parameters in Formula <1> have been monitored and recorded except for $ES_{j,i,\text{import},y}$. The meters monitoring the electricity imported from the grid to the Phase j project were managed and recorded by the 8 projects' owner. The incompleteness and loss of monitoring data for 8 projects from these meters in some months during this monitoring period were reported by the project participants. To be conservative, the Formula <1> is revised to:

Formula <1*>:

$$EG_{\text{facility},y} = ES_{\text{total},\text{export},y} \times \frac{\sum_{i=1}^3 ES_{II,i,\text{export},y}}{\sum_{i=1}^4 ES_{I,i,\text{export},y} + \sum_{j=II}^{VIII} \sum_{i=1}^3 ES_{j,i,\text{export},y}} - ES_{\text{total},\text{import},y}$$

The location of main meters, separate meters and transmission lines are displayed as following:

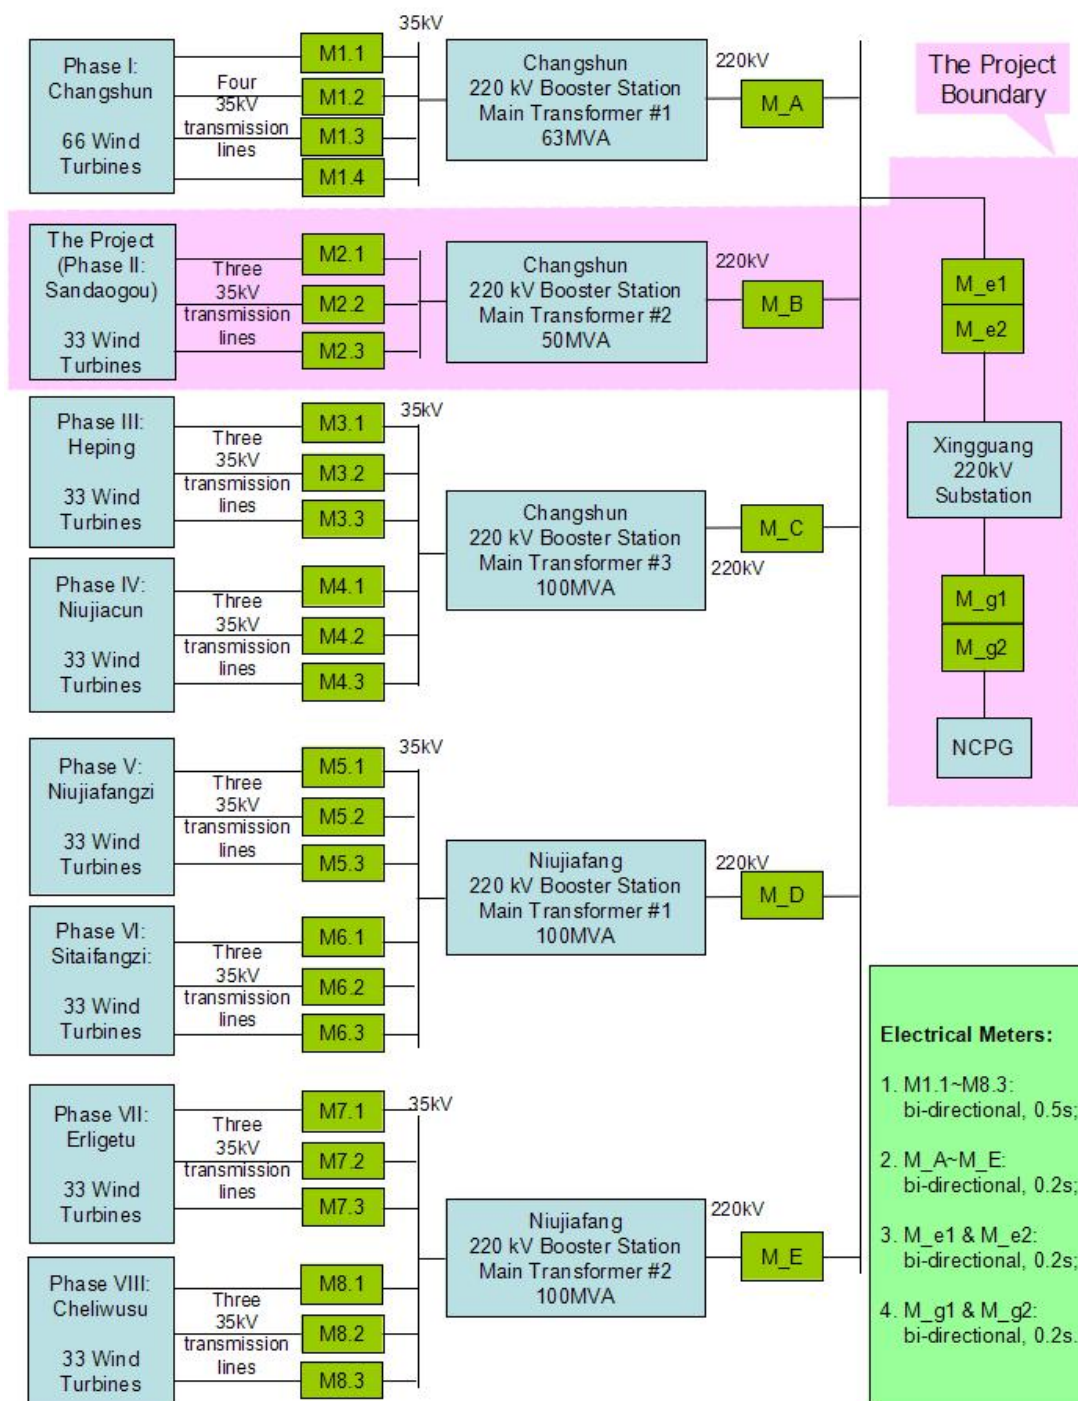


Figure 2 Diagram for metering points of the Project

• Monitoring organization

The Project owner retains overall responsibility for daily monitoring and reporting. A CDM group will be established within the Project owner to carry out the required monitoring work. The project owner will appoint a CDM manager with responsibility for monitoring the data related to the calculation of emission reductions. Technical and financial teams will also be organized to assist the CDM manager, as displayed in Figure below.

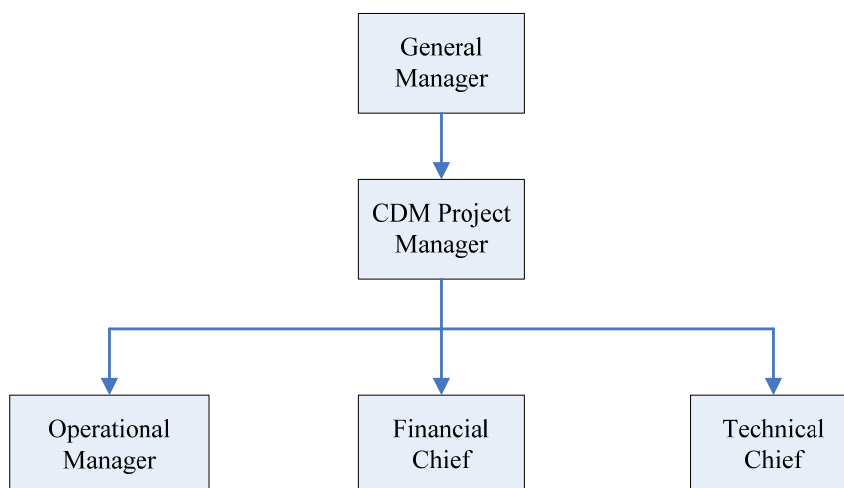


Figure 3 Structure of CDM group

The responsibilities of the Project staff are as follow:

- **General Manager:** to be responsible for the overall execution of the monitoring plan;
- **CDM project Manager:** to make sure each division of the monitoring team works as stipulated in the monitoring plan; report the monitoring work to general manager; responsible for periodic verification, etc.;
- **Operation Manager:** to be responsible for daily operation and electricity meter reading and recording;
- **Financial Chief:** to keep sales and/or purchase receipts, if any; and
- **Technical Chief:** to make sure that all the electricity meters are maintenance regularly according to industrial standard.
- **Emergency procedure**

Once a monitoring meter in fault, it shall be replaced immediately with another calibrated meter by a professional engineer within one month. Failure events will be recorded in the site events log book. The fault meter shall be repaired and calibrated only by national designated institutions with metering certificate.

- If the main gateway meter M_{g1} reading exceeds the allowable error or the meter functions improperly, the net electricity supplied to NCPG by the Project shall be determined according to Formula <1*> as follows:
 - The total amount of electricity exported to or imported from the grid will be calculated according to the backup gateway meter M_{g2}, unless a test by either party reveals that it is inaccurate;
- If the errors of both the gateway meters M_{g1} and M_{g2} exceed the national or trade standard allowance levels or the meters function improperly, the quantity of net electricity supplied to the NCPG by the Project will be calculated according to Formula <1*> as follows:
 - The total amount of electricity exported to or imported from the grid will be calculated according to the main evaluation electricity meter M_{e1} readings with consideration of the historical line loss rate, unless either party doubts the meter's accuracy;
- If the errors of both the gateway meters M_{g1} and M_{g2}, as well as the main evaluation electricity meter M_{e1} exceed the national or trade standard allowance levels or the meters function improperly, the quantity of net electricity supplied to NCPG by the Project will be calculated according to Formula <1*> as follows:
 - The total amount of electricity exported to or imported from the grid will be calculated according to the back-up evaluation electricity meter M_{e2} readings with consideration of the historical line loss rate, unless either party doubts the meter's accuracy;

- If the errors of all the two gateway meters M_g1 and M_g2 and the two evaluation meters M_e1 and M_e2, or any of the meters Mj.i (j=1, 2, 3, 4, 5, 6, 7, 8; i=1, 2, 3, 4 for Phase I project and i=1, 2, 3 for other seven projects) exceed the national or trade standard allowance levels or the meters function improperly, the quantity of net electricity supplied to NCPG by the Project will be calculated according to Formula <2> as follows:

- The readings from the meter at the 220kV sides of the main transformer connecting to the Project at the wind farm on-site booster station M_B will be used, with consideration of historical transmission line losses.

Formula <2>:

$$EG_{facility,y} = ES_{B, export, y} - ES_{B, import, y};$$

- If the errors of all the two gateway meters M_g1 and M_g2 and the two evaluation meters M_e1 and M_e2, and the meter at the 220kV side of the main transformer connecting to the Project at the wind farm on-site booster station M_B exceed the national or trade standard allowance levels or the meters function improperly, the quantity of net electricity supplied to NCPG by the Project will be calculated according to Formula <3> as follows:

- The readings from the meters at 35kV lines Mj.i (j=2; i=1, 2, 3) will be used, with consideration of historical transmission line losses and transformer losses.

Formula <3>:

$$EG_{facility,y} = \sum_{i=1}^3 ES_{II, i, export, y} - \sum_{i=1}^3 ES_{II, i, import, y}$$

- If the errors of all the two gateway meters M_g1 and M_g2 and the two evaluation meters M_e1 and M_e2, and the meter at the 220kV side of the main transformer connecting to the Project at the wind farm on-site booster station M_B, and any of the meters at 35kV lines Mj.i (j=2; i=1, 2, 3) exceed the national or trade standard allowance levels or the meters function improperly, the electricity generation during the period of erroneous measurement and replacement of the fault meter shall not be accounted to calculate the emission reduction for conservative consideration.

For the above situation (2), (3), (4) and (5):

- If the evaluation electricity meter does not have an acceptable level of precision, the project owner and the grid company will design a reasonable and conservative evaluation method together. In this event, the project owner will provide sufficient evidence to demonstrate the method's rationality and conservatism during the validation and verification processes.
- If the project owner and the grid company are unable to agree on the evaluation method, they will participate in an arbitration process to ensure the consistency of the evaluation method as provided for by their agreement.

SECTION D. Data and parameters

D.1. Data and parameters fixed ex ante or at renewal of crediting period

(Copy this table for each piece of data and parameter.)

Data / Parameter:	EF _{grid, CM, y}
Unit:	tCO ₂ /MWh
Description:	Baseline emission factor
Source of data:	Registered PDD
Value(s) applied:	0.9309
Purpose of data:	Baseline emission calculation
Additional comment:	Ex-anted according to the applied methodology

D.2. Data and parameters monitored

Data / Parameter:	$ES_{j,i, \text{export}, y}$ ($j=I, II, III, IV, V, VI, VII, VIII$; $i=1, 2, 3, 4$ for Phase I project, $i=1, 2, 3$ for the other 7 projects)
Unit:	MWh
Description:	Electricity exported to the grid by the Phase j project ($j=I, II, III, IV, V, VI, VII, VIII$) part i ($i=1, 2, 3, 4$ for Phase I project, $i=1, 2, 3$ for the other 7 projects) in year y.
Measured/ Calculated / Default:	Measured by the separate bi-directional meter $M_{j,i}$ at the Phase j project's site with the accuracy of 0.5s.
Source of data:	Meter records.
Value(s) of monitored parameter:	Refer to Section E.

Monitoring equipment:	Information of monitoring equipments:				
	Mj.i				
	Item	M1.1	M1.2	M1.3	M1.4
	Type	DTSD341	DTSD341	DTSD341	DTSD341
	SN	090600948600 05	090600948600 04	090600948600 10	090600948600 11
	Item	M2.1	M2.2	M2.3	
	Type	DTSD341	DTSD341	DTSD341	
	SN	100804020900 0013	100804020900 0009	100804020900 0014	
	Item	M3.1	M3.2	M3.3	
	Type	DTSD341	DTSD341	DTSD341	
	SN	100804020900 0008	100804020900 0002	100804020900 0012	
	Item	M4.1	M4.2	M4.3	
	Type	DTSD341	DTSD341	DTSD341	
	SN	100804020900 0004	100804020900 0003	100804020900 0001	
	Item	M5.1	M5.2	M5.3	
	Type	DTSD719	DTSD719	DTSD719	
	SN	420052504110 8348712	420052504110 8348711	420052504110 8348706	
	Item	M6.1	M6.2	M6.3	
	Type	DTSD719	DTSD719	DTSD719	
	SN	420052504110 8348709	420052504110 8348713	420052504110 8348718	
	Item	M7.1	M7.2	M7.3	
Type	DTSD719	DTSD719	DTSD719		
SN	420052504110 8348704	420052504110 8348720	420052504110 8348707		
Item	M8.1	M8.2	M8.3		
Type	DTSD719	DTSD719	DTSD719		
SN	420052504110 8348715	420052504110 8348705	420052504110 8348721		
Accuracy class	0.5S				
Calibration frequency	Annual				
Calibration date	01/02/2012 01/05/2012 10/07/2012 07/07/2013				
Valid period	31/01/2013 30/04/2013 09/07/2013 06/07/2014				
Calibration entry	Ulanqab Electric Power Bureau (01/02/2012 and 01/05/2012) Inner Mongolia Ke Gao Electric Technology Testing Co., Ltd. (10/07/2012 and 07/07/2013)				
Measuring/ Reading/ Recording frequency:	Measuring continuously/ Reading daily / Recording monthly.				
Calculation method (if applicable):	N/A.				

QA/QC procedures:	Meters have been calibrated and checked yearly by a qualified third party for accuracy in accordance with national standards JJG1055-1997 and DL/T448—2000.
Purpose of data:	Baseline emission calculation.
Additional comment:	N/A.

Data / Parameter:	$ES_{j,i, import, y}$ ($j=I, II, III, IV, V, VI, VII, VIII$; $i=1, 2, 3, 4$ for Phase I project, $i=1, 2, 3$ for the other 7 projects)
Unit:	MWh
Description:	Electricity imported from the grid to the Phase j project ($j=I, II, III, IV, V, VI, VII, VIII$) part i ($i=1, 2, 3, 4$ for Phase I project, $i=1, 2, 3$ for the other 7 projects) in year y.
Measured/ Calculated / Default:	Measured by the separate bi-directional meter $M_{j,i}$ at the Phase j project's site with the accuracy of 0.5s.
Source of data:	Meter records.
Value(s) of monitored parameter:	$ES_{j,i, import, y}$ have not been monitored as per PDD due to the fact that the electricity company has signed a contract with the project owner to take the monthly imported electricity amount as pre-agreed amount instead of monitored amount.
Monitoring equipment:	The same 25 meters to monitor $ES_{j,i, export, y}$.
Measuring/ Reading/ Recording frequency:	Measuring continuously/ Reading daily / Recording monthly.
Calculation method (if applicable):	N/A.
QA/QC procedures:	Meters have been calibrated and checked yearly by a qualified third party for accuracy in accordance with national standards JJG1055-1997 and DL/T448—2000.
Purpose of data:	Baseline emission calculation.
Additional comment:	During this monitoring period, $ES_{j,i, import, y}$ has not been monitored due to the fact that the electricity company has signed a contract with the project owner to take the monthly imported electricity amount as pre-agreed amount instead of monitored amount.

Data / Parameter:	$ES_{total, export, y}$
Unit:	MWh
Description:	Total electricity exported to the grid by all the 8 projects (including the Project) in year y.
Measured/ Calculated / Default:	Measured by the gateway electrical meter M_{g1} (and M_{g2} as its back-up meter) at the 220kV Xingguang substation with the accuracy of 0.2s.
Source of data:	Meter records.
Value(s) of monitored parameter:	Refer to Section E.

Monitoring equipment:	Information of monitoring equipments: M_g1 (M_g2 as its back-up meter) and M_e1 (M_e2 as its back-up meter) <table border="1"> <tr> <td>Item</td><td>M_g1</td><td>M_g2</td><td>M_e1</td><td>M_e2</td></tr> <tr> <td>Type</td><td>LANDIS</td><td>LANDIS</td><td>LANDIS</td><td>LANDIS</td></tr> <tr> <td>SN</td><td>95 411 060</td><td>95 411 068</td><td>96 057 671</td><td>95 411 066</td></tr> <tr> <td>Accuracy class</td><td colspan="4">0.2S</td></tr> <tr> <td>Calibration frequency</td><td colspan="4">Annual</td></tr> <tr> <td>Calibration date</td><td colspan="2"> 06/03/2011 04/03/2012 01/06/2012 22/03/2013 </td><td colspan="2"> 05/03/2011 03/03/2012 31/05/2012 22/03/2013 </td></tr> <tr> <td>Valid period</td><td colspan="2"> 05/03/2012 03/03/2013 31/05/2013 21/03/2014 </td><td colspan="2" rowspan="2"> 04/03/2012 02/03/2013 30/05/2013 21/03/2014 </td></tr> <tr> <td>Calibration entry</td><td colspan="4">Inner Mongolia Electric Power Research Institute Electric Metering Testing Centre</td></tr> </table>	Item	M_g1	M_g2	M_e1	M_e2	Type	LANDIS	LANDIS	LANDIS	LANDIS	SN	95 411 060	95 411 068	96 057 671	95 411 066	Accuracy class	0.2S				Calibration frequency	Annual				Calibration date	06/03/2011 04/03/2012 01/06/2012 22/03/2013		05/03/2011 03/03/2012 31/05/2012 22/03/2013		Valid period	05/03/2012 03/03/2013 31/05/2013 21/03/2014		04/03/2012 02/03/2013 30/05/2013 21/03/2014		Calibration entry	Inner Mongolia Electric Power Research Institute Electric Metering Testing Centre			
Item	M_g1	M_g2	M_e1	M_e2																																					
Type	LANDIS	LANDIS	LANDIS	LANDIS																																					
SN	95 411 060	95 411 068	96 057 671	95 411 066																																					
Accuracy class	0.2S																																								
Calibration frequency	Annual																																								
Calibration date	06/03/2011 04/03/2012 01/06/2012 22/03/2013		05/03/2011 03/03/2012 31/05/2012 22/03/2013																																						
Valid period	05/03/2012 03/03/2013 31/05/2013 21/03/2014		04/03/2012 02/03/2013 30/05/2013 21/03/2014																																						
Calibration entry	Inner Mongolia Electric Power Research Institute Electric Metering Testing Centre																																								
Measuring/ Reading/ Recording frequency:	Measuring continuously/ Reading daily / Recording monthly.																																								
Calculation method (if applicable):	N/A.																																								
QA/QC procedures:	Meters have been calibrated and checked yearly by a qualified third party for accuracy in accordance with national standards JJG1055-1997 and DL/T448—2000.																																								
Purpose of data:	Baseline emission calculation.																																								
Additional comment:	N/A.																																								

Data / Parameter:	$ES_{total, import, y}$
Unit:	MWh
Description:	Total electricity imported from the grid to all the 8 projects (including the Project) in year y.
Measured/ Calculated / Default:	Measured by the gateway electrical meter M_g1 (and M_g2 as its back-up meter) at the 220kV Xingguang substation with the accuracy of 0.2s.
Source of data:	Meter records.
Value(s) of monitored parameter:	Refer to Section E.
Monitoring equipment:	The same 4 meters to monitor $ES_{total, export, y}$.
Measuring/ Reading/ Recording frequency:	Measuring continuously/ Reading daily / Recording monthly.
Calculation method (if applicable):	N/A.
QA/QC procedures:	Meters have been calibrated and checked yearly by a qualified third party for accuracy in accordance with national standards JJG1055-1997 and DL/T448—2000.
Purpose of data:	Baseline emission calculation.
Additional comment:	N/A.

Data / Parameter:	$ES_{p, export, y}$
Unit:	MWh

Description:	The amount of electricity exported to the grid from the wind farm connected to the transformer p (p=A, B, C, D, E) in year y.																																																						
Measured/ Calculated / Default:	Measured by the electrical meter M_p at the 220kV side of the 35~220kV on-site booster station with the accuracy of 0.2s (p=A, B, C, D, E) respectively.																																																						
Source of data:	Meter records.																																																						
Value(s) of monitored parameter:	Refer to Section E.																																																						
Monitoring equipment:	<p>Information of monitoring equipments:</p> <table border="1"> <tr> <td>M_p</td><td></td><td></td><td></td><td></td><td></td></tr> <tr> <td>Item</td><td>M_A</td><td>M_B</td><td>M_C</td><td>M_D</td><td>M_E</td></tr> <tr> <td>Type</td><td>DTSD718</td><td>DTSD341</td><td>DTSD341</td><td>DTSD718</td><td>DTSD718</td></tr> <tr> <td>SN</td><td>420041504 110834726 1</td><td>100804018 40001</td><td>100804018 40002</td><td>420041504 110834725 8</td><td>420041504 110834726 0</td></tr> <tr> <td>Accuracy class</td><td colspan="5">0.2S</td></tr> <tr> <td>Calibration frequency</td><td colspan="5">Annual</td></tr> <tr> <td>Calibration date</td><td colspan="5">01/02/2012 01/05/2012 01/04/2013</td></tr> <tr> <td>Valid period</td><td colspan="5">31/01/2013 30/04/2013 31/03/2014</td></tr> <tr> <td>Clibration entiry</td><td colspan="5">Ulanqab Electric Power Bureau (01/02/2012 and 01/05/2012) Inner Mongolia Ke Gao Electric Technology Testing Co., Ltd. (01/04/2013)</td></tr> </table>	M_p						Item	M_A	M_B	M_C	M_D	M_E	Type	DTSD718	DTSD341	DTSD341	DTSD718	DTSD718	SN	420041504 110834726 1	100804018 40001	100804018 40002	420041504 110834725 8	420041504 110834726 0	Accuracy class	0.2S					Calibration frequency	Annual					Calibration date	01/02/2012 01/05/2012 01/04/2013					Valid period	31/01/2013 30/04/2013 31/03/2014					Clibration entiry	Ulanqab Electric Power Bureau (01/02/2012 and 01/05/2012) Inner Mongolia Ke Gao Electric Technology Testing Co., Ltd. (01/04/2013)				
M_p																																																							
Item	M_A	M_B	M_C	M_D	M_E																																																		
Type	DTSD718	DTSD341	DTSD341	DTSD718	DTSD718																																																		
SN	420041504 110834726 1	100804018 40001	100804018 40002	420041504 110834725 8	420041504 110834726 0																																																		
Accuracy class	0.2S																																																						
Calibration frequency	Annual																																																						
Calibration date	01/02/2012 01/05/2012 01/04/2013																																																						
Valid period	31/01/2013 30/04/2013 31/03/2014																																																						
Clibration entiry	Ulanqab Electric Power Bureau (01/02/2012 and 01/05/2012) Inner Mongolia Ke Gao Electric Technology Testing Co., Ltd. (01/04/2013)																																																						
Measuring/ Reading/ Recording frequency:	Measuring continuously/ Reading daily / Recording monthly.																																																						
Calculation method (if applicable):	N/A.																																																						
QA/QC procedures:	Meters have been calibrated and checked yearly by a qualified third party for accuracy in accordance with national standards JJG1055-1997 and DL/T448—2000.																																																						
Purpose of data:	Baseline emission calculation.																																																						
Additional comment:	N/A.																																																						

Data / Parameter:	$ES_{p, import, y}$
Unit:	MWh
Description:	The amount of electricity imported from the grid to the wind farm connected to the transformer p (p=A, B, C, D, E) in year y.
Measured/ Calculated / Default:	Measured by the electrical meter M_p at the 220kV side of the 35~220kV on-site booster station with the accuracy of 0.2s (p=A, B, C, D, E) respectively.
Source of data:	Meter records.
Value(s) of monitored parameter:	Refer to Section E.
Monitoring equipment:	The same 5 meters to monitor $ES_{p, export, y}$.
Measuring/ Reading/ Recording frequency:	Measuring continuously/ Reading daily / Recording monthly.
Calculation method (if applicable):	N/A.

QA/QC procedures:	Meters have been calibrated and checked yearly by a qualified third party for accuracy in accordance with national standards JJG1055-1997 and DL/T448—2000.
Purpose of data:	Baseline emission calculation.
Additional comment:	N/A.

Data / Parameter:	$EG_{facility, y}$
Unit:	MWh
Description:	Quantity of net electricity generation supplied by the Project to the grid in year y.
Measured/ Calculated / Default:	Calculated.
Source of data:	Calculated based on the meters: M_g1 (with the meter M_g2 as its back-up meter), Mj.i (j=1, 2, ..., 8; i=1, 2, 3, 4 for Phase I project where j=1, i=1, 2, 3 for the other 7 projects where j=2 ~ 7). Formula <1*>: $EG_{facility, y} = ES_{total, export, y} \times \frac{\sum_{i=1}^3 ES_{II, i, export, y}}{\sum_{i=1}^4 ES_{I, i, export, y} + \sum_{j=II}^8 \sum_{i=1}^3 ES_{j, i, export, y}} - ES_{total, import, y}$
Value(s) of monitored parameter:	114,425
Monitoring equipment:	The parameter $EG_{facility, y}$ is calculated on the basis on the equation stipulated in the section C.
Measuring/ Reading/ Recording frequency:	Measuring continuously/ Reading daily / Recording monthly.
Calculation method (if applicable):	Calculated with the formula presented in Section C.
QA/QC procedures:	The data is directly used for calculation of emission reduction and cross-checked with electricity ETNs.
Purpose of data:	Baseline emission calculation.
Additional comment:	N/A.

D.3. Implementation of sampling plan

>>

Not applicable.

SECTION E. Calculation of emission reductions or GHG removals by sinks

E.1. Calculation of baseline emissions or baseline net GHG removals by sinks

>>

The baseline emissions in year y is calculated as follows:

$$BE_y = EG_{facility, y} \times EF_{grid, CM, y}$$

where:

 BE_y : Baseline emissions in year y (tCO₂e/yr); $EG_{facility, y}$: The net electricity supplied to the grid by the project (MWh); $EF_{grid, CM, y}$: Emission factor of the grid (tCO₂e /MWh) (as calculated ex-ante in the registered PDD and will not be updated during the first crediting period).

According to the registered PDD, the combined baseline emission factor of the North China Power Grid is:

$$EF_{\text{grid,CM,Y}} = 0.9309 \text{ tCO}_2\text{e/MWh.}$$

Table 5 Summary of electricity exported to the grid

Period		PHASE I: CHANGS HUN (ref. No. 2093) ¹	PHASE II: SANDAO GOU (ref. No. 5781)	PHASE III: HEPING (ref. No. 5900)	PHASE IV: NIUJIACU N (ref. No. 5883)	PHASE V: NIUJIAFA NGZI (ref. No. 5992)	PHASE VI: SITAIFAN GZI (ref. No. 5990)	PHASE VII: ERLIGET U (ref. No. 5904)	PHASE VIII: CHELIWU SU (ref. No. 5909)	Sub-total	ES total, export .y
		ES _I , export .y	ES _{II} , export .y	ES _{III} , export .y	ES _{IV} , export .y	ES _V , export .y	ES _{VI} , export .y	ES _{VII} , export .y	ES _{VIII} , export .y		
From	To	MWh	MWh	MWh	MWh	MWh	MWh	MWh	MWh	MWh	MWh
01/03/2012	20/03/2012	n.a.	n.a.	n.a.	n.a.	n.a.	n.a.	n.a.	n.a.	n.a.	n.a.
21/03/2012	20/04/2012	n.a.	n.a.	n.a.	n.a.	n.a.	n.a.	n.a.	n.a.	n.a.	n.a.
21/04/2012	20/05/2012	n.a.	n.a.	n.a.	n.a.	n.a.	n.a.	n.a.	n.a.	n.a.	n.a.
21/05/2012	20/06/2012	n.a.	n.a.	n.a.	n.a.	n.a.	n.a.	n.a.	n.a.	n.a.	n.a.
21/06/2012	20/07/2012	n.a.	n.a.	n.a.	n.a.	n.a.	n.a.	n.a.	n.a.	n.a.	n.a.
21/07/2012	20/08/2012	n.a.	n.a.	n.a.	n.a.	n.a.	n.a.	n.a.	n.a.	n.a.	n.a.
21/08/2012	20/09/2012	n.a.	n.a.	n.a.	n.a.	n.a.	n.a.	n.a.	n.a.	n.a.	n.a.
21/09/2012	20/10/2012	n.a.	n.a.	n.a.	n.a.	n.a.	n.a.	n.a.	n.a.	n.a.	n.a.
21/10/2012	20/11/2012	n.a.	n.a.	n.a.	n.a.	n.a.	n.a.	n.a.	n.a.	n.a.	n.a.
21/11/2012	20/12/2012	n.a.	n.a.	n.a.	n.a.	n.a.	n.a.	n.a.	n.a.	n.a.	n.a.
21/12/2012	20/01/2013	n.a.	n.a.	n.a.	n.a.	n.a.	n.a.	n.a.	n.a.	n.a.	n.a.
21/01/2013	20/02/2013	n.a.	n.a.	n.a.	n.a.	n.a.	n.a.	n.a.	n.a.	n.a.	n.a.
21/02/2013	28/02/2013	n.a.	n.a.	n.a.	n.a.	n.a.	n.a.	n.a.	n.a.	n.a.	n.a.
01/03/2013	20/03/2013	16,016.28	6,953.24	6,160.00	6,881.56	17,976.56	8,710.52	17,668.56	6,364.12	86,730.84	74,811.79
21/03/2013	20/04/2013	11,564.84	14,293.72	14,733.04	12,534.20	13,395.76	13,885.20	12,688.48	12,909.68	106,004.92	103,423.13
21/04/2013	20/05/2013	9,792.16	13,404.16	12,725.16	11,165.28	12,183.36	11,563.44	11,581.08	10,989.44	93,404.08	89,180.43
21/05/2013	20/06/2013	10,712.80	12,513.48	10,653.72	11,108.72	10,695.44	11,174.24	10,547.60	10,913.00	88,319.00	86,372.09
21/06/2013	20/07/2013	5,401.48	7,523.32	6,711.04	7,486.92	6,142.64	6,750.52	5,803.00	6,480.88	52,299.80	51,307.57
21/07/2013	20/08/2013	6,178.48	8,768.20	8,267.56	8,443.96	5,749.80	6,377.84	6,564.60	7,235.20	57,585.64	56,652.54
21/08/2013	20/09/2013	6,860.84	8,207.92	8,242.92	7,818.44	6,653.92	7,073.92	6,775.16	7,192.36	58,825.48	57,264.53
21/09/2013	20/10/2013	9,527.28	12,934.88	11,519.20	11,653.32	10,539.20	10,917.48	10,045.00	10,376.80	87,513.16	86,222.46
21/10/2013	20/11/2013	9,976.68	9,922.08	10,877.44	10,556.28	8,630.72	9,000.04	10,144.40	10,314.08	79,421.72	77,695.61
21/11/2013	20/12/2013	8,670.76	7,364.00	9,496.20	9,597.28	8,362.20	8,542.24	8,433.32	8,716.12	69,182.12	67,796.44
21/12/2013	20/01/2014	10,658.20	10,484.60	12,015.08	11,629.24	9,244.48	9,918.72	10,439.24	11,058.04	85,447.60	85,110.92
21/01/2014	20/02/2014	5,174.96	5,662.72	6,842.92	6,766.20	5,131.56	5,486.60	5,573.68	5,991.44	46,630.08	45,538.81
21/02/2014	28/02/2014	1,581.16	2,014.60	2,126.04	1,815.80	1,452.92	1,523.20	1,350.72	1,560.16	13,424.60	13,201.32
Total		112,115.92	120,046.92	120,370.32	117,457.20	116,158.56	110,923.96	117,614.84	110,101.32	924,789.04	894,557.64

¹ Phase II ~ Phase VIII projects (including the Project) started connecting to the grid from 01/03/2013, thus the electricity exported to the grid by these projects before 01/03/2013 is 0. Phase I has been exporting electricity to the grid during the period 01/03/2012 ~ 28/02/2013, it is not taken into consideration in the calculation for the Project and set as default value 0, since it makes no difference on determining the Project's exported electricity.

Table 6 Summary of electricity imported to the grid

Period		ES ² total, import, y
From	To	MWh
01/03/2012	20/03/2012	n.a.
21/03/2012	20/04/2012	n.a.
21/04/2012	20/05/2012	n.a.
21/05/2012	20/06/2012	n.a.
21/06/2012	20/07/2012	n.a.
21/07/2012	20/08/2012	n.a.
21/08/2012	20/09/2012	n.a.
21/09/2012	20/10/2012	n.a.
21/10/2012	20/11/2012	n.a.
21/11/2012	20/12/2012	n.a.
21/12/2012	20/01/2013	n.a.
21/01/2013	20/02/2013	n.a.
21/02/2013	28/02/2013	n.a.
01/03/2013	20/03/2013	135.00
21/03/2013	20/04/2013	209.25
21/04/2013	20/05/2013	202.50
21/05/2013	20/06/2013	209.25
21/06/2013	20/07/2013	202.50
21/07/2013	20/08/2013	209.25
21/08/2013	20/09/2013	303.73
21/09/2013	20/10/2013	98.80
21/10/2013	20/11/2013	154.82
21/11/2013	20/12/2013	138.14
21/12/2013	20/01/2014	108.69
21/01/2014	20/02/2014	157.54
21/02/2014	28/02/2014	42.71
Total		2,172.18

Table 7 Summary of net electricity delivered

Period		PHASE II: SANDAOGOU (ref. No. 5781) EG facility, y
From	To	MWh
01/03/2012	20/03/2012	0
21/03/2012	20/04/2012	0
21/04/2012	20/05/2012	0
21/05/2012	20/06/2012	0
21/06/2012	20/07/2012	0
21/07/2012	20/08/2012	0
21/08/2012	20/09/2012	0
21/09/2012	20/10/2012	0
21/10/2012	20/11/2012	0
21/11/2012	20/12/2012	0
21/12/2012	20/01/2013	0
21/01/2013	20/02/2013	0
21/02/2013	28/02/2013	0
01/03/2013	20/03/2013	5,862.69
21/03/2013	20/04/2013	13,736.34
21/04/2013	20/05/2013	12,595.54
21/05/2013	20/06/2013	12,028.38
21/06/2013	20/07/2013	7,178.09
21/07/2013	20/08/2013	8,416.87
21/08/2013	20/09/2013	7,686.39

² Phase II ~ Phase VIII projects (including the Project) started connecting to the grid from 01/03/2013, thus the electricity imported from the grid by these projects before 01/03/2013 is 0. Phase I has been importing electricity from the grid during the period 01/03/2012 ~ 28/02/2013, it is not taken into consideration in the calculation for the Project and set as default value 0, since it makes no difference on determining the Project's imported electricity.

21/09/2013	20/10/2013	12,645.31
21/10/2013	20/11/2013	9,551.62
21/11/2013	20/12/2013	7,078.36
21/12/2013	20/01/2014	10,334.60
21/01/2014	20/02/2014	5,372.66
21/02/2014	28/02/2014	1,938.38
Total		114,425

Based on the electricity records list above, the Baseline Emissions (BE_y) is calculated as follow:

Table 8 Emission reduction of the Project from 01/03/2012 to 28/02/2014

Period	Net electricity delivered(MWh)	$EF_{grid,CM,y}$ (tCO ₂ e/MWh)	BE_y (tCO ₂ e)
Total	114,425	0.9309	106,518

E.2. Calculation of project emissions or actual net GHG removals by sinks

>>

According to the applied methodology, as a renewable energy project, the project emissions of this project are zero.

E.3. Calculation of leakage

>>

According to the applied methodology, as a renewable energy project, the Leakage of this project are zero.

E.4. Summary of calculation of emission reductions or net anthropogenic GHG removals by sinks

Item	Baseline emissions or baseline net GHG removals by sinks (t CO ₂ e)	Project emissions or actual net GHG removals by sinks (t CO ₂ e)	Leakage (t CO ₂ e)	Emission reductions or net anthropogenic GHG removals by sinks (t CO ₂ e)
Total	106,518	0	0	106,518

E.5. Comparison of actual emission reductions or net anthropogenic GHG removals by sinks with estimates in registered PDD

Item	Values estimated in ex-ante calculation of registered PDD	Actual values achieved during this monitoring period
Emission reductions or GHG removals by sinks (t CO ₂ e)	184,806	106,518

According to the registered PDD, the ex-ante estimated average annual emission reductions are 92,403 tCO₂e. This monitoring period covers 730 days, therefore the ex-ante estimated emission reductions should be 184,806 tCO₂e as per registered PDD ($92,403 \text{ tCO}_2\text{e} / 365\text{days} \times 730\text{days} = 184,806 \text{ tCO}_2\text{e}$).

E.6. Remarks on difference from estimated value in registered PDD

>>

The total emission reductions for this monitoring period are 106,518 tCO₂e. As the monitoring period is for 730 days, multiplying the annual volume in the PDD by 730/365days give a volume of 184,806 tCO₂ and so the actual volume is 42.36% lower than the estimates in the registered PDD.

E.7. Actual emission reductions or net anthropogenic GHG removals by sinks during the first commitment period and the period from 1 January 2013 onwards

• Item	Actual values achieved up to 31 December 2012	Actual values achieved from 1 January 2013 onwards
• Emission reductions or GHG removals by sinks (t CO ₂ e)	0	106,518

- - - - -

- Contact information of project participants and responsible persons/ entities**

Project participant and/or responsible person/ entity	<input checked="" type="checkbox"/> Project participant <input type="checkbox"/> Responsible person/ entity for completing the CDM-MR-FORM
Organization name	China Water Group Huade Wind Power Co., Ltd.
Street/P.O. Box	Room 408, No.12, Lane 2, Baiguang Road, Xicheng District
Building	
City	Beijing
State/Region	Beijing
Postcode	100053
Country	P.R. China
Telephone	+86-10-5868 9628
Fax	+86-10-5868 9504
E-mail	
Website	
Contact person	Wang Hong Ye
Title	Department Director
Salutation	Ms.
Last name	Wang
Middle name	
First name	Hong Ye
Department	Planning & Development
Mobile	
Direct fax	+86-10-5868 9504
Direct tel.	+86-10-5868 9628
Personal e-mail	hollywang816@126.com

Project participant and/or responsible person/ entity	<input checked="" type="checkbox"/> Project participant <input checked="" type="checkbox"/> Responsible person/ entity for completing the CDM-MR-FORM
Organization name	Eco-Tec Asia (UK) Ltd.
Street/P.O. Box	18A, Zhong Guan Cun South Street, Haidian District
Building	B1505, New Logo International Building
City	Beijing
State/Region	
Postcode	100081
Country	P.R. China
Telephone	+86-10-62156001
Fax	+86-10-62156006
E-mail	
Website	
Contact person	Wu Xin
Title	Vice President
Salutation	Mr.
Last name	Wu
Middle name	
First name	Xin
Department	
Mobile	+86-18611685882
Direct fax	+86-10-62156006
Direct tel.	+86-10-62156001 ext 811
Personal e-mail	colin.wu@ecotec-asia.com

- - - - -

Document information

<i>Version</i>	<i>Date</i>	<i>Description</i>
• 04.0	• 25 June 2014	<ul style="list-style-type: none"> • Revisions to: • Include the Attachment: Instructions for filling out the monitoring report form (these instructions supersede the "Guideline: Completing the monitoring report form" (Version 04.0)); • Include provisions related to standardized baselines; • Add contact information on a responsible person(s)/ entity(ies) for completing the CDM-MR-FORM in A.6 and Appendix 1; • Change the reference number from <i>F-CDM-MR</i> to <i>CDM-MR-FORM</i>; • Editorial improvement.
• 03.2	• 5 November 2013	• Editorial revision to correct table in page 1.
• 03.1	• 2 January 2013	• Editorial revision to correct table in section E.5.
• 03.0	• 3 December 2012	• Revision required to introduce a provision on reporting actual emission reductions or net anthropogenic GHG removals by sinks for the period up to 31 December 2012 and the period from 1 January 2013 onwards (EB70, Annex 11).
• 02.0	• 13 March 2012	• Revision required to ensure consistency with the "Guidelines for completing the monitoring report form" (EB 66, Annex 20).
• 01	• 28 May 2010	• EB 54, Annex 34. Initial adoption.
• Decision Class: Regulatory Document Type: Form Business Function: Issuance Keywords: monitoring report		