



**Monitoring report form**  
**(Version 05.1)**

*Complete this form in accordance with the Attachment "Instructions for filling out the monitoring report form" at the end of this form.*

**MONITORING REPORT**

<b>Title of the project activity</b>	Inner Mongolia China Water Group Huade Sandaogou Wind Farm 49.5MW Project	
<b>UNFCCC reference number of the project activity</b>	5781	
<b>Version number of the monitoring report</b>	2.0	
<b>Completion date of the monitoring report</b>	05/11/2015	
<b>Monitoring period number and duration of this monitoring period</b>	2 <sup>nd</sup> monitoring period: 01/03/2014 - 20/08/2015 (first and last days included, 538 days in all)	
<b>Project participant(s)</b>	China Water Group Huade Wind Power Co., Ltd. (Project owner) Eco-Tec Asia (UK) Ltd. (Buyer) Amsterdam Capital Trading B.V. (Buyer)	
<b>Host Party</b>	China	
<b>Sectoral scope(s)</b>	01: Energy Industries (renewable resources) Wind Power Generation	
<b>Selected methodology(ies)</b>	ACM0002: Consolidated baseline methodology for grid-connected electricity generation from renewable sources (Version 12.2.0, EB 65)	
<b>Selected standardized baseline(s)</b>	-	
<b>Estimated amount of GHG emission reductions or net GHG removals by sinks for this monitoring period in the registered PDD</b>	92,403 tCO <sub>2</sub> e / 365days × 538days = 136,199 tCO <sub>2</sub> e	
<b>Total amount of GHG emission reductions or net GHG removals by sinks achieved in this monitoring period</b>	GHG emission reductions or net GHG removals by sinks reported up to 31 December 2012	GHG emission reductions or net GHG removals by sinks reported from 1 January 2013 onwards
	0	127,749

## SECTION A. Description of project activity

### A.1. Purpose and general description of project activity

>>

The purpose of Inner Mongolia China Water Group Huade Sandaogou Wind Farm 49.5MW Project (hereafter "the Project") is to utilize wind resources for electricity generation. The Project involves the installation of 33 sets of wind turbines with unit capacity of 1500kW, reaching a total capacity of 49.5MW. The electricity supplied by the Project is sold to the North China Power Grid ("NCPG"). The Project will reduce greenhouse gas ("GHG") emissions by avoiding carbon dioxide emissions from the generation of electricity by fossil fuel power plants.

The Project delivers estimated 99,263 MWh of electricity per year to the NCPG with an average load factor of 23%. The Project will reduce greenhouse gas ("GHG") emissions by avoiding carbon dioxide emissions from the generation of electricity by fossil fuel power plants that presently supply the NCPG. The Project's annual expected emissions reduction is 92,403 tCO<sub>2</sub>e.

Relevant dates for the Project activity are as below:

**Table 1 Project Timeline**

Construction start date	13/05/2010
Date of grid connection agreement signed and started operation	01/03/2013
Date of CDM registration	15/02/2012
Fixed crediting period	01/03/2012-28/02/2022
The 1 <sup>st</sup> monitoring period	01/03/2012-28/02/2014
The second monitoring period (this monitoring period)	01/03/2014-20/08/2015

In this monitoring period, 127,749tCO<sub>2</sub>e emission reductions were achieved.

### A.2. Location of project activity

>>

The Project is located at Sandaogou Wind Farm 10 km away from the southwest of Changshun Town, Huade County, Ulanqab City in the Inner Mongolia Autonomous Region of the People's Republic of China. Huade County is located in the north of Ulanqab City, and centre of Inner Mongolia Autonomous Region. The centre geographic coordinates of the wind farm is 113.8917°E and 41.8666°N. The Project site covers an area of 113.8712°E ~ 113.9154°E and 41.8354°N ~ 41.8975°N.

### A.3. Parties and project participant(s)

Party involved ((host) indicates a host Party)	Private and/or public entity(ies) project participants (as applicable)	Indicate whether the Party involved wishes to be considered as project participant (yes/no)
China (host)	China Water Group Huade Wind Power Co., Ltd.	No
United Kingdom of Great Britain and Northern Ireland	Eco-Tec Asia (UK) Ltd	No
Netherlands	Amsterdam Capital Trading B.V.	No

### A.4. Reference of applied methodology and standardized baseline

>>

The applied approved methodology to the Project is ACM0002: "Consolidated baseline methodology for grid-connected electricity generation from renewable sources" (Version 12.2.0, EB 65)

The methodology refers to the following tools:

"Tool for the demonstration and assessment of additionality" (Version 05.2.1 EB 39)

"Tool to calculate the emission factor for an electricity system" (Version 02.2.1, EB63)

For more information please refer to:

<http://cdm.unfccc.int/methodologies/PAmethodologies/approved.html>

#### A.5. Crediting period of project activity

>>

**Table 2 Crediting Period of the Project**

Crediting period	Fixed crediting period
Starting date of crediting period	01/03/2012
End date of crediting period	28/02/2022

#### A.6. Contact information of responsible persons/entities

>>

Responsible Person: Wu Xin  
 Responsible Entity: Eco-Tec Asia (UK) Ltd  
 Address: 12 Zhong Guan Cun South Street, A803, Tianzuo International Building,  
 Haidian District, Beijing.  
 Postcode: 100081  
 Telephone: (86)-10-6215 6001 ext 822  
 Facsimile: (86)-10-6215 6006  
 E-mail: [colin.wu@ecotec-asia.com](mailto:colin.wu@ecotec-asia.com)

### SECTION B. Implementation of project activity

#### B.1. Description of implemented registered project activity

>>

The Project activity was started construction on 13/05/2010. All the wind turbines have been put into full commercial operation since 01/03/2013, and well operated during this monitoring period.

During this monitoring period, the Project was in normal and smooth operation as per the registered PDD without any emergencies or special events. There have been no overhaul times, downtimes of equipment, exchange of equipment that occurred during the monitoring period; and no events or situations that occurred during the monitoring period, which may impact the applicability of the applied methodology.

All 33 sets of wind turbines are produced by Xinjiang Goldwind Technology Co., Ltd. with a rated capacity of 1.5MW, accumulating a total capacity of 49.5MW. Key technical parameters of the wind turbines are listed in table 3.

**Table 3 Key Technical Specifications of Wind Turbines**

Parameters		Value
Manufacturer / Type		Xinjiang Goldwind Technology Co., Ltd. GW77/1500kW
Life Time (Year)		20
Annual Operation Hours (Hours)		2005
Plant Load Factor (PLF)		0.23
Wind Wheel	Diameter (m)	77
	Rated Capacity (kW)	1500
	Cut-in Wind Speed (m/s)	3
	Rated Wind Speed (m/s)	12
	Cut-out Wind Speed (m/s)	22

	Operation Temperature(°C)	-30°C~+40°C
	Type	Variable blade
	Swept Area (m <sup>2</sup> )	4656
Generator	Type	Direct-drive permanent magnet synchronous generator
	Capacity (kW)	1580
	Rated Voltage (V)	690
	Rated Current (A)	660
Braking System	Main Braking System	Pneumatic brake
	Second Braking System	Mechanical brake
Tower	Type	cone
	Hub Height (m)	62.8
Power factor		0.95 (inductor) ~ 0.95 (capacitor)

These turbines are expected to deliver 99,263 MWh of electricity to the NCPG annually.

The project will share the same gateway electrical meters at the Xingguang 220kV Substation with other seven projects developed by the same project owner. The list of the eight projects that share the same gateway electrical meters at the Xingguang 220kV Substation is as below:

- Huade Phase I project: *Huade Changshun 49.5MW Wind Power Project* (ref. No. 2093);
- **The Project:**  
Huade Phase II project: *Inner Mongolia China Water Group Huade Sandaogou Wind Farm 49.5MW Project* (ref. No. 5781);
- Huade Phase III project: *Inner Mongolia China Water Group Huade Heping Wind Farm 49.5MW Project* (ref. No. 5900);
- Huade Phase IV project: *Inner Mongolia China Water Group Huade Niujiacun Wind Farm 49.5MW Project* (ref. No. 5883);
- Huade Phase V project: *Inner Mongolia China Water Group Huade Niujiafangzi Wind Farm 49.5MW Project* (ref. No. 5992);
- Huade Phase VI project: *Inner Mongolia China Water Group Huade Sitaifangzi Wind Farm 49.5MW Project* (ref. No. 5990);
- Huade Phase VII project: *Inner Mongolia China Water Group Huade Erligetu Wind Farm 49.5MW Project* (ref. No. 5904);
- Huade Phase VIII project: *Inner Mongolia China Water Group Huade Cheliwusu Wind Farm 49.5MW Project* (ref. No. 5909);

The two bi-directional gateway meters (one is the main meter and the other is the back-up meter) are installed at the 220kV side of the Xingguang 220kV Substation to monitor the total amount of electricity delivered to and purchased from the NCPG by the eight projects simultaneously and the net total amount of electricity supplied to the NCPG by the eight projects activity would be calculated based on the readings of those meters. In order to calculate the exact amount of electricity delivered to and purchased from the NCPG by the eight projects respectively, there have installed an bi-directional electrical meter at each of the 35kV transmission lines for each of the eight projects.

The line diagram showing all relevant monitoring points is as following:

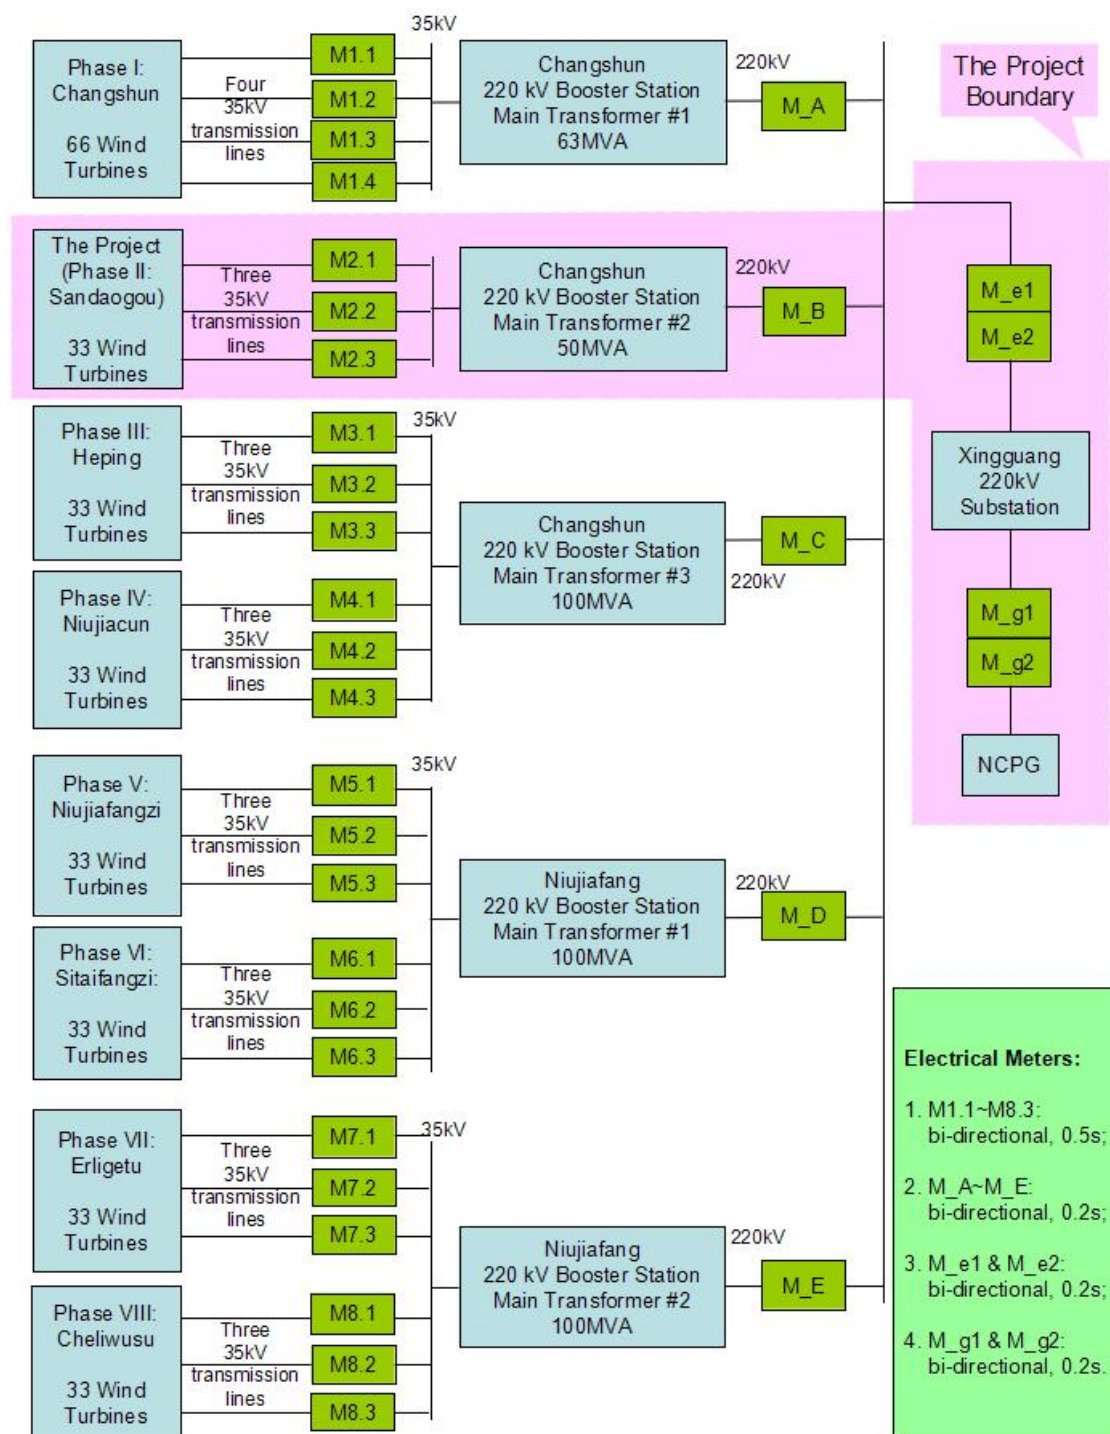


Figure 1 Electricity Generation Process by Wind Energy

## B.2. Post-registration changes

### B.2.1. Temporary deviations from registered monitoring plan, applied methodology or applied standardized baseline

>>

N/A

**B.2.2. Corrections**

&gt;&gt;

The name of the booster station was changed from “Niujiatangzi” to “Niujiatang”. The correction was described in PRC-5781-001 which has been approved by EB.

**B.2.3. Changes to start date of crediting period**

&gt;&gt;

N/A

**B.2.4. Inclusion of a monitoring plan to the registered PDD that was not included at registration**

&gt;&gt;

N/A

**B.2.5. Permanent changes from registered monitoring plan, applied methodology or applied standardized baseline**

&gt;&gt;

The meter M<sub>A</sub> was changed from the 0.5s uni-directional meter to the current 0.2s bi-directional on 27/11/2010 following the unified planning by Inner Mongolia Power Dispatching and Communicating Centre, which also was indicated in the PPA, then the registered PDD have been revised on 28/07/2014. The change was described in PRC-5781-001 which has been approved by EB.

In the 1<sup>st</sup> monitoring period, the recording time of the electricity amount was changed to the 20<sup>th</sup> of every month according to the PPA. The change was described in PRC-5781-001 which has been approved by EB.

**B.2.6. Changes to project design of registered project activity**

&gt;&gt;

N/A

**B.2.7. Types of changes specific to afforestation or reforestation project activity**

&gt;&gt;

N/A

**SECTION C. Description of monitoring system**

&gt;&gt;

As described in the revised PDD, the net electricity supplied to the grid from the Project (EG<sub>facility,y</sub>) is monitored parameters. Its monitoring system is achieved by the following monitored parameters:

**Table 4 The Data Collection and Handling**

<b>Monitoring Data</b>	<p><math>ES_{j,i, \text{ export }, y}</math> (<math>j=I, II, III, IV, V, VI, VII, VIII</math>; <math>i=1, 2, 3, 4</math> for Phase I project, <math>i=1, 2, 3</math> for the other 7 projects)</p> <p><math>ES_{j,i, \text{ import }, y}</math> have not been monitored as per PDD due to the fact that the electricity company has taken the monthly imported electricity amount as pre-set amount instead of monitored amount.</p>	<p><math>ES_{p, \text{ export }, y}</math> (<math>p=A, B, C, D, E</math>)</p> <p><math>ES_{p, \text{ import }, y}</math> (<math>p=A, B, C, D, E</math>)</p>	<p><math>ES_{\text{total}, \text{ export }, y}</math> &amp; <math>ES_{\text{total}, \text{ import }, y}</math></p>		$EG_{\text{facility}, y}$
<b>Monitoring Equipments</b>	25 meters: $M_{j,i}$ ( $j=1, 2, \dots, 8$ ; $i=1, 2, 3, 4$ for Phase I project, $i=1, 2, 3$ for the other 7 projects)	5 meters: $M_p$ ( $p=A, B, C, D, E$ ; bi-directional)	2 evaluation meters ( $M_{e1}$ as main and $M_{e2}$ as its back-up meter)	2 gateway meters ( $M_{g1}$ as main and $M_{g2}$ as its back-up meter)	Measured based on the meters: $M_{g1}, M_{j,i}$ ( $j=1, 2, \dots, 8$ ; $i=1, 2, 3, 4$ for Phase I project where $j=1, i=1, 2, 3$ for the other 7 projects where $j=2 \sim 7$ ).
<b>Data Collection</b>	<p>The Project owner will record these data on the 20<sup>th</sup> of every month, and store the relevant documents.</p>			<p>The grid company and the Project owner will record these data on the 20<sup>th</sup> of every month</p> <p>The grid company will issue the invoice of imported electricity and the project owner will issue the invoice of exported electricity.</p>	<p>The Project owner will perform calculation based on Formula &lt;1&gt; and the monitored results every month, and store the relevant documents.</p>
<b>Data Handling</b>	<p>Monthly monitoring results will be signed off and approved by CDM Project Manager before it is accepted and stored. This internal audit will check compliance with operational procedures in the monitoring plan, and will also identify potential improvements to procedures to improve monitoring and reporting in future.</p> <p>The Project owner will provide meter readings and invoice photocopies to DOE for verification.</p>				

- Data calculation

Based on the revised PDD,  $EG_{\text{facility}, y}$  can be calculated as follows:

Formula <1>:

$$EG_{facility,y} = ES_{total,export,y} \times \frac{\sum_{i=1}^3 ES_{II,i,export,y}}{\sum_{i=1}^4 ES_{I,i,export,y} + \sum_{j=II}^{VIII} \sum_{i=1}^3 ES_{j,i,export,y}} - ES_{total,import,y} \times \frac{\sum_{i=1}^3 ES_{II,i,import,y}}{\sum_{i=1}^4 ES_{I,i,import,y} + \sum_{j=II}^{VIII} \sum_{i=1}^3 ES_{j,i,import,y}}$$

Where:

$EG_{facility,y}$ : is quantity of net electricity generation supplied by the Project to the NCPG in year y.

$ES_{total,export,y}$ : is the total amount of electricity exported to the grid from all the eight projects developed by the same project owner as listed above measured by the same gateway meter(s)  $M_{g1}$  (and  $M_{g2}$  as its back-up);

$ES_{total,import,y}$ : is the total amount of electricity imported from the grid to all the eight projects developed by the same project owner as listed above measured by the gateway meter(s)  $M_{g1}$  (and  $M_{g2}$  as its back-up);

$ES_{j,i,export,y}$ : is the electricity exported to the grid by the Phase j project part i (j=I, II, III, ..., VIII; i=1, 2, 3, 4 for Phase I project, i=1, 2, 3 for the other 7 projects) measured by the meter  $M_{j,i}$  (j=1, 2, 3, ..., 8; i=1, 2, 3, 4 for Phase I project, i=1, 2, 3 for the other 7 projects) at the project site;

$ES_{j,i,import,y}$ : is the electricity imported from the grid to the Phase j project part i (j=I, II, III, ..., VIII; i=1, 2, 3, 4 for Phase I project, i=1, 2, 3 for the other 7 projects) measured by the meter  $M_{j,i}$  (j=1, 2, 3, ..., 8; i=1, 2, 3, 4 for Phase I project, i=1, 2, 3 for the other 7 projects) at the project site;

During this monitoring period, all parameters in Formula <1> have been monitored and recorded

The location of main meters, separate meters and transmission lines are displayed as following:



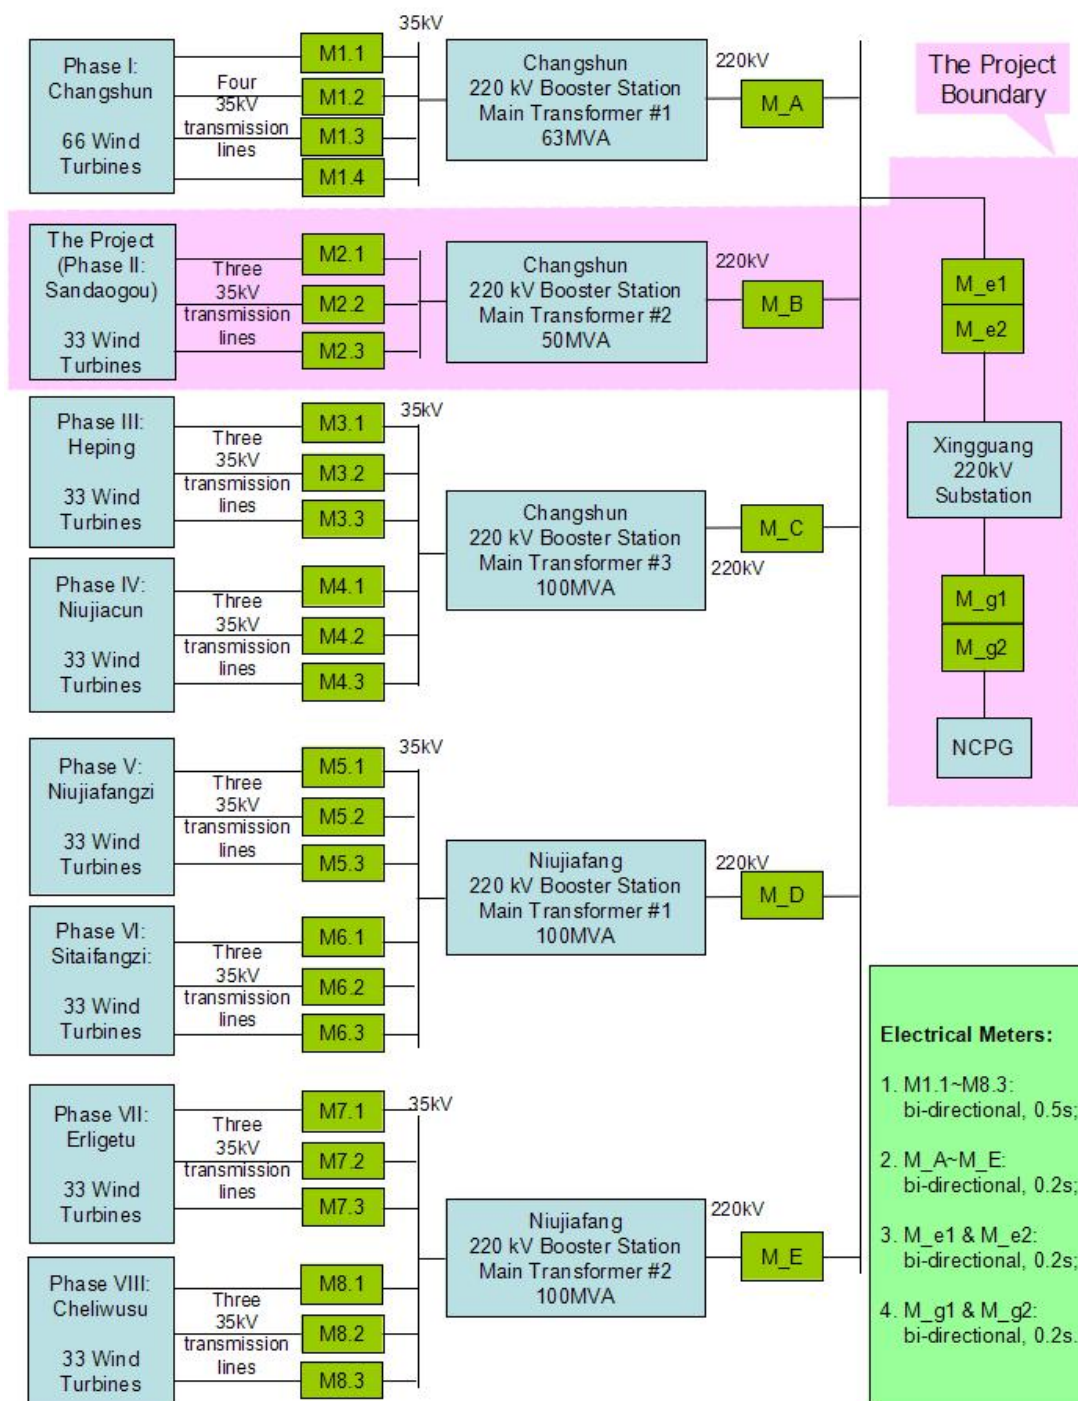
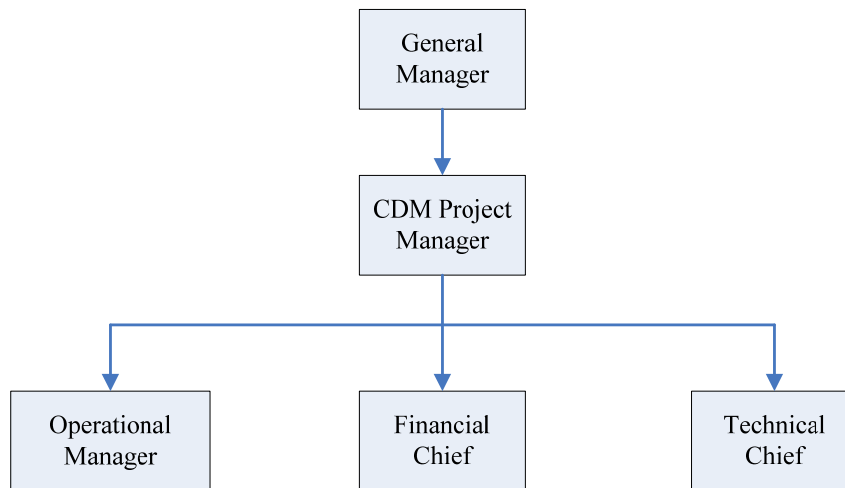


Figure 2 Diagram for metering points of the Project

#### • Monitoring organization

The Project owner retains overall responsibility for daily monitoring and reporting. A CDM group will be established within the Project owner to carry out the required monitoring work. The project owner will appoint a CDM manager with responsibility for monitoring the data related to the calculation of emission reductions. Technical and financial teams will also be organized to assist the CDM manager, as displayed in Figure below.



**Figure 3 Structure of CDM group**

The responsibilities of the Project staff are as follow:

- **General Manager:** to be responsible for the overall execution of the monitoring plan;
- **CDM project Manager:** to make sure each division of the monitoring team works as stipulated in the monitoring plan; report the monitoring work to general manager; responsible for periodic verification, etc.;
- **Operation Manager:** to be responsible for daily operation and electricity meter reading and recording;
- **Financial Chief:** to keep sales and/or purchase receipts, if any; and
- **Technical Chief:** to make sure that all the electricity meters are maintenance regularly according to industrial standard.
- **Emergency procedure**

Once a monitoring meter in fault, it shall be replaced immediately with another calibrated meter by a professional engineer within one month. Failure events will be recorded in the site events log book. The fault meter shall be repaired and calibrated only by national designated institutions with metering certificate.

- If the main gateway meter  $M_{g1}$  reading exceeds the allowable error or the meter functions improperly, the net electricity supplied to NCPG by the Project shall be determined according to Formula <1\*> as follows:
- The total amount of electricity exported to or imported from the grid will be calculated according to the backup gateway meter  $M_{g2}$ , unless a test by either party reveals that it is inaccurate;

Formula <1\*>:

$$EG_{facility,y} = ES_{total,exp,ort,y} \times \frac{\sum_{i=1}^3 ES_{II,i,exp,ort,y}}{\sum_{i=1}^4 ES_{I,i,exp,ort,y} + \sum_{j=II}^{VIII} \sum_{i=1}^3 ES_{j,i,exp,ort,y}} - ES_{total,import,y}$$

- If the errors of both the gateway meters  $M_{g1}$  and  $M_{g2}$  exceed the national or trade standard allowance levels or the meters function improperly, the quantity of net electricity supplied to the NCPG by the Project will be calculated according to Formula <1\*> as follows:
- The total amount of electricity exported to or imported from the grid will be calculated according to the main evaluation electricity meter  $M_{e1}$  readings with consideration of the historical line loss rate, unless either party doubts the meter's accuracy;
- If the errors of both the gateway meters  $M_{g1}$  and  $M_{g2}$ , as well as the main evaluation electricity meter  $M_{e1}$  exceed the national or trade standard allowance levels or the meters function improperly, the

quantity of net electricity supplied to NCPG by the Project will be calculated according to Formula <1\*> as follows:

- The total amount of electricity exported to or imported from the grid will be calculated according to the back-up evaluation electricity meter  $M_{e2}$  readings with consideration of the historical line loss rate, unless either party doubts the meter's accuracy;
- If the errors of all the two gateway meters  $M_{g1}$  and  $M_{g2}$  and the two evaluation meters  $M_{e1}$  and  $M_{e2}$ , or any of the meters  $M_{j,i}$  ( $j=1, 2, 3, 4, 5, 6, 7, 8$ ;  $i=1, 2, 3, 4$  for Phase I project and  $i=1, 2, 3$  for other seven projects) exceed the national or trade standard allowance levels or the meters function improperly, the quantity of net electricity supplied to NCPG by the Project will be calculated according to Formula <2> as follows:
- The readings from the meter at the 220kV sides of the main transformer connecting to the Project at the wind farm on-site booster station  $M_B$  will be used, with consideration of historical transmission line losses.

Formula <2>:

$$EG_{facility,y} = ES_{B, export, y} - ES_{B, import, y};$$

- If the errors of all the two gateway meters  $M_{g1}$  and  $M_{g2}$  and the two evaluation meters  $M_{e1}$  and  $M_{e2}$ , and the meter at the 220kV side of the main transformer connecting to the Project at the wind farm on-site booster station  $M_B$  exceed the national or trade standard allowance levels or the meters function improperly, the quantity of net electricity supplied to NCPG by the Project will be calculated according to Formula <3> as follows:
- The readings from the meters at 35kV lines  $M_{j,i}$  ( $j=2$ ;  $i=1, 2, 3$ ) will be used, with consideration of historical transmission line losses and transformer losses.

Formula <3>:

$$EG_{facility,y} = \sum_{i=1}^3 ES_{II, i, export, y} - \sum_{i=1}^3 ES_{II, i, import, y}$$

- If the errors of all the two gateway meters  $M_{g1}$  and  $M_{g2}$  and the two evaluation meters  $M_{e1}$  and  $M_{e2}$ , and the meter at the 220kV side of the main transformer connecting to the Project at the wind farm on-site booster station  $M_B$ , and any of the meters at 35kV lines  $M_{j,i}$  ( $j=2$ ;  $i=1, 2, 3$ ) exceed the national or trade standard allowance levels or the meters function improperly, the electricity generation during the period of erroneous measurement and replacement of the fault meter shall not be accounted to calculate the emission reduction for conservative consideration.

For the above situation (2), (3), (4) and (5):

- If the evaluation electricity meter does not have an acceptable level of precision, the project owner and the grid company will design a reasonable and conservative evaluation method together. In this event, the project owner will provide sufficient evidence to demonstrate the method's rationality and conservatism during the validation and verification processes.
- If the project owner and the grid company are unable to agree on the evaluation method, they will participate in an arbitration process to ensure the consistency of the evaluation method as provided for by their agreement

**SECTION D. Data and parameters****D.1. Data and parameters fixed ex ante or at renewal of crediting period**

<b>Data/parameter:</b>	EF <sub>grid, CM, y</sub>
Unit	tCO <sub>2</sub> /MWh
Description	Baseline emission factor
Source of data	Registered PDD
Value(s) applied)	0.9309
Choice of data or measurement methods and procedures	-
Purpose of data	Baseline emission calculation
Additional comments	Ex-anted according to the applied methodology

**D.2. Data and parameters monitored**

<b>Data / Parameter:</b>	ES <sub>j,i, export, y</sub> (j=I, II, III, IV, V, VI, VII, VIII; i=1, 2, 3, 4 for Phase I project, i=1, 2, 3 for the other 7 projects)
Unit:	MWh
Description:	Electricity exported to the grid by the Phase j project (j=I, II, III, IV, V, VI, VII, VIII) part i (i=1, 2, 3, 4 for Phase I project, i=1, 2, 3 for the other 7 projects) in year y.
Measured/ Calculated / Default:	Measured by the separate bi-directional meter M <sub>j,i</sub> at the Phase j project's site with the accuracy of 0.5s.
Source of data:	Meter records.
Value(s) of monitored parameter:	Refer to Section E.

Monitoring equipment:

Information of monitoring equipments:

M<sub>j,i</sub>

Item	M <sub>1.1</sub>	M <sub>1.2</sub>	M <sub>1.3</sub>	M <sub>1.4</sub>
Type	DTSD341	DTSD341	DTSD341	DTSD341
SN	090600948600 05	090600948600 04	090600948600 10	090600948600 11

Item	M <sub>2.1</sub>	M <sub>2.2</sub>	M <sub>2.3</sub>	
Type	DTSD341	DTSD341	DTSD341	
SN	100804020900 0013	100804020900 0009	100804020900 0014	

Item	M <sub>3.1</sub>	M <sub>3.2</sub>	M <sub>3.3</sub>	
Type	DTSD341	DTSD341	DTSD341	
SN	100804020900 0008	100804020900 0002	100804020900 0012	

Item	M <sub>4.1</sub>	M <sub>4.2</sub>	M <sub>4.3</sub>	
Type	DTSD341	DTSD341	DTSD341	
SN	100804020900 0004	100804020900 0003	100804020900 0001	

Accuracy class	0.5S			
Calibration frequency	Annual			
Calibration date	07/07/2013 24/03/2014 15/03/2015			
Calibration entity	Inner Mongolia Ke Gao Electric Technology Testing Co., Ltd. Huade electric power company			

Item	M <sub>5.1</sub>	M <sub>5.2</sub>	M <sub>5.3</sub>	
Type	DTSD719	DTSD719	DTSD719	
SN	420052504110 8348712	420052504110 8348711	420052504110 8348706	

Item	M <sub>6.1</sub>	M <sub>6.2</sub>	M <sub>6.3</sub>	
Type	DTSD719	DTSD719	DTSD719	
SN	420052504110 8348709	420052504110 8348713	420052504110 8348718	

Item	M <sub>7.1</sub>	M <sub>7.2</sub>	M <sub>7.3</sub>	
Type	DTSD719	DTSD719	DTSD719	
SN	420052504110 8348704	420052504110 8348720	420052504110 8348707	

Item	M <sub>8.1</sub>	M <sub>8.2</sub>	M <sub>8.3</sub>	
Type	DTSD719	DTSD719	DTSD719	
SN	420052504110 8348715	420052504110 8348705	420052504110 8348721	

Accuracy class	0.5S			
Calibration frequency	Annual			
Calibration date	07/07/2013 23/03/2014 15/03/2015			
Calibration entity	Inner Mongolia Ke Gao Electric Technology Testing Co., Ltd. Huade electric power company			

Measuring/ Reading/ Recording frequency:	Measuring continuously/ Reading daily / Recording monthly.
Calculation method (if applicable):	N/A.
QA/QC procedures:	Meters have been calibrated and checked yearly by a qualified third party for accuracy in accordance with national standards JJG1055-1997 and DL/T448—2000.
Purpose of data:	Baseline emission calculation.
Additional comment:	N/A.

<b>Data / Parameter:</b>	$ES_{j,i, import, y}$ ( $j=I, II, III, IV, V, VI, VII, VIII$ ; $i=1, 2, 3, 4$ for Phase I project, $i=1, 2, 3$ for the other 7 projects)
Unit:	MWh
Description:	Electricity imported from the grid to the Phase j project ( $j=I, II, III, IV, V, VI, VII, VIII$ ) part i ( $i=1, 2, 3, 4$ for Phase I project, $i=1, 2, 3$ for the other 7 projects) in year y.
Measured/ Calculated / Default:	Measured by the separate bi-directional meter $M_{j,i}$ at the Phase j project's site with the accuracy of 0.5s.
Source of data:	Meter records.
Value(s) of monitored parameter:	$ES_{j,i, import, y}$ have not been monitored as per PDD due to the fact that the electricity company has signed a contract with the project owner to take the monthly imported electricity amount as pre-agreed amount instead of monitored amount.
Monitoring equipment:	The same 25 meters to monitor $ES_{j,i, export, y}$ .
Measuring/ Reading/ Recording frequency:	Measuring continuously/ Reading daily / Recording monthly.
Calculation method (if applicable):	N/A.
QA/QC procedures:	Meters have been calibrated and checked yearly by a qualified third party for accuracy in accordance with national standards JJG1055-1997 and DL/T448—2000.
Purpose of data:	Baseline emission calculation.
Additional comment:	During this monitoring period, $ES_{j,i, import, y}$ , has not been monitored due to the fact that the electricity company has signed a contract with the project owner to take the monthly imported electricity amount as pre-agreed amount instead of monitored amount.

<b>Data / Parameter:</b>	$ES_{total, export, y}$
Unit:	MWh
Description:	Total electricity exported to the grid by all the 8 projects (including the Project) in year y.
Measured/ Calculated / Default:	Measured by the gateway electrical meter $M_{g1}$ (and $M_{g2}$ as its back-up meter) at the 220kV Xingguang substation with the accuracy of 0.2s.
Source of data:	Meter records.
Value(s) of monitored parameter:	Refer to Section E.

Monitoring equipment:	<p>Information of monitoring equipments:</p> <p>M<sub>g1</sub> (M<sub>g2</sub> as its back-up meter) and M<sub>e1</sub> (M<sub>e2</sub> as its back-up meter)</p> <table border="1"> <tr> <td>Item</td><td>M<sub>g1</sub></td><td>M<sub>g2</sub></td><td>M<sub>e1</sub></td><td>M<sub>e2</sub></td></tr> <tr> <td>Type</td><td>LANDIS</td><td>LANDIS</td><td>LANDIS</td><td>LANDIS</td></tr> <tr> <td>SN</td><td>95411060</td><td>95411068</td><td>96057671</td><td>95411066</td></tr> <tr> <td>Accuracy class</td><td colspan="4">0.2S</td></tr> <tr> <td>Calibration frequency</td><td colspan="4">Annual</td></tr> <tr> <td>Calibration date</td><td colspan="2">05/02/2014 22/06/2014 07/02/2015</td><td colspan="2" rowspan="2">05/02/2014 21/06/2014 05/02/2015</td></tr> <tr> <td>Calibration entity</td><td colspan="4">Inner Mongolia Electric Power Research Institute Electric Metering Testing Centre</td></tr> </table>	Item	M <sub>g1</sub>	M <sub>g2</sub>	M <sub>e1</sub>	M <sub>e2</sub>	Type	LANDIS	LANDIS	LANDIS	LANDIS	SN	95411060	95411068	96057671	95411066	Accuracy class	0.2S				Calibration frequency	Annual				Calibration date	05/02/2014 22/06/2014 07/02/2015		05/02/2014 21/06/2014 05/02/2015		Calibration entity	Inner Mongolia Electric Power Research Institute Electric Metering Testing Centre			
Item	M <sub>g1</sub>	M <sub>g2</sub>	M <sub>e1</sub>	M <sub>e2</sub>																																
Type	LANDIS	LANDIS	LANDIS	LANDIS																																
SN	95411060	95411068	96057671	95411066																																
Accuracy class	0.2S																																			
Calibration frequency	Annual																																			
Calibration date	05/02/2014 22/06/2014 07/02/2015		05/02/2014 21/06/2014 05/02/2015																																	
Calibration entity	Inner Mongolia Electric Power Research Institute Electric Metering Testing Centre																																			
Measuring/ Reading/ Recording frequency:	Measuring continuously/ Reading daily / Recording monthly.																																			
Calculation method (if applicable):	N/A.																																			
QA/QC procedures:	Meters have been calibrated and checked yearly by a qualified third party for accuracy in accordance with national standards JJG1055-1997 and DL/T448—2000.																																			
Purpose of data:	Baseline emission calculation.																																			
Additional comment:	N/A.																																			

<b>Data / Parameter:</b>	$ES_{total, import, y}$
Unit:	MWh
Description:	Total electricity imported from the grid to all the 8 projects (including the Project) in year y.
Measured/ Calculated / Default:	Measured by the gateway electrical meter M <sub>g1</sub> (and M <sub>g2</sub> as its back-up meter) at the 220kV Xingguang substation with the accuracy of 0.2s.
Source of data:	Meter records.
Value(s) of monitored parameter:	Refer to Section E.
Monitoring equipment:	The same 4 meters to monitor $ES_{total, export, y}$ .
Measuring/ Reading/ Recording frequency:	Measuring continuously/ Reading daily / Recording monthly.
Calculation method (if applicable):	N/A.
QA/QC procedures:	Meters have been calibrated and checked yearly by a qualified third party for accuracy in accordance with national standards JJG1055-1997 and DL/T448—2000.
Purpose of data:	Baseline emission calculation.
Additional comment:	N/A.

<b>Data / Parameter:</b>	$ES_{p, export, y}$
Unit:	MWh
Description:	The amount of electricity exported to the grid from the wind farm connected to the transformer p (p=A, B, C, D, E) in year y.
Measured/ Calculated / Default:	Measured by the electrical meter M <sub>p</sub> at the 220kV side of the 35~220kV on-site booster station with the accuracy of 0.2s (p=A, B, C, D, E) respectively.

Source of data:	Meter records.																																										
Value(s) of monitored parameter:	Refer to Section E.																																										
Monitoring equipment:	<p>Information of monitoring equipments:</p> <p><math>M_p</math></p> <table border="1"> <tr> <th>Item</th><th><math>M_A</math></th><th><math>M_B</math></th><th><math>M_C</math></th><th><math>M_D</math></th><th><math>M_E</math></th></tr> <tr> <td>Type</td><td>DTSD718</td><td>DTSD341</td><td>DTSD341</td><td>DTSD718</td><td>DTSD718</td></tr> <tr> <td>SN</td><td>4200415041 108347261</td><td>100804018 40001</td><td>100804018 40002</td><td>4200415041 108347258</td><td>4200415041 108347260</td></tr> <tr> <td>Accuracy class</td><td colspan="5">0.2S</td></tr> <tr> <td>Calibration frequency</td><td colspan="5">Annual</td></tr> <tr> <td>Calibration date</td><td colspan="3">01/04/2013 24/03/2014 15/03/2015</td><td colspan="2" rowspan="2">01/04/2013 23/03/2014 15/03/2015</td></tr> <tr> <td>Calibration entity</td><td colspan="5">Inner Mongolia Ke Gao Electric Technology Testing Co., Ltd. Huade electric power company</td></tr> </table>	Item	$M_A$	$M_B$	$M_C$	$M_D$	$M_E$	Type	DTSD718	DTSD341	DTSD341	DTSD718	DTSD718	SN	4200415041 108347261	100804018 40001	100804018 40002	4200415041 108347258	4200415041 108347260	Accuracy class	0.2S					Calibration frequency	Annual					Calibration date	01/04/2013 24/03/2014 15/03/2015			01/04/2013 23/03/2014 15/03/2015		Calibration entity	Inner Mongolia Ke Gao Electric Technology Testing Co., Ltd. Huade electric power company				
Item	$M_A$	$M_B$	$M_C$	$M_D$	$M_E$																																						
Type	DTSD718	DTSD341	DTSD341	DTSD718	DTSD718																																						
SN	4200415041 108347261	100804018 40001	100804018 40002	4200415041 108347258	4200415041 108347260																																						
Accuracy class	0.2S																																										
Calibration frequency	Annual																																										
Calibration date	01/04/2013 24/03/2014 15/03/2015			01/04/2013 23/03/2014 15/03/2015																																							
Calibration entity	Inner Mongolia Ke Gao Electric Technology Testing Co., Ltd. Huade electric power company																																										
Measuring/ Reading/ Recording frequency:	Measuring continuously/ Reading daily / Recording monthly.																																										
Calculation method (if applicable):	N/A.																																										
QA/QC procedures:	Meters have been calibrated and checked yearly by a qualified third party for accuracy in accordance with national standards JJG1055-1997 and DL/T448—2000.																																										
Purpose of data:	Baseline emission calculation.																																										
Additional comment:	The gateway meters $M_{g1}$ and $M_{g2}$ operated well in this monitoring period and their readings were used to calculate the emission reductions. Hence, the readings from meters $M_A$ to $M_E$ were not used in the emission reductions calculation.																																										

<b>Data / Parameter:</b>	$ES_{p, import, y}$
Unit:	MWh
Description:	The amount of electricity imported from the grid to the wind farm connected to the transformer p (p=A, B, C, D, E) in year y.
Measured/ Calculated / Default:	Measured by the electrical meter $M_p$ at the 220kV side of the 35~220kV on-site booster station with the accuracy of 0.2s (p=A, B, C, D, E) respectively.
Source of data:	Meter records.
Value(s) of monitored parameter:	Refer to Section E.
Monitoring equipment:	The same 5 meters to monitor $ES_{p, export, y}$ .
Measuring/ Reading/ Recording frequency:	Measuring continuously/ Reading daily / Recording monthly.
Calculation method (if applicable):	N/A.
QA/QC procedures:	Meters have been calibrated and checked yearly by a qualified third party for accuracy in accordance with national standards JJG1055-1997 and DL/T448—2000.
Purpose of data:	Baseline emission calculation.



Additional comment:	The gateway meters M <sub>g1</sub> and M <sub>g2</sub> operated well in this monitoring period and their readings were used to calculate the emission reductions. Hence, the readings from meters M <sub>A</sub> to M <sub>E</sub> were not used in the emission reductions calculation.
---------------------	--

Data / Parameter:	$EG_{facility, y}$
Unit:	MWh
Description:	Quantity of net electricity generation supplied by the Project to the grid in year y.
Measured/ Calculated / Default:	Calculated.
Source of data:	Calculated based on the meters: M <sub>g1</sub> (with the meter M <sub>g2</sub> as its back-up meter), M <sub>j,i</sub> (j=1, 2, ..., 8; i=1, 2, 3, 4 for Phase I project where j=1, i=1, 2, 3 for the other 7 projects where j=2 ~ 7).
Value(s) of monitored parameter:	137,233
Monitoring equipment:	The parameter $EG_{facility, y}$ is calculated on the basis on the equation stipulated in the section C.
Measuring/ Reading/ Recording frequency:	Measuring continuously/ Reading daily / Recording monthly.
Calculation method (if applicable):	Calculated with the formula presented in Section C.
QA/QC procedures:	The data is directly used for calculation of emission reduction and cross-checked with electricity ETNs.
Purpose of data:	Baseline emission calculation.
Additional comment:	N/A.

### D.3. Implementation of sampling plan

>>  
N/A

## SECTION E. Calculation of emission reductions or GHG removals by sinks

### E.1. Calculation of baseline emissions or baseline net GHG removals by sinks

>>

The baseline emissions in year y is calculated as follows:

$$BE_y = EG_{facility, y} \times EF_{grid, CM, y}$$

Where:

BE<sub>y</sub>: Baseline emissions in year y (tCO<sub>2</sub>e/yr);

EG<sub>facility, y</sub>: The net electricity supplied to the grid by the project (MWh);

EF<sub>grid, CM, y</sub>: Emission factor of the grid (tCO<sub>2</sub>e /MWh) (as calculated ex-ante in the revised PDD and will not be updated during the first crediting period).

According to the revised PDD, the combined baseline emission factor of the North China Power Grid is:

$$EF_{grid, CM, y} = 0.9309 \text{ tCO}_2\text{e/MWh.}$$

Table 5 Summary of electricity exported to the grid

Period		PHASE I : CHANGS HUN (ref. No. 2093)	PHASE II : SANDAO GOU (ref. No. 5781)	PHASE III: HEPING (ref. No. 5900)	PHASE IV: NIUJIACU N (ref. No. 5883)	PHASE V : NIUJIAFA NGZI (ref. No. 5992)	PHASE VI: SITAIFAN GZI (ref. No. 5990)	PHASE VII: ERLIGET U (ref. No. 5904)	PHASE VIII: CHELIWU SU (ref. No. 5909)	Sub-total	ES total, export .y
		ES I, export .y	ES II, export .y	ES III, export .y	ES IV, export .y	ES V, export .y	ES VI, export .y	ES VII, export .y	ES VIII, export .y		
From	To	MWh	MWh	MWh	MWh	MWh	MWh	MWh	MWh	MWh	MWh
01/03/2014	20/03/2014	8666.56	8990.52	9901.92	9705.36	9029.16	8456	8181.6	8254.96	71186.08	71186.85
21/03/2014	20/04/2014	7338.52	9837.52	10460.24	10060.12	8846.32	8796.48	8225.28	8220.8	71785.28	71783.56
21/04/2014	20/05/2014	9048.48	10368.68	10711.4	11039.28	9999.08	9932.16	9487.52	8888.88	79475.48	79370.53
21/05/2014	20/06/2014	9262.96	12239.08	11646.88	11626.16	10850.28	10853.08	10792.32	9459.24	86730	86729.48
21/06/2014	20/07/2014	4902.24	7776.72	7157.08	7155.68	5942.44	6068.16	5526.36	5232.92	49761.6	49761.91
21/07/2014	20/08/2014	4290.72	6554.24	6228.32	6836.2	5929.28	5939.92	5354.16	4772.32	45905.16	45905.36
21/08/2014	20/09/2014	4255.16	6297.2	6244.84	6422.92	5258.68	9248.4	12986.68	12341.84	63055.72	43900.11
21/09/2014	20/10/2014	6855.52	8975.68	8515.08	8414.56	7662.76	7637.56	7278.6	6439.44	61779.2	61518.04
21/10/2014	20/11/2014	9313.92	9058.84	9232.44	9232.44	8438.64	8022.84	7719.6	9157.4	70176.12	70176.05
21/11/2014	20/12/2014	13416.48	9514.96	6797.84	6822.48	13096.44	12382.16	12104.12	13157.76	87292.24	87292.54
21/12/2014	20/01/2015	11052.16	10251.36	6812.96	4273.08	10226.72	9261.84	9602.88	9836.12	71317.12	71317.27
21/01/2015	20/02/2015	7951.72	6647.48	7543.48	8173.48	6705.16	6590.08	6522.32	5956.44	56090.16	56089.55
21/02/2015	20/03/2015	9424.24	7256.48	11675.16	11704	10354.12	10410.68	10365.88	8473.08	79663.64	79663.86
21/03/2015	20/04/2015	8196.16	8898.4	9450.00	9821	8907.36	8421.56	8767.92	6941.76	69404.16	69404.10
21/04/2015	20/05/2015	7287.28	9078.72	9493.96	9851.8	9043.16	9110.36	9024.4	6942.32	69832	69831.72
21/05/2015	20/06/2015	3866.52	5741.68	5677.00	5484.92	4684.96	4627.84	9512.44	11703.16	51298.52	38194.00
21/06/2015	20/07/2015	3712.24	5019.28	5411.00	5225.08	4587.24	8539.16	4518.64	3881.36	40894	36772.57
21/07/2015	20/08/2015	8666.56	8990.52	9901.92	9705.36	9029.16	8456	8181.6	8254.96	71186.08	71186.85
Total		136663.52	149507.68	150034.08	150187.52	146163.36	151026.40	152874.68	145589.64	1182046.88	1145297.86

Table 6 Summary of electricity imported to the grid

Period		PHASE I : CHANGS HUN (ref. No. 2093)	PHASE II : SANDAO GOU (ref. No. 5781)	PHASE III: HEPING (ref. No. 5900)	PHASE IV: NIUJIACU N (ref. No. 5883)	PHASE V : NIUJIAFA NGZI (ref. No. 5992)	PHASE VI: SITAIFAN GZI (ref. No. 5990)	PHASE VII: ERLIGET U (ref. No. 5904)	PHASE VIII: CHELIWU SU (ref. No. 5909)	Sub-total	ES total, import .y
		ES I, import .y	ES II, import .y	ES III, import .y	ES IV, import .y	ES V, import .y	ES VI, import .y	ES VII, import .y	ES VIII, import .y		
From	To	MWh	MWh	MWh	MWh	MWh	MWh	MWh	MWh	MWh	MWh
01/03/2014	20/03/2014	184.24	504.00	249.48	273.28	250.04	251.72	190.68	207.48	2110.92	2118.12
21/03/2014	20/04/2014	185.64	407.96	352.24	275.24	251.72	253.96	192.08	209.16	2128.00	2134.26
21/04/2014	20/05/2014	212.24	480.76	402.52	314.72	287.84	290.08	219.52	239.12	2446.80	2439.98
21/05/2014	20/06/2014	217.28	497.28	411.72	322.00	294.56	196.56	224.56	244.72	2408.68	2494.85
21/06/2014	20/07/2014	94.36	258.72	179.20	140.00	127.96	129.08	97.72	106.40	1133.44	1086.08
21/07/2014	20/08/2014	94.36	258.16	178.92	140.00	128.24	129.08	97.72	106.40	1132.88	1085.40
21/08/2014	20/09/2014	100.52	274.68	190.40	148.96	136.08	137.20	103.88	112.84	1204.56	1154.14
21/09/2014	20/10/2014	185.92	509.04	353.08	275.80	252.42	254.52	192.36	209.72	2232.86	2138.55
21/10/2014	20/11/2014	194.32	531.16	368.15	287.84	263.34	265.16	201.04	218.68	2329.69	2231.70
21/11/2014	20/12/2014	333.76	912.80	632.85	494.76	452.76	356.16	345.24	376.04	3904.37	3835.77
21/12/2014	20/01/2015	231.84	634.20	439.60	343.84	314.44	316.68	239.68	260.96	2781.24	2664.75
21/01/2015	20/02/2015	119.56	327.32	227.08	177.43	162.12	163.52	123.76	134.96	1435.75	1375.10
21/02/2015	20/03/2015	130.48	357.00	247.52	193.57	176.96	178.64	134.96	147.00	1566.13	1500.33
21/03/2015	20/04/2015	288.12	787.92	546.28	427.00	390.60	393.40	297.92	324.24	3455.48	3310.27
21/04/2015	20/05/2015	177.24	485.52	336.28	263.20	240.80	242.48	183.68	199.92	2129.12	2039.42
21/05/2015	20/06/2015	234.36	640.64	444.36	347.20	317.52	220.36	242.20	263.76	2710.40	2692.43

2015	2015										
21/06/2015	20/07/2015	129.08	353.64	245.28	191.80	175.56	176.68	133.82	145.60	1551.46	1485.75
21/07/2015	20/08/2015	121.80	332.64	230.44	180.04	164.92	166.32	125.74	136.92	1458.82	1397.36
Total		3235.12	8553.44	6035.40	4796.68	4387.88	4121.60	3346.56	3643.92	38120.60	37184.26

**Table 7 Summary of net electricity delivered**

Period		PHASE II: SANDAOGOU (ref. No. 5781)
		EG facility, y
From	To	MWh
01/03/2014	20/03/2014	8,484.90
21/03/2014	20/04/2014	9,428.12
21/04/2014	20/05/2014	9,875.57
21/05/2014	20/06/2014	11,723.94
21/06/2014	20/07/2014	7,528.86
21/07/2014	20/08/2014	6,306.93
21/08/2014	20/09/2014	4,121.00
21/09/2014	20/10/2014	8,450.20
21/10/2014	20/11/2014	8,550.01
21/11/2014	20/12/2014	8,618.23
21/12/2014	20/01/2015	9,643.74
21/01/2015	20/02/2015	6,333.91
21/02/2015	20/03/2015	6,658.83
21/03/2015	20/04/2015	6,501.69
21/04/2015	20/05/2015	8,433.33
21/05/2015	20/06/2015	8,442.29
21/06/2015	20/07/2015	3,936.27
21/07/2015	20/08/2015	4,194.79
Total		137,233

Based on the electricity records list above, the Baseline Emissions ( $BE_y$ ) is calculated as follow:

**Table 8 Emission reduction of the Project from 01/03/2012 to 28/02/2014**

Period	Net electricity delivered(MWh)	$EF_{grid,CM,y}$ (tCO <sub>2</sub> e/MWh)	$BE_y$ (tCO <sub>2</sub> e)
Total	137,233	0.9309	127,749

## E.2. Calculation of project emissions or actual net GHG removals by sinks

>>

According to the applied methodology, as a renewable energy project, the project emissions of this project are zero.

## E.3. Calculation of leakage

>>

According to the applied methodology, as a renewable energy project, the Leakage of this project are zero.

**E.4. Summary of calculation of emission reductions or net GHG removals by sinks**

Item	Baseline emissions or baseline net GHG removals by sinks (t CO <sub>2</sub> e)	Project emissions or actual net GHG removals by sinks (t CO <sub>2</sub> e)	Leakage (t CO <sub>2</sub> e)	GHG emission reductions or net GHG removals by sinks (t CO <sub>2</sub> e) achieved in the monitoring period		
				Up to 31/12/2012	From 01/01/2013	Total amount
<b>Total</b>	127,749	0	0	0	127,749	127,749

**E.5. Comparison of actual emission reductions or net GHG removals by sinks with estimates in registered PDD**

Item	Values estimated in ex ante calculation of registered PDD	Actual values achieved during this monitoring period
Emission reductions or GHG removals by sinks (t CO <sub>2</sub> e)	136,199	127,749

**E.6. Remarks on difference from estimated value in registered PDD**

&gt;&gt;

The total emission reductions for this monitoring period are 127,749 tCO<sub>2</sub>e. The actual volume is 6.20% lower than the estimates in the revised PDD.

## Appendix 1. Contact information of project participants and responsible persons/entities

<b>Project participant and/or responsible person/ entity</b>	<input checked="" type="checkbox"/> Project participant <input type="checkbox"/> Responsible person/ entity for completing the CDM-MR-FORM
<b>Organization name</b>	China Water Group Huade Wind Power Co., Ltd.
<b>Street/P.O. Box</b>	Room 408, No.12, Lane 2, Baiguang Road, Xicheng District
<b>Building</b>	
<b>City</b>	Beijing
<b>State/Region</b>	Beijing
<b>Postcode</b>	100053
<b>Country</b>	P.R. China
<b>Telephone</b>	+86-10-5868 9628
<b>Fax</b>	+86-10-5868 9504
<b>E-mail</b>	
<b>Website</b>	
<b>Contact person</b>	Wang Hong Ye
<b>Title</b>	Department Director
<b>Salutation</b>	Ms.
<b>Last name</b>	Wang
<b>Middle name</b>	
<b>First name</b>	Hong Ye
<b>Department</b>	Planning & Development
<b>Mobile</b>	
<b>Direct fax</b>	+86-10-5868 9504
<b>Direct tel.</b>	+86-10-5868 9628
<b>Personal e-mail</b>	hollywang816@126.com

<b>Project participant and/or responsible person/ entity</b>	<input checked="" type="checkbox"/> Project participant <input checked="" type="checkbox"/> Responsible person/ entity for completing the CDM-MR-FORM
<b>Organization name</b>	Eco-Tec Asia (UK) Ltd.
<b>Street/P.O. Box</b>	12, Zhong Guan Cun South Street, Haidian District
<b>Building</b>	A803, Tianzuo International Building
<b>City</b>	Beijing
<b>State/Region</b>	
<b>Postcode</b>	100081
<b>Country</b>	P.R. China
<b>Telephone</b>	+86-10-62156001
<b>Fax</b>	+86-10-62156006
<b>E-mail</b>	
<b>Website</b>	
<b>Contact person</b>	Wu Xin
<b>Title</b>	Vice President
<b>Salutation</b>	Mr.
<b>Last name</b>	Wu
<b>Middle name</b>	
<b>First name</b>	Xin
<b>Department</b>	
<b>Mobile</b>	+86-18611685882
<b>Direct fax</b>	+86-10-62156006
<b>Direct tel.</b>	+86-10-62156001 ext 822
<b>Personal e-mail</b>	colin.wu@ecotec-asia.com

<b>Project participant and/or responsible person/ entity</b>	<input checked="" type="checkbox"/> Project participant <input type="checkbox"/> Responsible person/ entity for completing the CDM-MR-FORM
<b>Organization name</b>	Amsterdam Capital Trading B.V.
<b>Street/P.O. Box</b>	Herengracht 469, 4d verdieping
<b>Building</b>	1017 BS Amsterdam
<b>City</b>	Amsterdam
<b>State/Region</b>	Amsterdam
<b>Postcode</b>	1011
<b>Country</b>	Netherlands
<b>Telephone</b>	+31 208911781
<b>Fax</b>	+31 208911787
<b>E-mail</b>	jjanssen@group-act.com
<b>Website</b>	-
<b>Contact person</b>	<a href="#">Jaap Janssen</a>
<b>Title</b>	CEO
<b>Salutation</b>	Mr.
<b>Last name</b>	Janssen
<b>Middle name</b>	-
<b>First name</b>	Jaap
<b>Department</b>	-
<b>Mobile</b>	-
<b>Direct fax</b>	+31 208911787
<b>Direct tel.</b>	+31 208911781
<b>Personal e-mail</b>	jjanssen@group-act.com

- - - - -