

**MONITORING REPORT****Version: 01****Date: 01/07/2010****Title of the project: China Tongwan Hydropower Project****Reference number: 1590****The 4<sup>th</sup> monitoring period: 01/01/2010-30/06/2010 (incl. both dates)****SECTION A. General description of the project activity****A.1. Brief description of the project activity: >>**

&gt;&gt;

China Tongwan Hydropower Project (hereinafter referred to as “the project”) is a newly built hydropower plant. The purpose of the project is to generate electricity by using water resources to alleviate electricity shortage in Central China. The project will contribute to the reduction of GHG emission by displacing part of the electricity supplied by Central China Power Grid (CCPG), which is dominant of fuel-fired power plants.

The total installed capacity of the project is 180 MW, which is consisted of 4 sets of 45 MW generators. The project construction was started on 22 March 2005. The commissioning dates of 4 generators are 25 December 2007, 31 May 2008, 26 October 2008 and 23 December 2008 respectively. There was no physical change and no any accident happened to the project during the monitoring period. The project was operational under normal status during the monitoring period.

Total emission reductions achieved in given monitoring period are 220,561 tCO<sub>2</sub>.

**A.2. Project Participants**

&gt;&gt;

Name of Party involved (*) ((host) indicates a host Party)	Private and/or public entity(ies) project participants (*) (as applicable)	Kindly indicate if the Party involved wishes to be considered as project participant (Yes/No)
People's Republic of China (Host)	Hunan Zhongfang Tongwan Water Resources & Hydropower Development Co., Ltd	No
Sweden	Carbon Asset Management Sweden AB	No
Netherlands	Carbon Asset Management Sweden AB	No

(\*) In accordance with the CDM modalities and procedures, at the time of making the CDM-PDD public at the stage of validation, a Party involved may or may not have provided its approval. At the time of requesting registration, the approval by the Party(ies) involved is required.

**A.3. Location of the project activity:**

&gt;&gt;



The project is located at Tongwan Town, Zhongfang County, Huaihua City, Hunan Province, P.R.China. The project is 49 km away from Huaihua City. The geographical coordinates of the project are:

110 °17'19" E  
27 °35'02" N

#### A.4. Technical description of the project

>>

The project is a newly built medium size hydropower plant, the total installed capacity will be 180 MW. The project makes use of water resources for electricity generation. The project is connected to Yangtang Substation through 220 kV × 30 km transmission line. The generated electricity will be delivered to CCPG. Table below shows the characteristics of the equipments employed.

Turbine	Unit	4
	Model	GZ4BN28B-WP-710
	Manufacturer	Tianjin Alstom Hydro Co., Ltd.
	Rated rotate speed	83.3 r/min
	Rated water head	11 m
	Rated flow rate	459.79 m <sup>3</sup> /s
Generator	Unit	Unit: 4
	Model	SFWG45-72/7550
	Manufacturer	Tianjin Alstom Hydro Co., Ltd.
	Single capacity	45 MW
	Rated voltage	10.5 kV

#### A.5. Title, reference and version of the baseline and monitoring methodology applied to the project activity:

>>

**Title of the approved baseline methodology:** ACM0002-Consolidated baseline methodology for grid-connected electricity generation from renewable sources (Version 06, 19 May 2006)

**Title of the approved monitoring methodology:** ACM0002-Consolidated monitoring methodology for zero-emissions grid-connected electricity generation from renewable sources (Version 06, 19 May 2006)

**Reference:** Tool for the demonstration and assessment of additionality (Version 03, 16 February 2007)

#### A.6. Registration date of the project activity:

>>

30/10/2008

#### A.7. Crediting period of the project activity and related information (start date and choice of crediting period):

>>

Choice of crediting period: renewable crediting period  
Length of the first crediting period: 7 years and 0 month



There was no change to the start date of the crediting period post registration has been made.

**A.8. Name of responsible person(s)/entity(ies):**

&gt;&gt;

Person and entity responsible for completing the monitoring report form:

Hanson Xu, Carbon Asset Management Sweden AB, E-mail: [hanson.xu@tricornase.se](mailto:hanson.xu@tricornase.se), Tel: +86-10-65305930-105

Carbon Asset Management Sweden AB is the project participant.

**SECTION B. Implementation of the project activity****B.1. Implementation status of the project activity**

&gt;&gt;

The implementation and operational status of the project are as follows:

Event	Time
Project construction	22/03/2005
Registration date	30/10/2008
Crediting period	30/10/2008-29/10/2015 (renewable)
Operation of 1 <sup>st</sup> generator	25/12/2007
Operation of 2 <sup>nd</sup> generator	31/05/2008
Operation of 3 <sup>rd</sup> generator	26/10/2008
Operation of 4 <sup>th</sup> generator	23/12/2008
1 <sup>st</sup> monitoring period	30/10/2008-31/01/2009
2 <sup>nd</sup> monitoring period	01/02/2009-31/08/2009
3 <sup>rd</sup> monitoring period	01/09/2009-31/12/2009
4 <sup>th</sup> monitoring period	01/01/2010-30/06/2010

There were no special events happened to the project during the monitoring period. The project was operational as normal during the monitoring period.

**B.2. Revision of the monitoring plan**

&gt;&gt;

No monitoring plan revision has been requested for the project.

**B.3. Request for deviation applied to this monitoring period**

&gt;&gt;

No deviation has been requested for the given monitoring period.

**B.4. Notification or request of approval of changes**

&gt;&gt;

No notification or request of approval of changes have been made for the project.


**SECTION C. Description of the monitoring system**

&gt;&gt;

### General description of monitoring system:

The generated electricity from 1# generator and 2# generator is transmitted through 10.5 kV line I into 1# main transformer to boost voltage to 220 kV; the generated electricity from 3# generator and 4# generator is transmitted through 10.5 kV line II into 2# main transformer to boost voltage to 220 kV. Then the electricity is delivered through two 220 kV transmission lines to 220 kV Yangtang Substation and then to power grid.

There are two bidirectional electronic meters (Master Meter<sub>1</sub> and Master Meter<sub>2</sub>) are installed at high voltage sides of main transformers to monitor the power exported to power grid and power imported from power grid as per signed Power Purchase Agreement (PPA). Furthermore, there is also a Backup Meter with same accuracy and function for each Master Meter to ensure the monitoring purpose if the Master Meters are found malfunction. The power electric connection diagram is as follow:

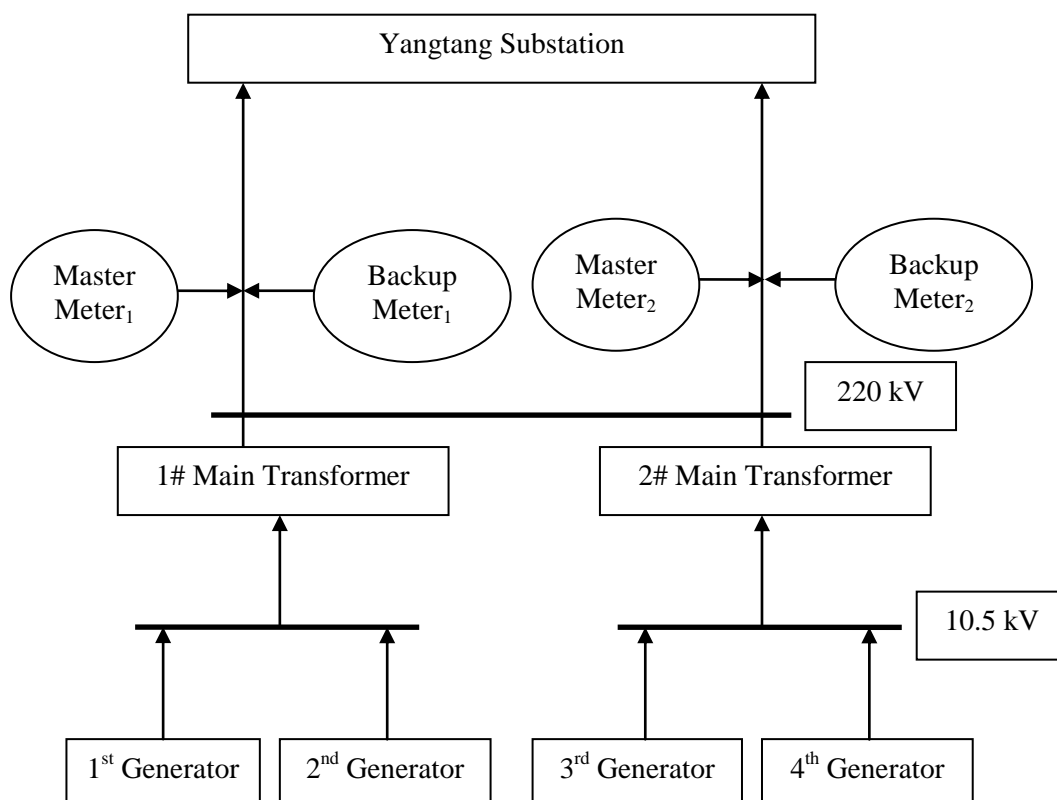

The magnification factor of Master Meters is 1,320,000, which is calculated based on voltage ratio of potential transformer (PT) and current ratio of current transformer (CT)

There are totally 6 sets of PT and CT for the project, every 3 sets of PT and CT are for one transmission line. The calibration details of PT and CT are as follows:



Equipment	CT	PT
Serial Number	F2GA F2GB, F2GC, F4GA, F4GB, F4GC	503710, 503708, 503707, 503711, 503709, 503712
Calibration Date	06/12/2007	05/12/2007
Calibration Valid Until	05/12/2017	04/12/2017
Calibration Entity	Testing and Research Institute of Hunan Electric Power Company, which is authorized by Administration of Quality and Technology Supervision of Hunan Province.	

Note: The CT and PT are calibrated as per Verification Regulation of Instrument Transformers in Power System (JJG 1021-2007). As per JJG 1021-2007, the calibration frequency for CT and PT is 10 years.

According to calibration records for PT & CT conducted by Testing and Research Institute of Hunan Electric Power Company on 5<sup>th</sup> and 6<sup>th</sup> December 2007:

Rated primary voltage of PT is 220 kV

Rated secondary voltage of PT is 100 V

Then voltage ratio of PT is 2200 (it equals to 220 kV/100 V)

Rated primary current of CT is 600 A

Rated Secondary current of CT is 1 A

Then current ratio of CT is 600 (it equals to 600 A/1 A)

Thus the final magnification factor applied for the meter is:

voltage ratio  $\times$  current ratio =  $2200 \times 600 = 1,320,000$

#### **Data collection procedures:**


The power imported from power grid and power exported to power grid data were measured continuously by Master Meters and were recorded by grid company monthly. The meter readings were aggregated on Master Meters.

For power exported to grid, the power grid company provided the electricity transaction notes to project owner in the early of each month. The monitoring director from project entity checked and confirmed the electricity transaction notes based on the monitored meter readings. The finance department from project entity issued the electricity sales receipts and then financial manager Mr. He Hua from project entity confirmed the electricity sales receipts. Finally the power grid company paid the money to project owner for electricity transactions.

For power imported from grid, the project owner paid the money to the grid company based on confirmed monthly monitoring records provided by grid company and then got the power purchase receipts from grid company.

#### **Organizational structure:**

The monitoring organizational structure is as follow:

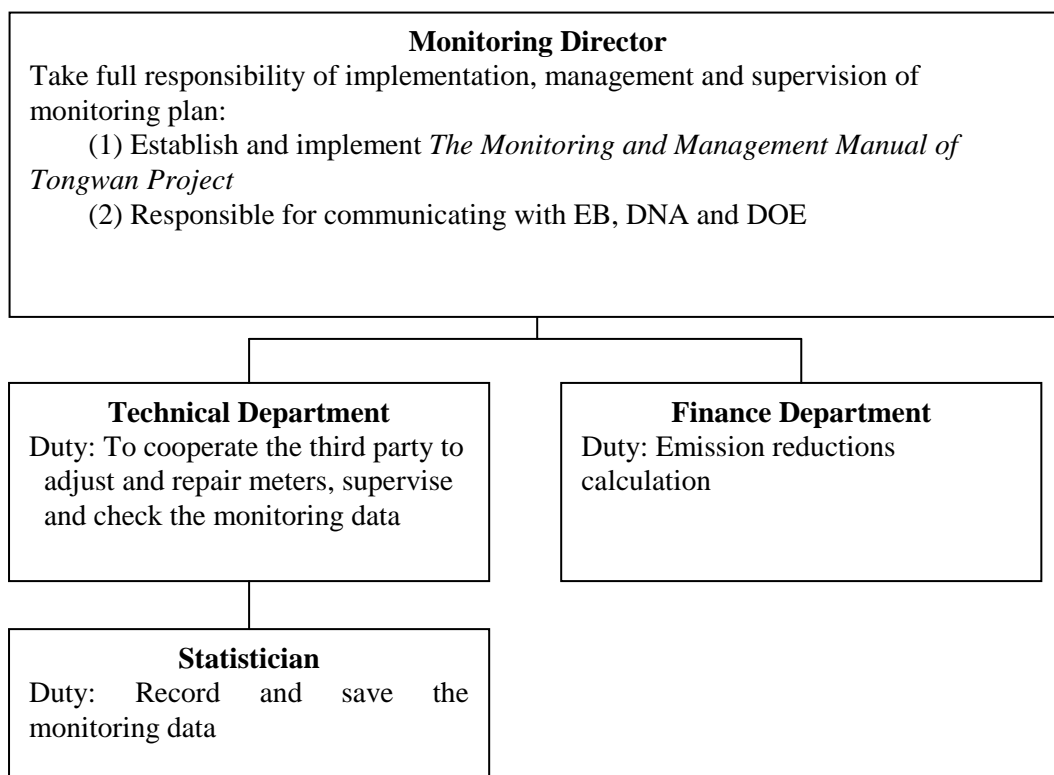**Roles and responsibilities of personnel:**

Monitoring Director: Mr. Liu Changsheng is responsible for the overall management of the monitoring plan and for the internal verification of the monitored data.

Technical Department: It is consisted of operational employees, the group is leaded by the Mr. Li Binbin. The department is responsible for internal regular maintenance of monitoring equipment and DCS system

Statistician: To conduct the monitoring task strictly based on the monitoring manual and registered PDD. The statisticians are responsible for recording required monitored parameters, for reporting the monitoring results and for reporting the abnormal situation of the project. Each shift is responsible for the works.

Finance Department: Mr. He Hua is responsible for the department. The department is responsible for calculating the emission reductions regularly and for preparing the sales receipts of electricity transaction. The internal audit for CERs calculation is conducted by monitoring director.

**Training:**

The project staffs have been trained respectively regarding operational regulations, quality control, data monitoring & archive and CDM knowledge.

**Emergency procedures:**



The Backup Meter will be used for monitoring when Master Meter is in malfunction status. During the given monitoring period, the Master Meters were in well functions and Backup Meters were not used for monitoring.

## SECTION D. Data and parameters

### D.1. Data and parameters determined at registration and not monitored during the monitoring period, including default values and factors

<b>Data / Parameter:</b>	Surface Area
Data unit:	km <sup>2</sup>
Description:	Surface area at the full reservoir level
Source of data used:	Water Resources Bureau of Huaihua City
Value(s) :	12
Indicate what the data are used for (Baseline/ Project/ Leakage emission calculations)	The data is used for power density calculation. The power density is calculated as 15 W/m <sup>2</sup> , thus the project emissions are not needed to be considered.  The data was measured by Water Resources Bureau of Huaihua City at the start of the operation of the project. According to ACM0002 (Version 06), the data should only be monitored at start of the project during the crediting period. The data is not needed to be monitored since the data has been verified during 1 <sup>st</sup> verification. The first verification request has been approved by EB on 21 <sup>st</sup> August 2009.
Additional comment:	The data measured by Water Resources Bureau of Huaihua City is reliable and creditable.

<b>Data / Parameter:</b>	$NCV_i$
Data unit:	kJ/kg or kJ/m <sup>3</sup> or TJ/tce
Description:	The net calorific value (energy content) per mass or volume unit of fuel $i$
Source of data used:	<i>China Energy Statistical Yearbook 2006.</i>
Value(s) :	Please refer to the registered PDD.
Indicate what the data are used for (Baseline/ Project/ Leakage emission calculations)	The data is used for calculation of baseline emission factor, which are fixed during the 1 <sup>st</sup> crediting period.
Additional comment:	

<b>Data / Parameter:</b>	$OXID_i$
Data unit:	/
Description:	Oxidation factor of the fuel $i$
Source of data used:	<i>Revised 2006 IPCC Guidelines for National Greenhouse Gas Inventories</i>
Value(s) :	100%
Indicate what the data are used for (Baseline/ Project/ Leakage emission)	The data is used for calculation of baseline emission factor, which are fixed during the 1 <sup>st</sup> crediting period.



calculations)	
Additional comment:	

<b>Data / Parameter:</b>	$F_{i,j,y}$
Data unit:	$10^4 \text{ t}, 10^8 \text{ m}^3$
Description:	The quantity of fuel $i$ (in a mass or volume unit) consumed by the relevant provinces $j$ in year(s) $y$
Source of data used:	<i>China Energy Statistical Yearbook 2004-2006</i>
Value(s) :	Please refer to the registered PDD.
Indicate what the data are used for (Baseline/ Project/ Leakage emission calculations)	The data is used for calculation of baseline emission factor, which are fixed during the 1 <sup>st</sup> crediting period.
Additional comment:	

<b>Data / Parameter:</b>	<i>Electricity generation of power plants in CCPG</i>
Data unit:	MWh
Description:	The electricity generated by province $j$ in CCPG in year $y$ .
Source of data used:	<i>China Electric Power Yearbook 2004-2006</i>
Value(s) :	Please refer to the registered PDD.
Indicate what the data are used for (Baseline/ Project/ Leakage emission calculations)	The data is used for calculation of baseline emission factor, which are fixed during the 1 <sup>st</sup> crediting period.
Additional comment:	

<b>Data / Parameter:</b>	<i>Internal use rate of power plant</i>
Data unit:	%
Description:	The internal power consumption rate of power plants in province $j$ in CCPG in year $y$ .
Source of data used:	<i>China Electric Power Yearbook 2004-2006</i>
Value(s) :	Please refer to the registered PDD.
Indicate what the data are used for (Baseline/ Project/ Leakage emission calculations)	The data is used for calculation of baseline emission factor, which are fixed during the 1 <sup>st</sup> crediting period.
Additional comment:	

<b>Data / Parameter:</b>	$EF_{CO_2, i}$
Data unit:	tCO <sub>2</sub> /TJ
Description:	The CO <sub>2</sub> emission factor per unit of fuel $i$
Source of data used:	<i>Revised 2006 IPCC Guidelines for National Greenhouse Gas Inventories</i>
Value(s) :	Please refer to the registered PDD.
Indicate what the data are used for (Baseline/ Project/ Leakage emission calculations)	The data is used for calculation of baseline emission factor, which are fixed during the 1 <sup>st</sup> crediting period.



Additional comment:	
---------------------	--

<b>Data / Parameter:</b>	$CAP_{i,j,y}$
Data unit:	MW
Description:	Installed capacities of power plant category $i$ of province $j$ in years $y$ .
Source of data used:	<i>China Electric Power Yearbook 2001-2006</i>
Value(s) :	Please refer to the registered PDD.
Indicate what the data are used for (Baseline/ Project/ Leakage emission calculations)	The data is used for calculation of baseline emission factor, which are fixed during the 1 <sup>st</sup> crediting period.
Additional comment:	

<b>Data / Parameter:</b>	$GENE_{best,coal,i}$
Data unit:	/
Description:	The power supply efficiency of most advanced commercialized coal-fired power plants
Source of data used:	Chinese DNA's Guideline of emission factors of Chinese grids
Value(s) :	Please refer to the registered PDD.
Indicate what the data are used for (Baseline/ Project/ Leakage emission calculations)	The data is used for calculation of baseline emission factor, which are fixed during the 1 <sup>st</sup> crediting period.
Additional comment:	

<b>Data / Parameter:</b>	$GENE_{best,oil/gas}$
Data unit:	/
Description:	The power supply efficiency of most advanced commercialized oil-fired power plants and gas-fired power plants
Source of data used:	Chinese DNA's Guideline of emission factors of Chinese grids
Value(s) :	Please refer to the registered PDD.
Indicate what the data are used for (Baseline/ Project/ Leakage emission calculations)	The data is used for calculation of baseline emission factor, which are fixed during the 1 <sup>st</sup> crediting period.
Additional comment:	

## D.2. Data and parameters monitored

<b>Data / Parameter:</b>	$EG_y$
Data unit:	MWh
Description:	Net generated electricity delivered to CCPG
Measured /Calculated /Default:	Calculated based on difference between power exported to power grid and power imported from power grid.
Source of data:	Meters
Value(s) of monitored parameter:	Power export: 232078.440 MWh Power import: 6.600 MWh
Indicate what the data	The data is used for baseline emission calculations.



are used for (Baseline/ Project/ Leakage emission calculations)																																																										
Monitoring equipment (type, accuracy class, serial number, calibration frequency, date of last calibration, validity)	<p>The power imported from power grid and power exported to power grid were measured continuously by two bidirectional Master Meters and were recorded monthly. The information of meters are as follows:</p> <table><tr><th>Item</th><th>Master Meter<sub>1</sub></th><th>Master Meter<sub>2</sub></th><th>Backup Meter<sub>1</sub></th><th>Backup Meter<sub>2</sub></th></tr><tr><td>Type</td><td>AINTRAL-X</td><td>AINTRAL-X</td><td>AINTRAL-X</td><td>AINTRAL-X</td></tr><tr><td>Serial Number</td><td>03218434</td><td>03218457</td><td>03218436</td><td>03218433</td></tr><tr><td>Accuracy</td><td>0.2S</td><td>0.2S</td><td>0.2S</td><td>0.2S</td></tr></table> <p>Calibration information:</p> <table><tr><th>Meter</th><th>Calibration date</th><th>Valid until</th></tr><tr><td rowspan="3">Master Meter<sub>1</sub></td><td>14/10/2009</td><td>13/01/2010</td></tr><tr><td>10/01/2010</td><td>09/04/2010</td></tr><tr><td>09/04/2010</td><td>08/07/2010</td></tr><tr><td rowspan="3">Master Meter<sub>2</sub></td><td>14/10/2009</td><td>13/01/2010</td></tr><tr><td>10/01/2010</td><td>09/04/2010</td></tr><tr><td>09/04/2010</td><td>08/07/2010</td></tr><tr><td rowspan="3">Backup Meter<sub>1</sub></td><td>14/10/2009</td><td>13/01/2010</td></tr><tr><td>10/01/2010</td><td>09/04/2010</td></tr><tr><td>09/04/2010</td><td>08/07/2010</td></tr><tr><td rowspan="3">Backup Meter<sub>2</sub></td><td>14/10/2009</td><td>13/01/2010</td></tr><tr><td>10/01/2010</td><td>09/04/2010</td></tr><tr><td>09/04/2010</td><td>08/07/2010</td></tr><tr><td>Calibration Frequency</td><td colspan="2">Quarterly</td></tr><tr><td>Calibration Entity</td><td colspan="2">Testing and Research Institute of Hunan Electric Power Company, which is authorized by Administration of Quality and Technology Supervision of Hunan Province</td></tr></table> <p>Note: During the given monitoring period, the Master Meters were in well functions and Backup Meters were not used for monitoring.</p>	Item	Master Meter <sub>1</sub>	Master Meter <sub>2</sub>	Backup Meter <sub>1</sub>	Backup Meter <sub>2</sub>	Type	AINTRAL-X	AINTRAL-X	AINTRAL-X	AINTRAL-X	Serial Number	03218434	03218457	03218436	03218433	Accuracy	0.2S	0.2S	0.2S	0.2S	Meter	Calibration date	Valid until	Master Meter <sub>1</sub>	14/10/2009	13/01/2010	10/01/2010	09/04/2010	09/04/2010	08/07/2010	Master Meter <sub>2</sub>	14/10/2009	13/01/2010	10/01/2010	09/04/2010	09/04/2010	08/07/2010	Backup Meter <sub>1</sub>	14/10/2009	13/01/2010	10/01/2010	09/04/2010	09/04/2010	08/07/2010	Backup Meter <sub>2</sub>	14/10/2009	13/01/2010	10/01/2010	09/04/2010	09/04/2010	08/07/2010	Calibration Frequency	Quarterly		Calibration Entity	Testing and Research Institute of Hunan Electric Power Company, which is authorized by Administration of Quality and Technology Supervision of Hunan Province	
Item	Master Meter <sub>1</sub>	Master Meter <sub>2</sub>	Backup Meter <sub>1</sub>	Backup Meter <sub>2</sub>																																																						
Type	AINTRAL-X	AINTRAL-X	AINTRAL-X	AINTRAL-X																																																						
Serial Number	03218434	03218457	03218436	03218433																																																						
Accuracy	0.2S	0.2S	0.2S	0.2S																																																						
Meter	Calibration date	Valid until																																																								
Master Meter <sub>1</sub>	14/10/2009	13/01/2010																																																								
	10/01/2010	09/04/2010																																																								
	09/04/2010	08/07/2010																																																								
Master Meter <sub>2</sub>	14/10/2009	13/01/2010																																																								
	10/01/2010	09/04/2010																																																								
	09/04/2010	08/07/2010																																																								
Backup Meter <sub>1</sub>	14/10/2009	13/01/2010																																																								
	10/01/2010	09/04/2010																																																								
	09/04/2010	08/07/2010																																																								
Backup Meter <sub>2</sub>	14/10/2009	13/01/2010																																																								
	10/01/2010	09/04/2010																																																								
	09/04/2010	08/07/2010																																																								
Calibration Frequency	Quarterly																																																									
Calibration Entity	Testing and Research Institute of Hunan Electric Power Company, which is authorized by Administration of Quality and Technology Supervision of Hunan Province																																																									
Measuring/ Reading/ Recording frequency:	The power imported from power grid and power exported to power grid were measured continuously by two bidirectional Master Meters and were recorded monthly.																																																									
Calculation method (if applicable):	The data is calculated based on difference between power exported to power grid and power imported from power grid:  $EG_y = \text{Power export} - \text{power import}$																																																									
QA/QC procedures applied:	The monitoring data is used for emission reductions calculation. Sales/purchase receipts and electricity transaction notes are used for double check.																																																									

**SECTION E. Emission reductions calculation**

### E.1. Baseline emissions calculation

>>

The baseline emission during the monitoring period is:

$$BE_y = EG_y EF_y$$

Where:

$EG_y$  is electricity supplied by the project activity to the grid in year  $y$ , in MWh;

$EF_y$  is baseline emission factor in year  $y$ , in tCO<sub>2</sub>e/MWh.

The monitored data for the project are as follow:

Period	Power export (MWh)	Power import (MWh)	Net power supply (MWh)
	A	B	C
01/01/2010-31/01/2010	24427.920	0.000	24427.920
01/01/2010-28/02/2010	10227.360	0.000	10227.360
01/03/2010-31/03/2010	12356.520	0.000	12356.520
01/04/2010-30/04/2010	44151.360	0.000	44151.360
01/05/2010-31/05/2010	53147.160	0.000	53147.160
01/06/2010-30/06/2010	87768.120	6.600	87761.520
<b>Sum</b>	<b>232078.440</b>	<b>6.600</b>	<b>232071.840</b>

Note: All the meter readings in above table are sourced from 2 Master Meters, the meter readings have been confirmed by grid company. The monthly cut-off time for power export and power import data is 24:00 of the last day of each month.

Net power supply data is 232071.840 MWh.

#### According to Page 26 of registered Tongwan PDD<sup>1</sup>:

*The project will involve influencing 3 small hydropower plants, the total installed capacity of the 3 small hydropower plants is 1.35 MW. The 3 small hydropower plants have been compensated by Tongwan project owner. The average annual total power generation of the 3 small hydropower plants is 7000 MWh. In order to be conservative, the 3 small hydropower plants are assumed to operate full year. Thus, the annual power generation of 11826 MWh (1.35 MW×8760 h=11826 MWh) is deducted from power supply by Tongwan (66200 – 11826=650174 MWh) and the method will always be used to calculate the baseline emission during the whole 3 renewable crediting periods.*

<sup>1</sup> According to explanation document from design institute, the 3 small hydropower plants are located at the 3 different branches of Yuanshui River while Tongwan is located at Yuanshui River. The 3 small hydropower plants are 11 km, 12 km and 29 km away from Tongwan project site respectively. Due to construction of Tongwan project, the water level of the river is increased. The 3 small hydropower plants are affected by the increased water level. However, after modification of the 3 small hydropower plants, these 3 small hydropower plants are operational as before now. In order to be conservative and in line with the registered PDD, we'd like to abide by the calculation method in the registered PDD for Tongwan project.

The monitoring period is 01/01/2010 to 30/06/2010, totally 181 days.

Thus the power generation to 3 small hydropower power plants during monitoring period is:

$$1.35 \text{ MW} \times 8760 \text{ h} / 365 \text{ d} \times 181 \text{ d} = 5864.400 \text{ MWh}$$

$$BE_y = (232071.840 - 5864.400) \times 0.97504 \text{ tCO}_2/\text{MWh} = 220,561 \text{ tCO}_2$$

## E.2. Project emissions calculation

>>

The project is a newly built hydropower plant, the power density is 15 W/m<sup>2</sup>, greater than 10 W/m<sup>2</sup>,  $PE_y=0$

## E.3. Leakage calculation

>>

According to ACM0002,  $L_y = 0$

## E.4. Emission reductions calculation / table

>>

According to ACM0002, the emission reduction of the project is:

$$ER_y = BE_y - PE_y - L_y$$

Total baseline emissions: 220,561 tCO<sub>2</sub>

Total project emissions: 0 tCO<sub>2</sub>

Total leakage: 0 tCO<sub>2</sub>

Total emission reductions: 220,561 tCO<sub>2</sub>

## E.5. Comparison of actual emission reductions with estimates in the CDM-PDD

>>

The comparison of actual values of the emission reductions achieved during the monitoring period with the estimations in the registered CDM-PDD:

Item	Values applied in ex-ante calculation of the registered CDM-PDD	Actual values reached during the monitoring period
Emission reductions (tCO <sub>2</sub> e)	314,367*	220,561

\*The data is average one calculated based on registered PDD. The monitoring period covers 181 days. The annual estimated CERs are 633,945 tCO<sub>2</sub> as per registered PDD.

The actual values of the emission reductions achieved during the monitoring period are 29.84% lower than registered PDD. In order to further substantiate the comparison, the comparison with the full year data is also conducted for the project. The result shows that the actual annual emission reductions (01/07/2009-30/06/2010: 432,424 tCO<sub>2</sub>) covering the monitoring period are 31.79% lower than registered PDD (633,945 tCO<sub>2</sub>).



<b>E.6. Remarks on difference from estimated value in the PDD</b>
---

&gt;&gt;

According to paragraph 10 of Annex 68 of EB 48:

*Comparison of the actual emission reduction claimed in the monitoring period with the estimate in the registered PDD, **and explanation on any significant increase.***

Furthermore, according to Guidelines for Completing the Monitoring Report Form (Annex 34, EB 54):

*Please provide an explanation of the cause of any **increase** in the actual emission reductions achieved during the current monitoring period (e.g. higher water availability, higher load plant factor, etc), including all information (i.e. data and/or parameters) that is different from that stated in the registered CDM-PDD.*

The comparison result shows that the actual emission reductions during the given monitoring period or full year period are less than the estimation in the registered PDD. The reason is due to the actual water resources during past years are poorer than estimation in Preliminary Design Report of the project.